

Section 6—Masterpact NW Dimensional Drawings

MASTERPACT NW ENCLOSURE INFORMATION	100
MASTERPACT NW UL/ANSI 3P DRAWOUT CIRCUIT BREAKERS	100
800–3000 A and 3200 A (H1, H2, H3) Master Drawing	100
800–2000 A Rear Connected "T" Vertical (RCTV)	101
800–2000 A Rear Connected "T" Horizontal (RCTH)	101
800–2000 A Front Connected Flat (FCF)	102
800–3000 A Front Connected "T" (FCT)	102
2500–3000 A Rear Connected "T" Horizontal (RCTH)	103
2000 A L1 & 3200 A Rear Connected Offset Vertical (RCOV)	103
2500–3000 A Rear Connected "T" Vertical (RCTV)	104
3200 A L1 and 4000–6000 A Master Drawing	104
3200 A L1 and 4000–5000 A Rear Connected "T" Vertical (RCTV)	105
3200 A L1 and 4000–5000 A Rear Connected "T" Horizontal (RCTH)	105
3200 A L1 and 4000 A Front Connected Flat (FCF)	106
3200 A L1 and 4000–5000 A Front Connected "T" (FCT)	106
6000 A Rear Connected "T" Vertical (RCTV)	107
MASTERPACT NW DRAWOUT CRADLE MOUNTING	107
800–3000 A and 3200 A (H1, H2, H3) Door Cutout	108
3200 A L1 and 4000–6000 A Door Cutout	108
DOOR ESCUTCHEON HOLE PATTERN	109
MASTERPACT NW UL/ANSI 3P FIXED CIRCUIT BREAKERS	110
800–3000 A and 3200 A Master Drawing	110
800–2000 A Rear Connected "T" Vertical (RCTV)	111
800–2000 A Rear Connected "T" Horizontal (RCTH)	111
800–2000 A Front Connected Flat (FCF)	112
800–3000 A Front Connected "T" (FCT)	112
2500–3000 A Rear Vertical "T" Horizontal (RCTV)	113
2500–3000 A Rear Connected "T" Horizontal (RCTH)	113
2000 L1 and 3200 A Rear Connected Offset Vertical (RCOV)	114
4000 A (W-Frame) Rear Connected Offset Vertical (RCOV)	114
4000–6000 A Master Drawing	115
4000–5000 A Rear Connected "T" Vertical (RCTV)	115
4000–5000 A Rear Connected "T" Horizontal (RCTH)	116
6000 A Rear Connected "T" Vertical (RCTV)	116
800–3200 A Door Cutout	117
4000–6000 A Door Cutout	117
MASTERPACT NW UL AND ANSI 4P DRAWOUT CIRCUIT BREAKERS	118
800–3000 A and 3200 A Master Drawing	118
800–2000 A Rear Connected "T" Vertical (RCTV)	119
800–2000 A Rear Connected "T" Horizontal (RCTH)	119
800–2000 A Front Connected Flat (FCF)	120
800–3000 A Front Connected "T" (FCT)	120
2500–3000 A Rear Connected "T" Vertical (RCTV)	121
2500–3000 A Rear Connected "T" Horizontal (RCTH)	121
2000 A L1 and 3200 A Rear Connected Offset Vertical (RCOV)	122
3200 A L1 and 4000–6000 A Master Drawing	123
3200 A L1 and 4000–5000 A Rear Connected "T" Vertical (RCTV)	123
3200 A L1 and 4000–5000 A Rear Connected "T" Horizontal (RCTH)	124
3200 A L1 and 4000 A Front Connected Flat (FCF)	124
3200 A L1 and 4000–5000 A Front Connected "T" (FCT)	125
6000 A Rear Connected "T" Vertical (RCTV)	125

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

MASTERPACT NW UL AND ANSI 4P FIXED CIRCUIT BREAKERS	126
800–3000 A and 3200 A Master Drawing	126
800–2000 A Rear Connected "T" Vertical (RCTV)	126
800–2000 A Rear Connected "T" Horizontal (RCTH)	127
800–2000 A Front Connected Flat (FCF)	127
800–3000 A Front Connected "T" (FCT)	128
2000 A L1 and 3200 A Rear Connected Offset Vertical (RCOV)	128
2500–3000 A Rear Vertical "T" Horizontal (RCTV)	129
2500–3000 A Rear Connected "T" Horizontal (RCTH)	129
4000–6000 A Master Drawing	130
4000–5000 A Rear Connected "T" Vertical (RCTV)	130
4000–5000 A Rear Connected "T" Horizontal (RCTH)	131
6000 A Rear Connected "T" Vertical (RCTV)	131
Pan Drawings for 3P and 4P Circuit Breakers	132
MASTERPACT NW NEUTRAL CURRENT TRANSFORMERS	133
Neutral Current Transformer 100–250 A, 400–2000 A	133
Neutral Current Transformer 2000–4000 A	133
Double Neutral Current Transformer 2000–6300 A	133
MDGF/SGR Current Transformer	134
MASTERPACT NW IEC 3P DRAWOUT CIRCUIT BREAKERS	135
800–3200 A Rear Connected "T" Vertical (RCTV)	135
800–3200 A Rear Connected "T" Horizontal (RCTH)	136
800–3200 A Front Connected Flat (FCF)	136
4000 A Rear Connected "T" Vertical (RCTV)	137
4000 A Rear Connected "T" Horizontal (RCTH)	137
5000 A Rear Connected "T" Vertical (RCTV)	138
5000 A Rear Connected "T" Horizontal (RCTH)	138
6300 A Rear Connected "T" Vertical (RCTV)	139
MASTERPACT NW IEC 3P FIXED CIRCUIT BREAKERS	140
800–3200 A Rear Connected "T" Vertical (RCTV)	140
800–3200 A Rear Connected "T" Horizontal (RCTH)	140
800–3200 A Front Connected Flat (FCF)	141
4000 A Rear Connected "T" Vertical (RCTV)	141
4000 A Rear Connected "T" Horizontal (RCTH)	142
5000 A Rear Connected "T" Vertical (RCTV)	142
5000 A Rear Connected "T" Horizontal (RCTH)	143
6300 A Rear Connected "T" Vertical (RCTV)	143
MASTERPACT NW IEC 4P DRAWOUT CIRCUIT BREAKERS	144
800–3200 A Rear Connected "T" Vertical (RCTV)	144
800–3200 A Rear Connected "T" Horizontal (RCTH)	145
800–3200 A Front Connected Flat (FCF)	145
4000 A Rear Connected "T" Vertical (RCTV)	146
4000 A Rear Connected "T" Horizontal (RCTH)	146
5000 A Rear Connected "T" Vertical (RCTV)	147
5000 A Rear Connected "T" Horizontal (RCTH)	147
6300 A Rear Connected "T" Vertical (RCTV)	148
MASTERPACT NW IEC 4P FIXED CIRCUIT BREAKERS	149
800–3200 A Rear Connected "T" Vertical (RCTV)	149
800–3200 A Rear Connected "T" Horizontal (RCTH)	150
800–3200 A Front Connected Flat (FCF)	150
4000 A Rear Connected "T" Vertical (RCTV)	151
4000 A Rear Connected "T" Horizontal (RCTH)	151
5000 A Rear Connected "T" Vertical (RCTV)	152
5000 A Rear Connected "T" Horizontal (RCTH)	152
6300 Rear Connected "T" Vertical (RCTV)	153

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings


Enclosure Information

Table 61: Minimum Enclosure Information

Number of Poles	Circuit Breaker Rating	Circuit Breaker Enclosure Dimensions		Ventilation Area					
		(H x W x D)		Top		Bottom		Front Face	
		in.	mm	in. ²	mm ²	in. ²	mm ²	in. ²	mm ²
3P	2000 A and below, UL 1066 (ANSI C37.50)	21.25 x 21.75 x 15.75	539.8 x 552.5 x 400	59.62	38 460	35.62	22 980	—	—
	3000 A and below, UL 489	18.37 x 24.00 x 15.75	466.6 x 609.6 x 400	16.62	10 720	16.62	10 720	—	—
	3200 A, and 4000 A (W-Frame) UL 1066 (ANSI C37.50)	31.00 x 21.75 x 15.75	787.4 x 552.5 x 400	59.62	38 460	—	—	93.6	60 390
	4000–5000 A, UL 1066 (ANSI C37.50)	33.00 x 32.62 x 15.75	838.2 x 828.5 x 400	198.75	128 230	—	—	130.5	84 190
	4000–6000 A, UL 489	21.75 x 36.00 x 15.75	552.5 x 914.4 x 400	16.62	10 720	16.62	10 720	—	—
4P	2000 A and below, UL 1066 (ANSI C37.50)	21.25 x 26.28 x 15.75	539.8 x 667.5 x 400	59.62	38 460	35.62	22 980	—	—
	3000 A and below, UL 489	18.37 x 30.00 x 15.75	466.6 x 762.0 x 400	16.62	10 720	16.62	10 720	—	—
	3200 A, and 4000 A (W-Frame) UL 1066 (ANSI C37.50)	31.00 x 26.28 x 15.75	787.4 x 667.5 x 400	59.62	38 460	—	—	93.6	60 390
	4000–5000 A, UL 1066 (ANSI C37.50)	33.00 x 41.68 x 15.75	838.2 x 1058.7 x 400	198.75	128 230	—	—	130.5	84 190
	4000–6000 A, UL 489	21.75 x 45.00 x 15.75	552.5 x 1168.4 x 400	16.62	10 720	16.62	10 720	—	—

UL®/ANSI 3P Drawout Circuit Breakers

Figure 68: 800–3000 A and 4000 A (H1, H2, H3) Master Drawing

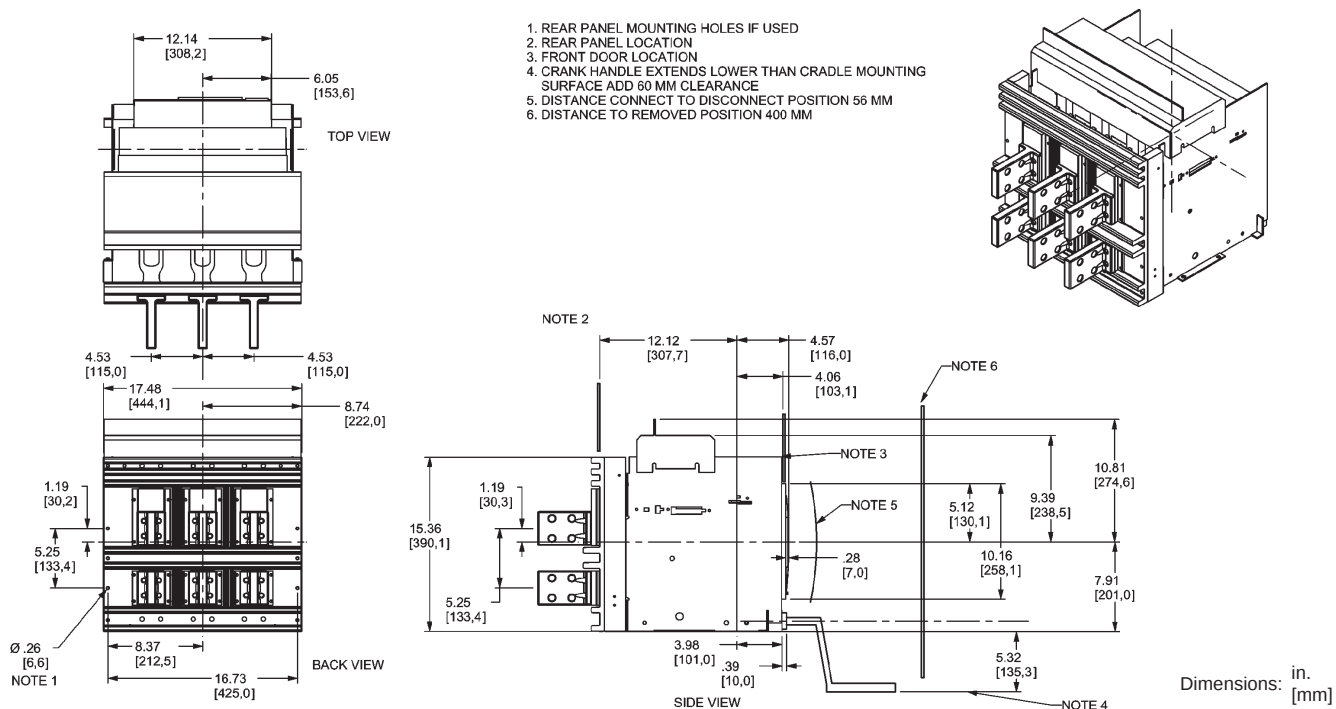

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 69: 800–2000 A Rear-Connected "T" Vertical (RCTV)


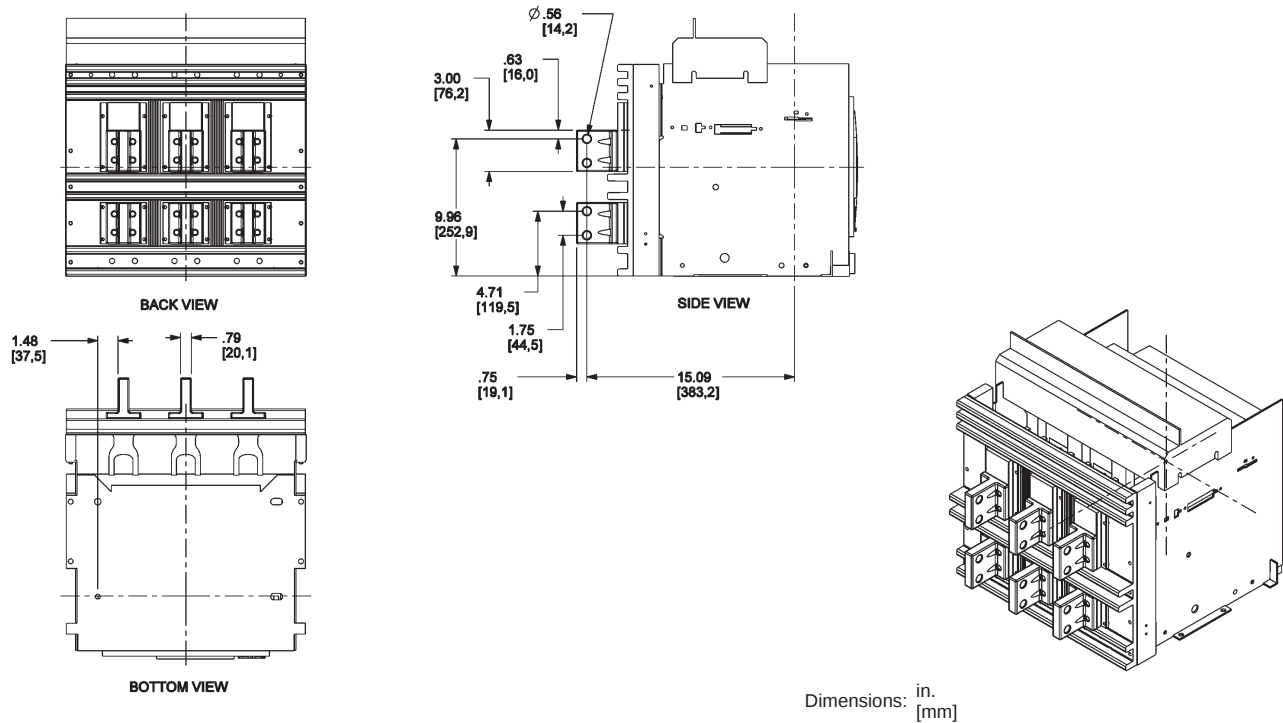


Figure 70: 800–2000 A Rear-Connected "T" Horizontal (RCTH)

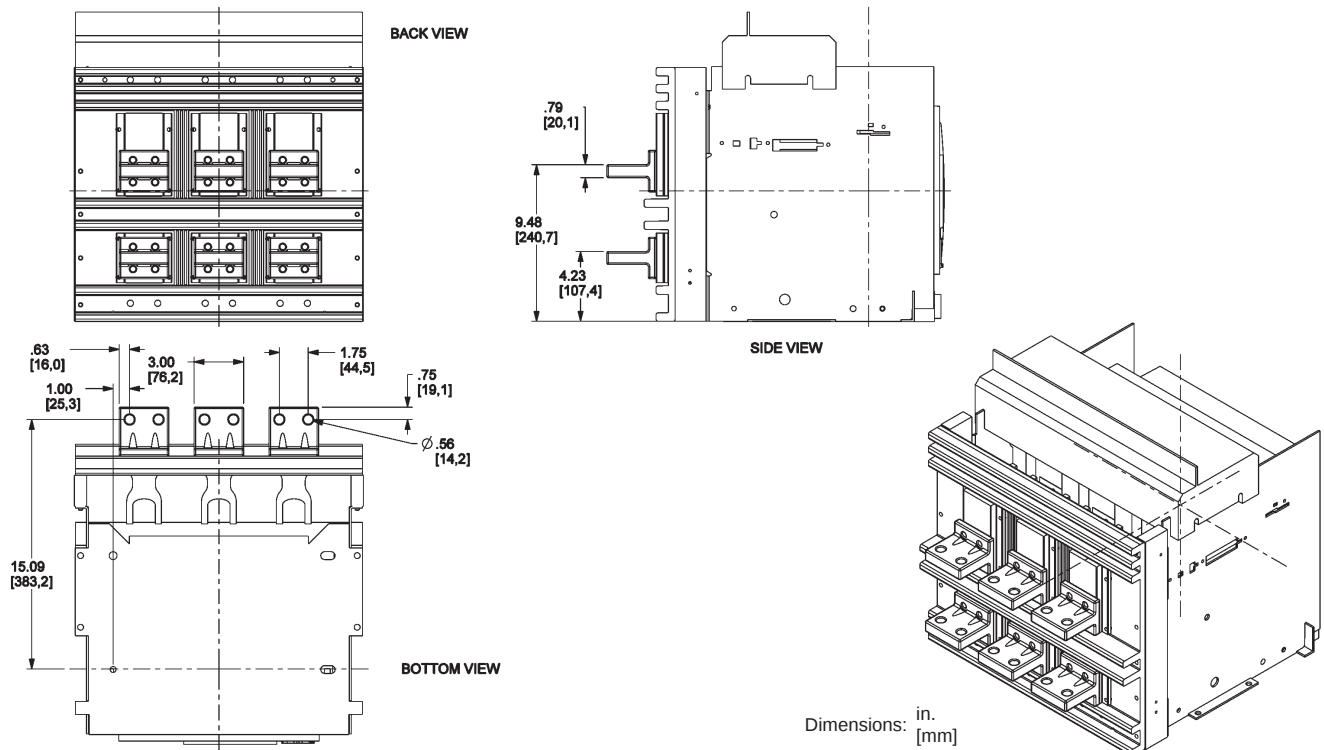

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 71: 800–2000 A Front-Connected Flat (FCF)


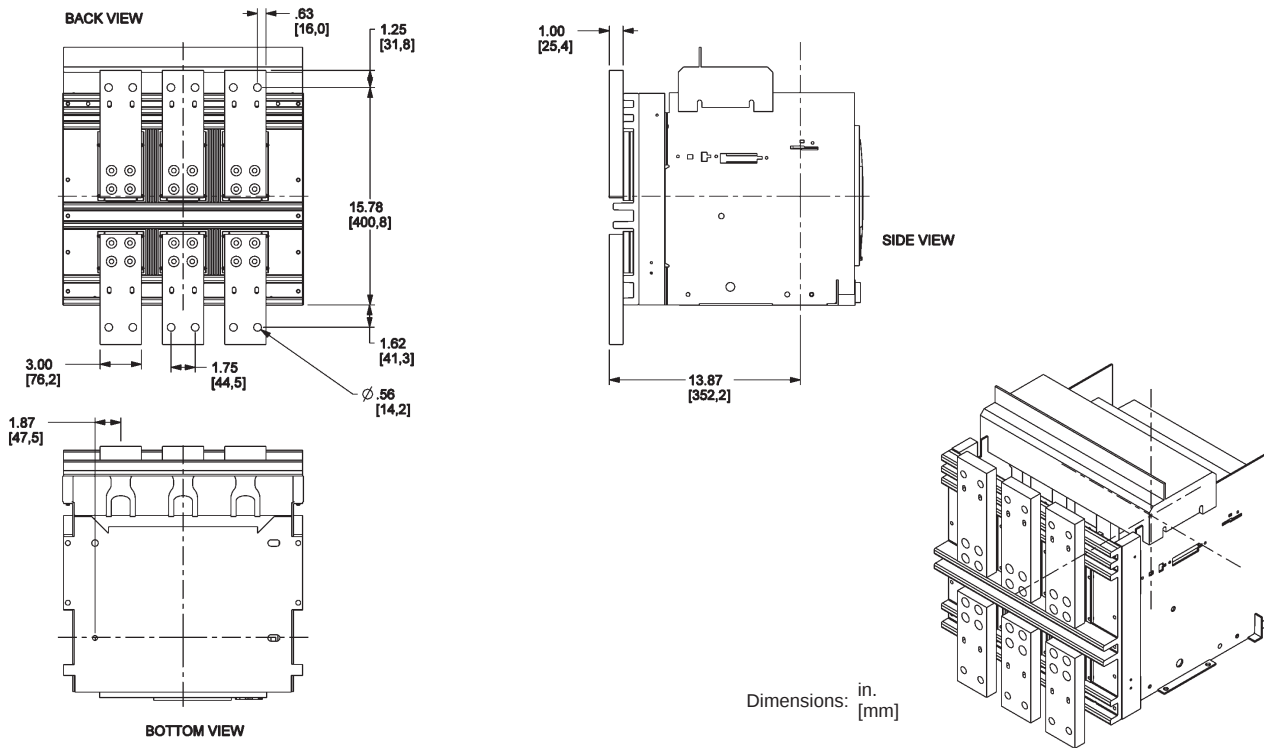


Figure 72: 800–3000 A Front-Connected "T" (FCT)

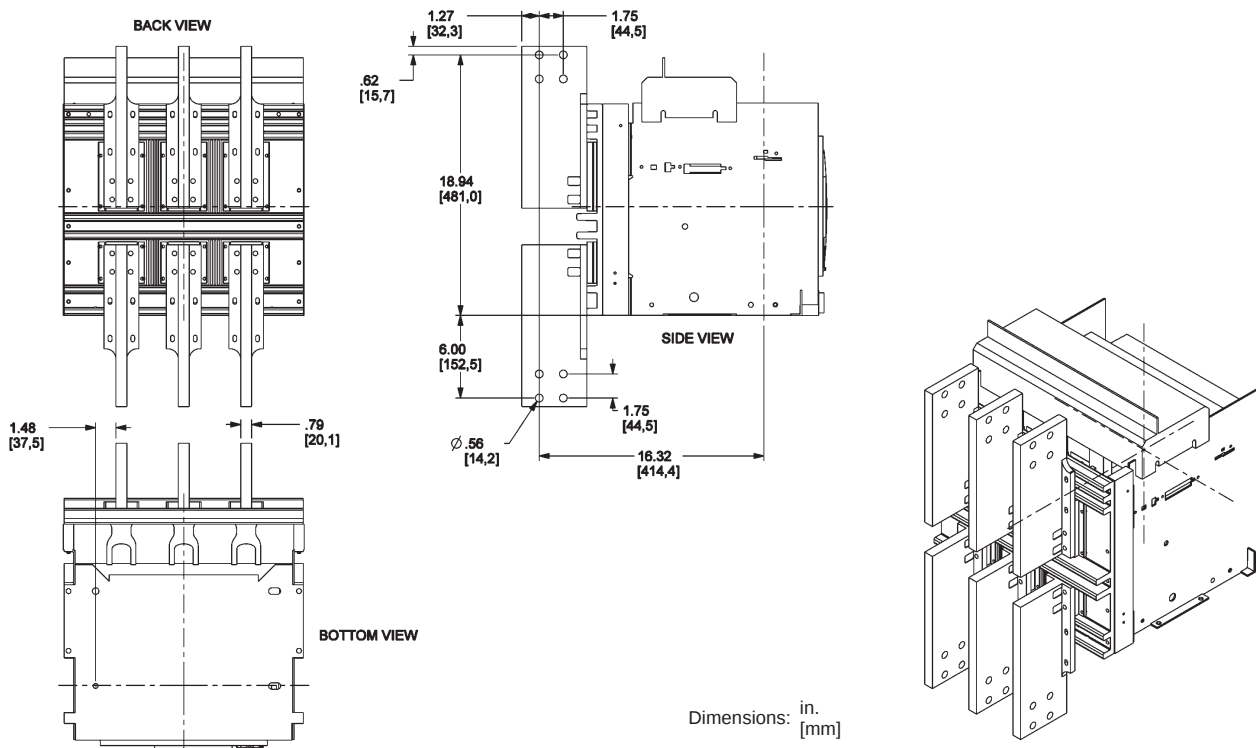

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 73: 2500–3000 A Rear-Connected "T" Horizontal (RCTH)


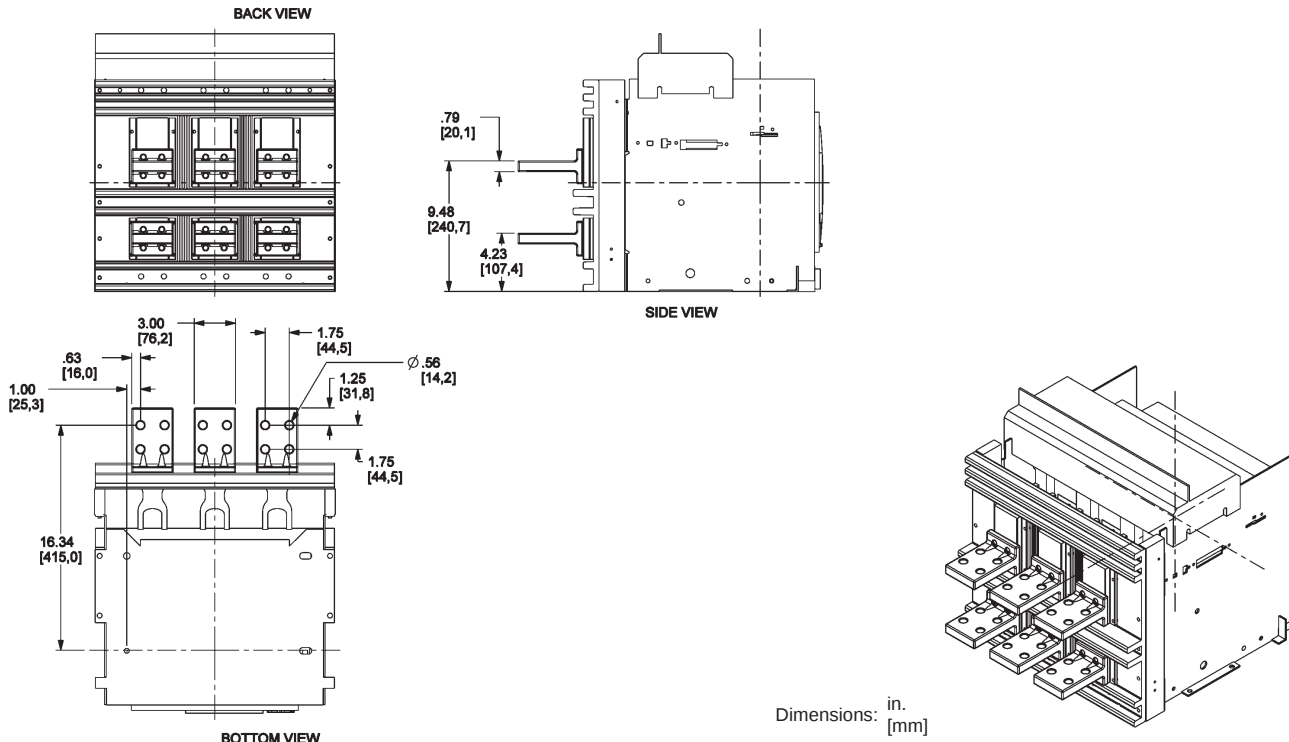


Figure 74: 2000 A L1 and 3200 A Rear-Connected Offset Vertical (RCOV)

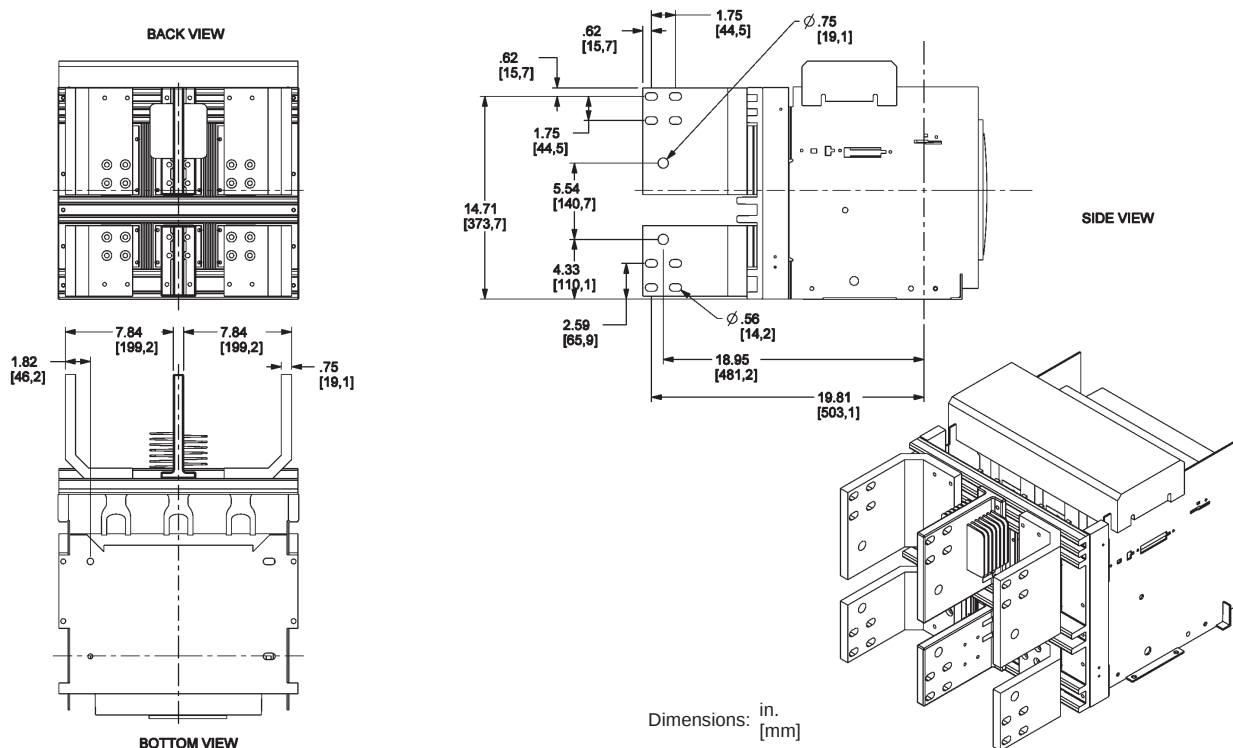

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 75: 2500–3000 A Rear-Connected "T" Vertical (RCTV)


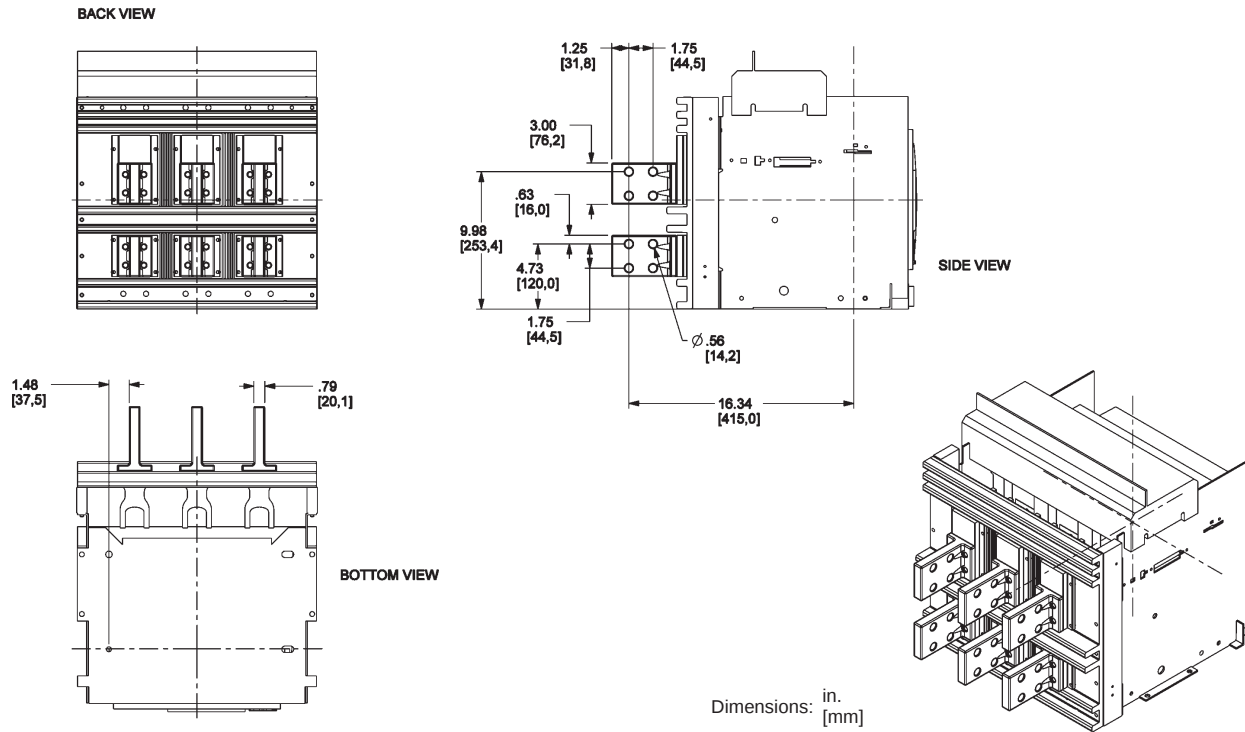


Figure 76: 3200 A L1 and 4000–6000 A Master Drawing

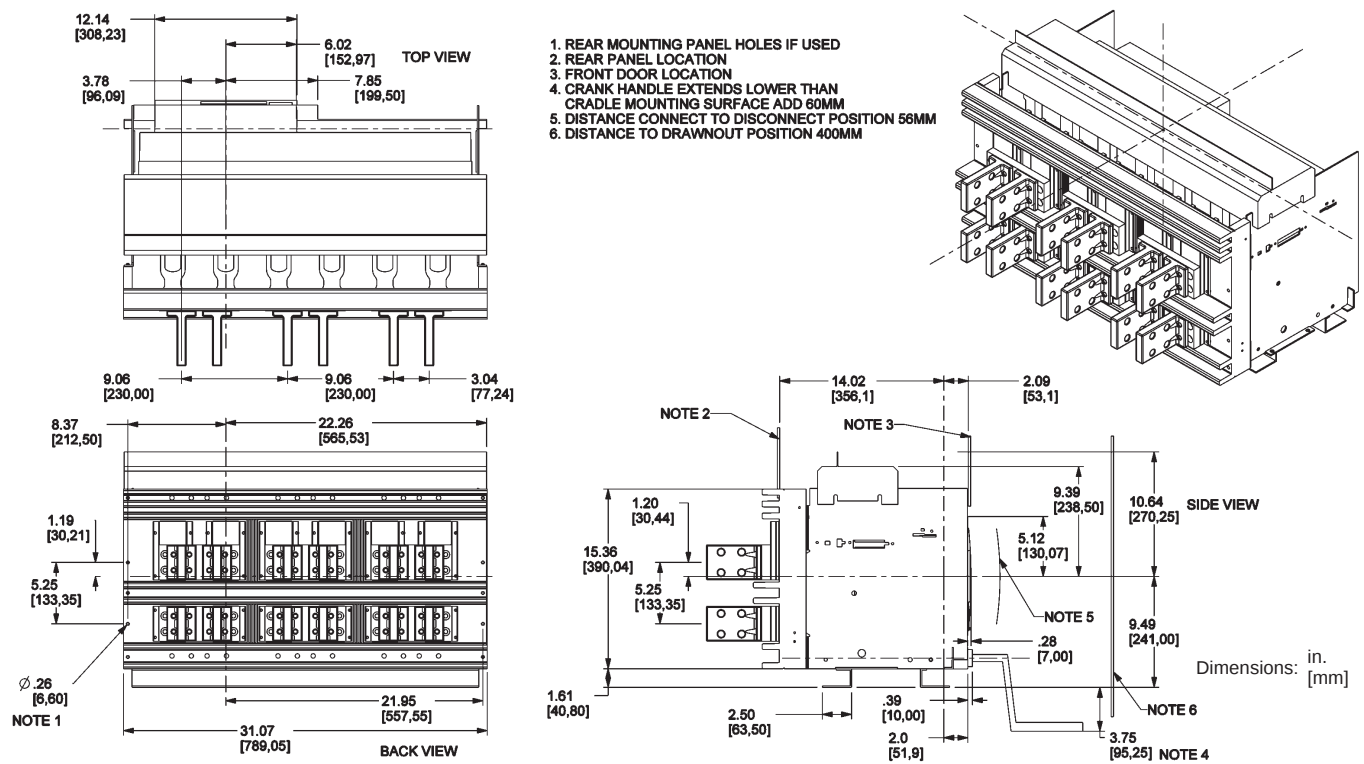

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 77: 3200 A L1 and 4000–5000 A Rear-Connected "T" Vertical (RCTV)


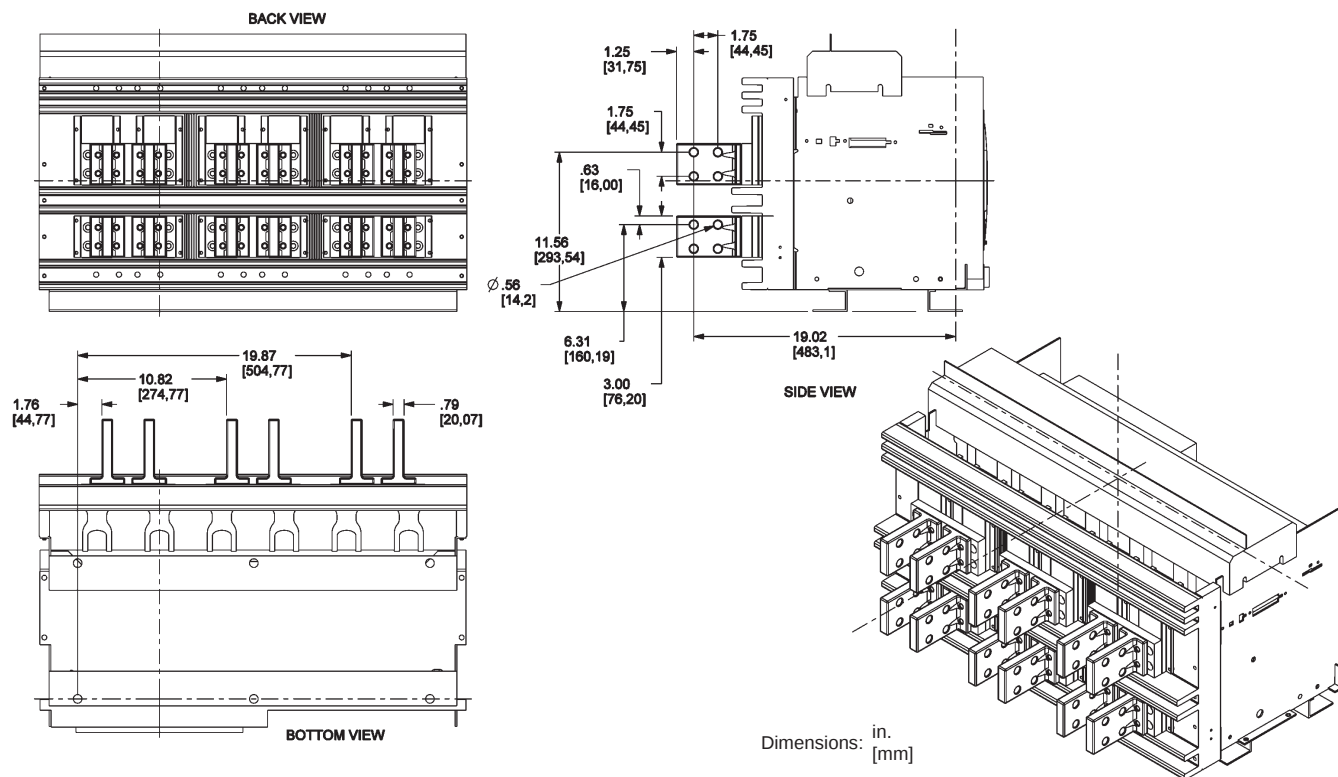


Figure 78: 3200 A L1 and 4000–5000 A Rear-Connected "T" Horizontal (RCTH)

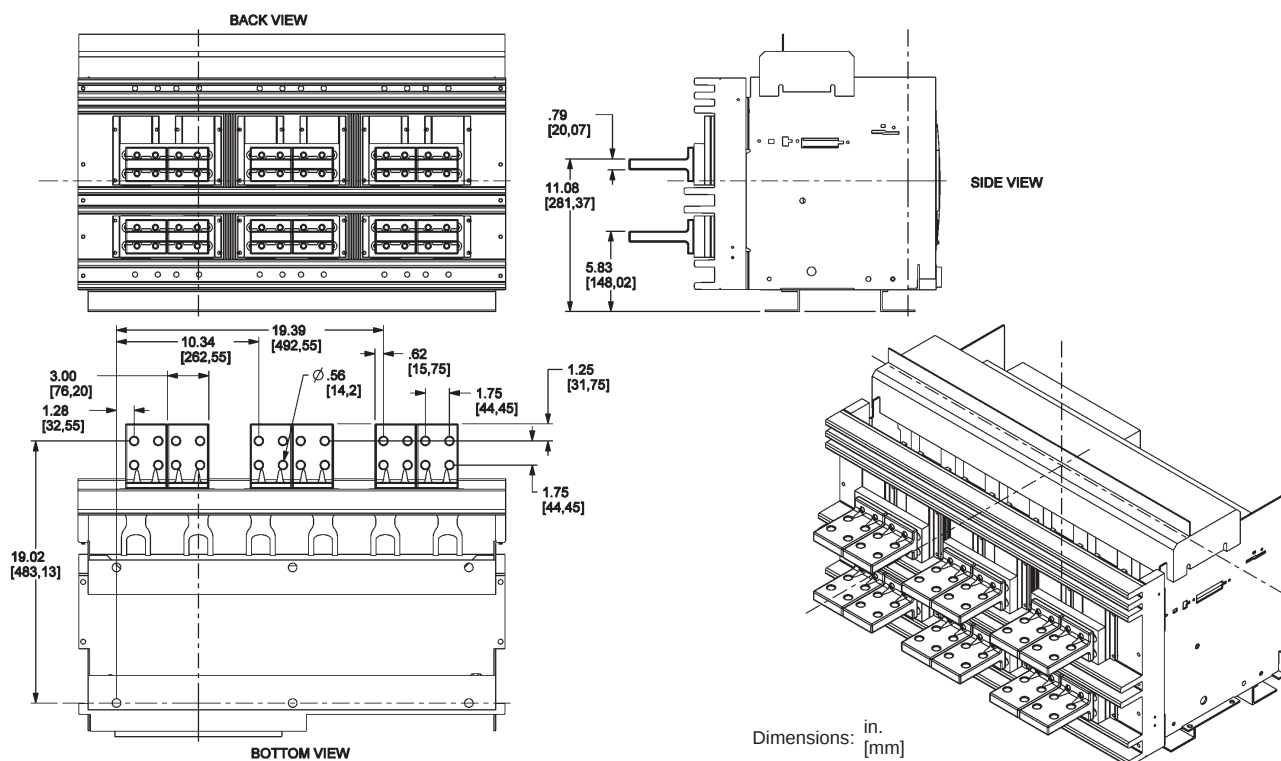

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 79: 3200 A L1 and 4000 A Front-Connected Flat (FCF)


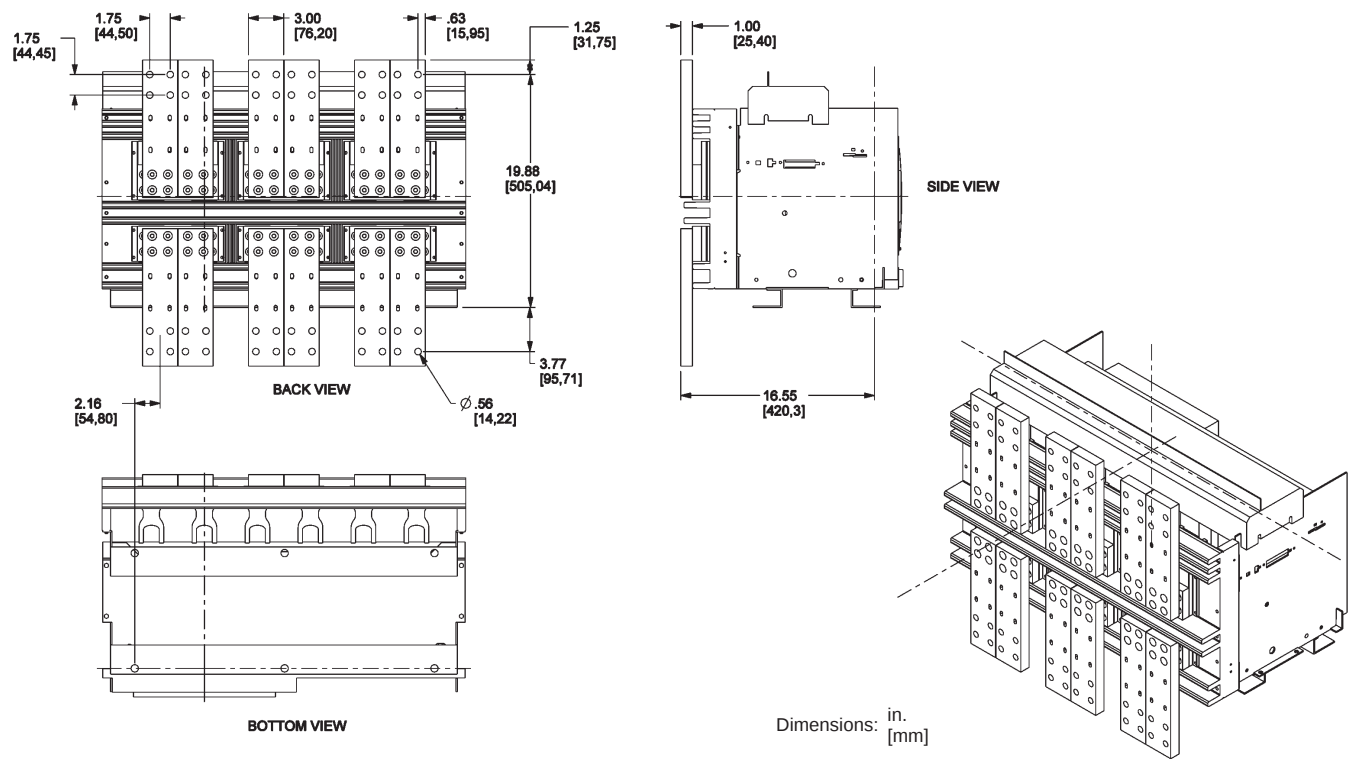


Figure 80: 3200 A L1 and 4000–5000 A Front-Connected "T" (FCT)

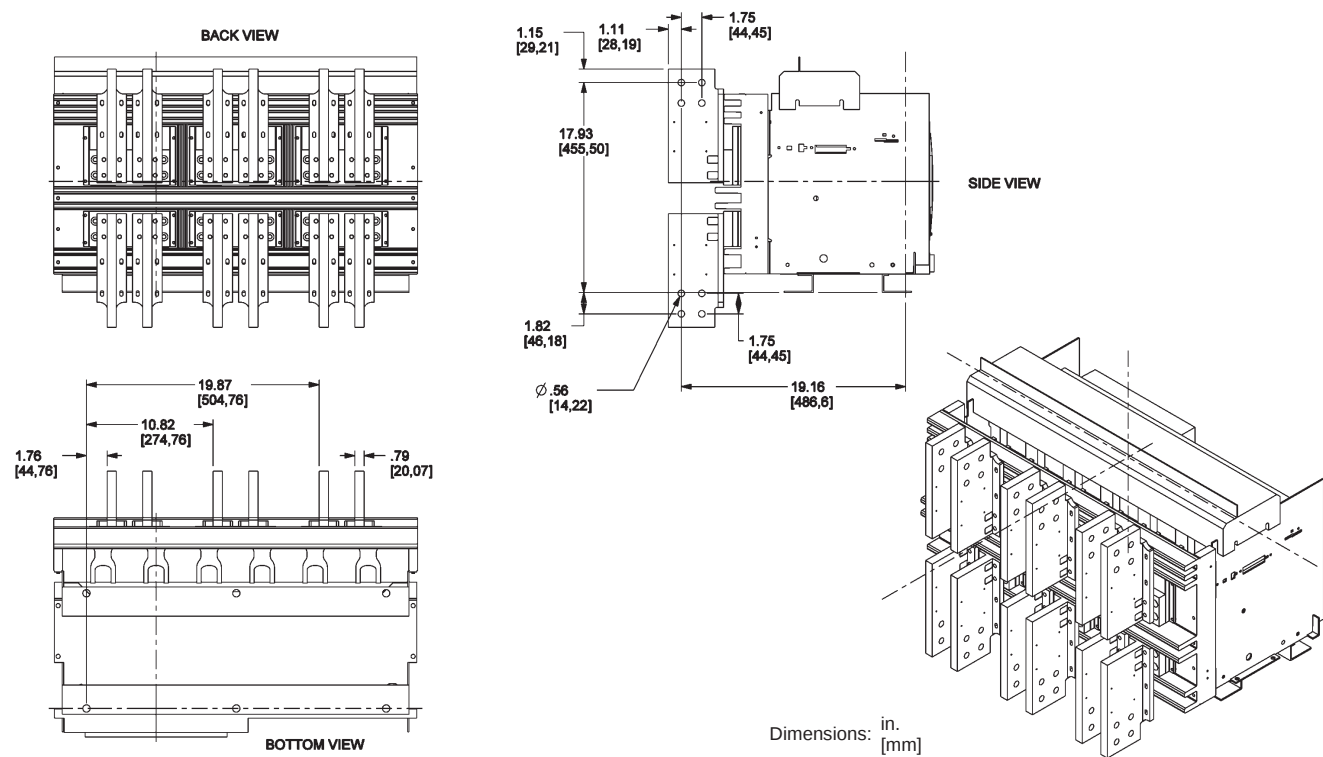

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 81: 6000 A Rear-Connected "T" Vertical (RCTV)


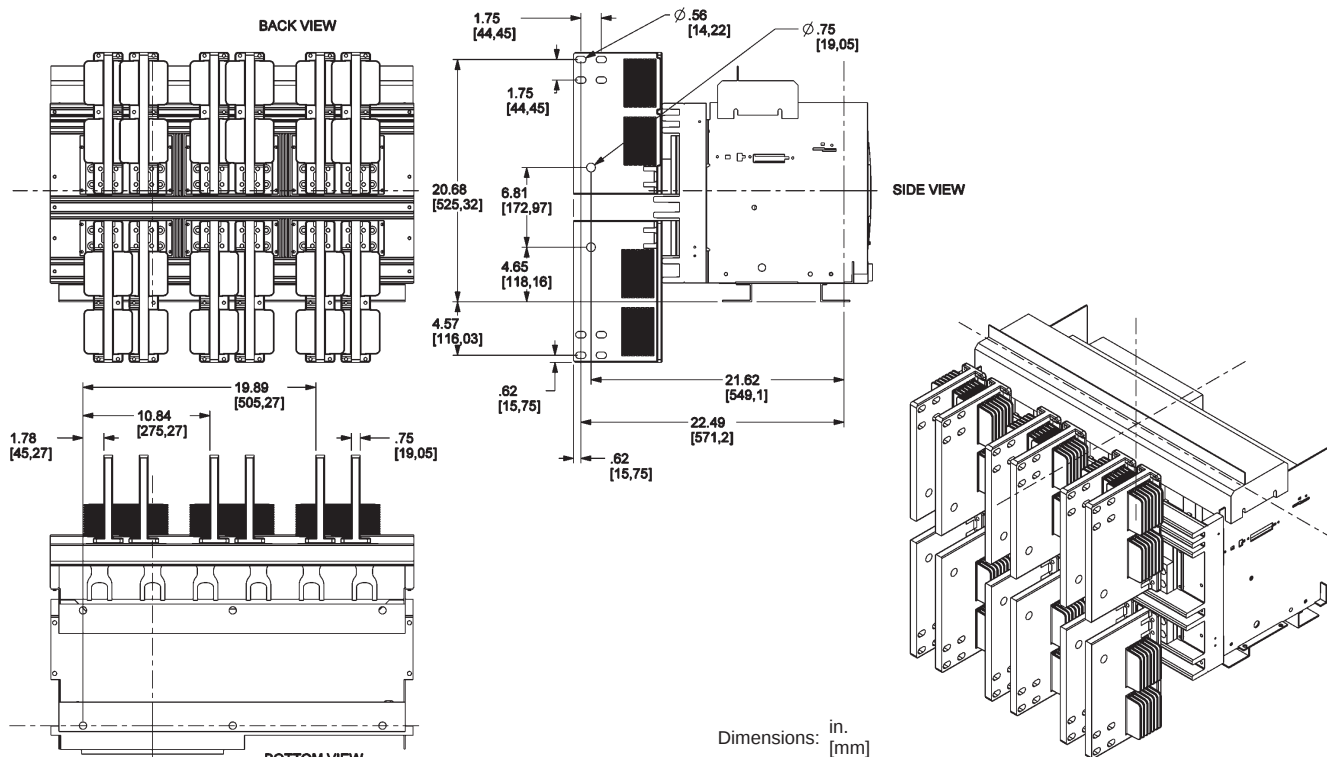


Figure 82: Drawout Cradle Mounting

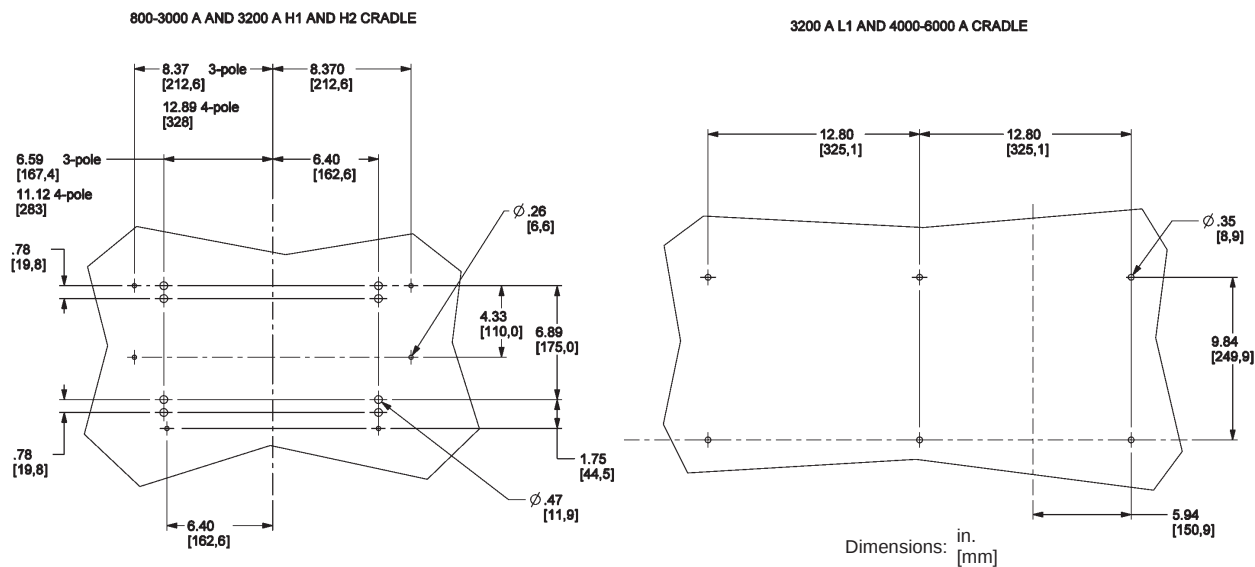

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 83: 800–3000 A and 3200 A (H1, H2, H3) Door Cutout


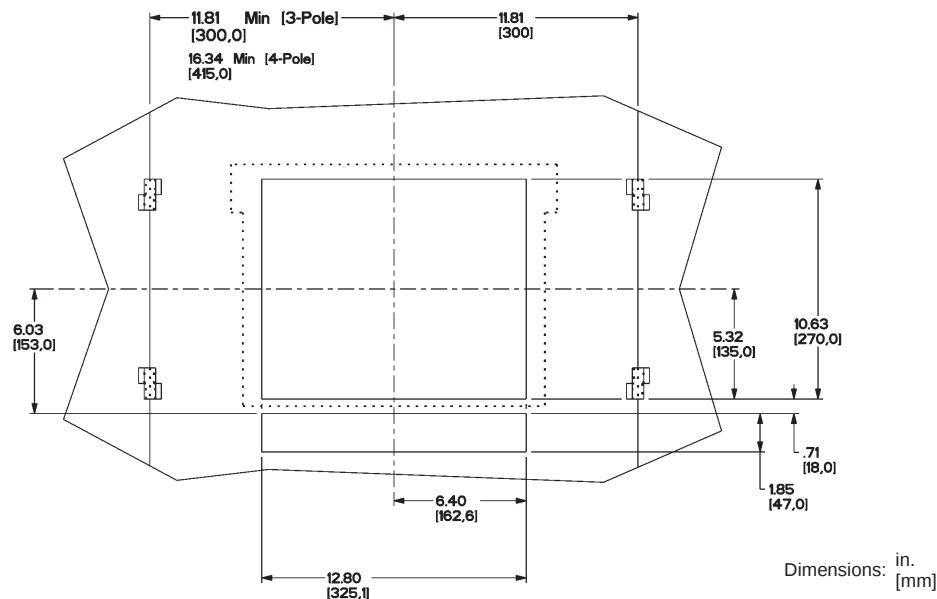



Figure 84: 3200 A L1 and 4000–6000 A Door Cutout

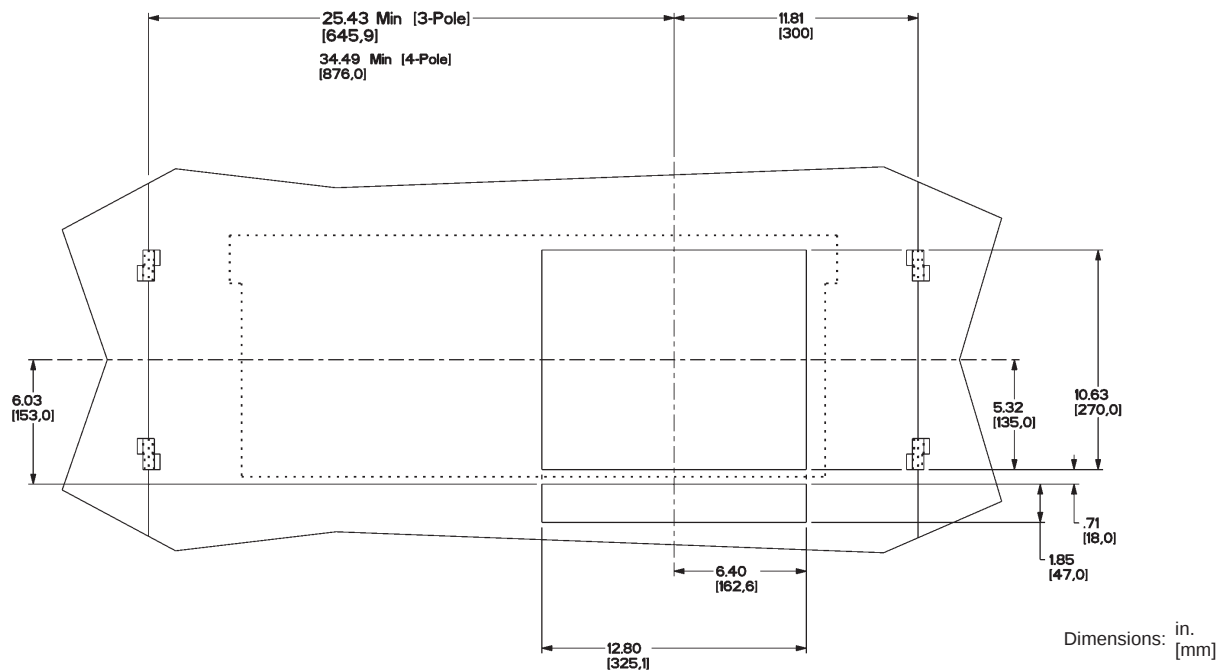

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 85: Door Escutcheon Hole Pattern

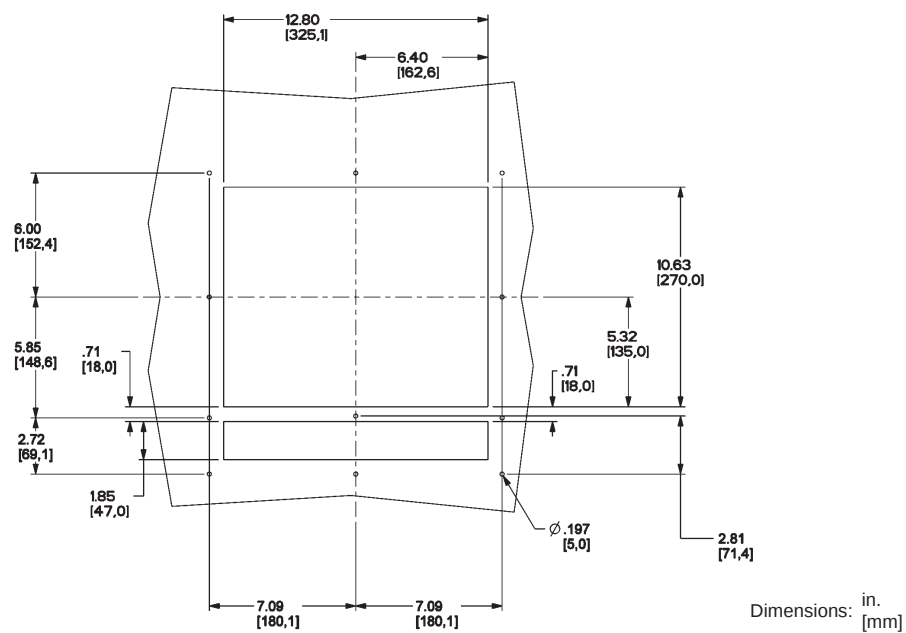


Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

UL/ANSI 3P Fixed Circuit Breakers

Figure 86: 800–3000 A, 3200 A and 4000 A (W-Frame) Master Drawing

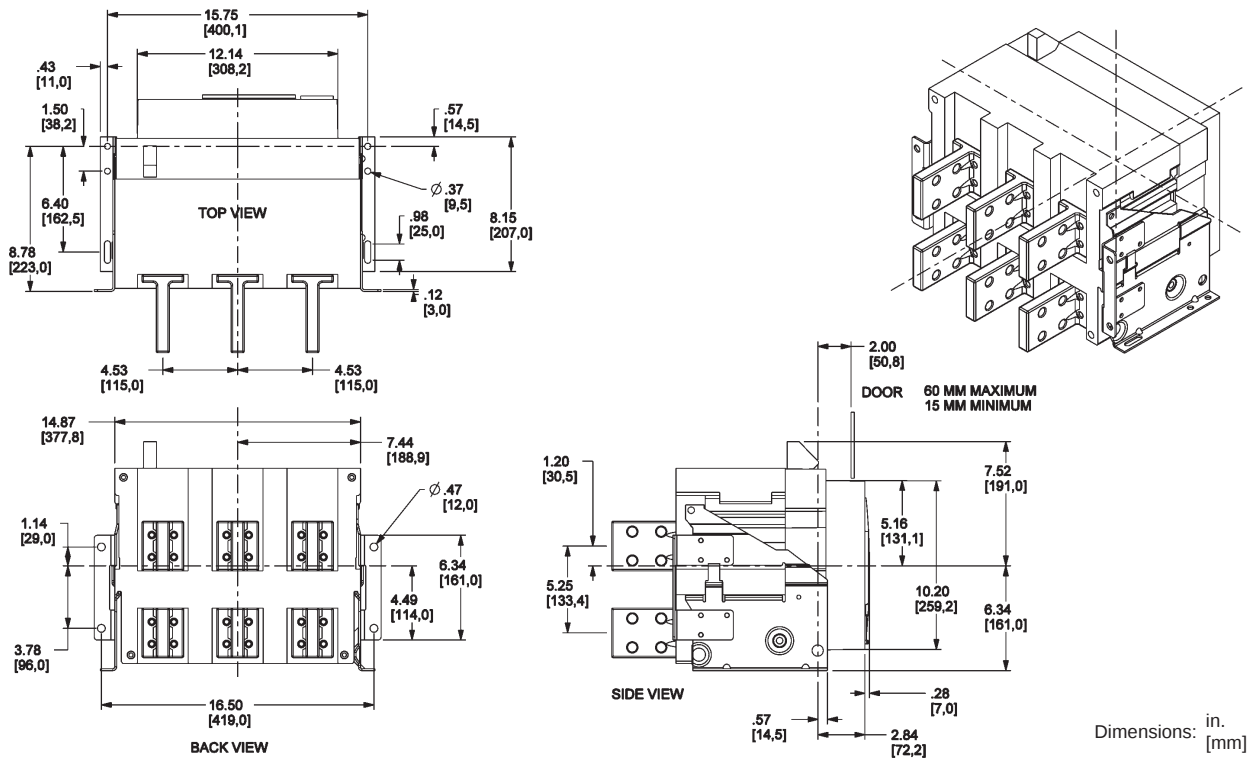

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 87: 800–2000 A Rear-Connected "T" Vertical (RCTV)


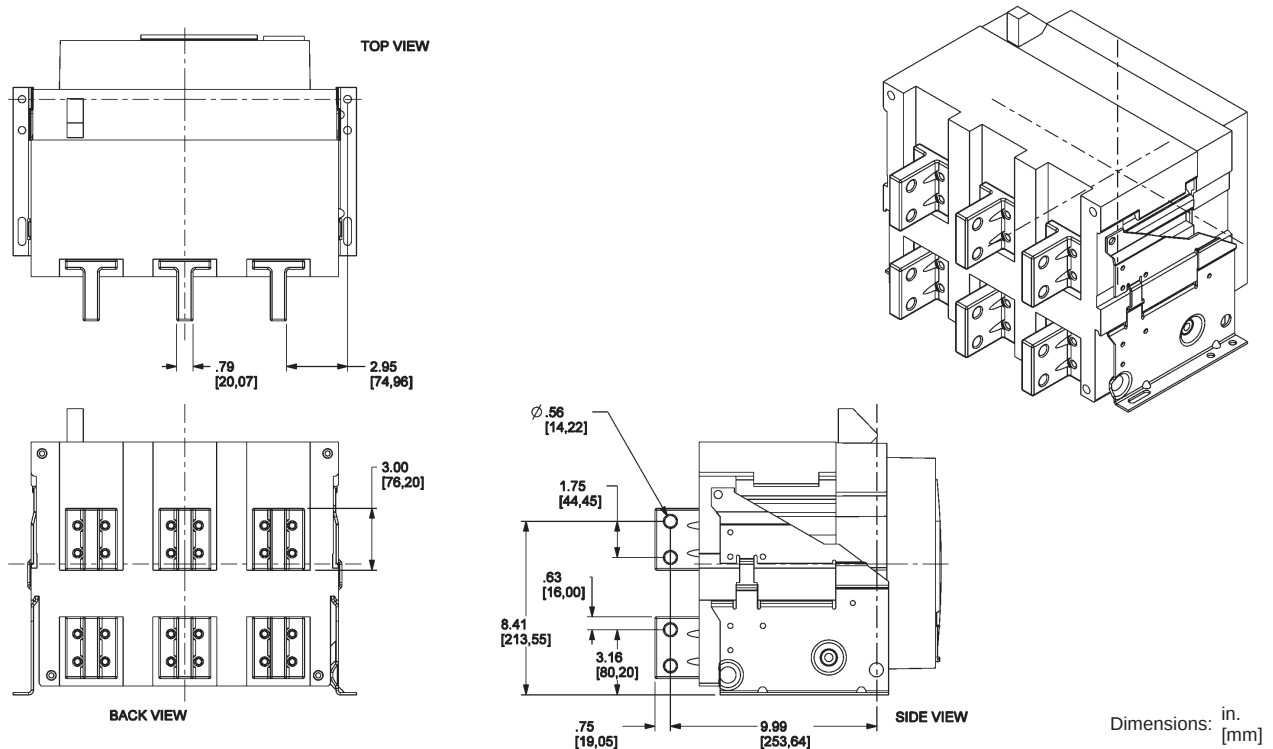


Figure 88: 800–2000 A Rear-Connected "T" Horizontal (RCTH)

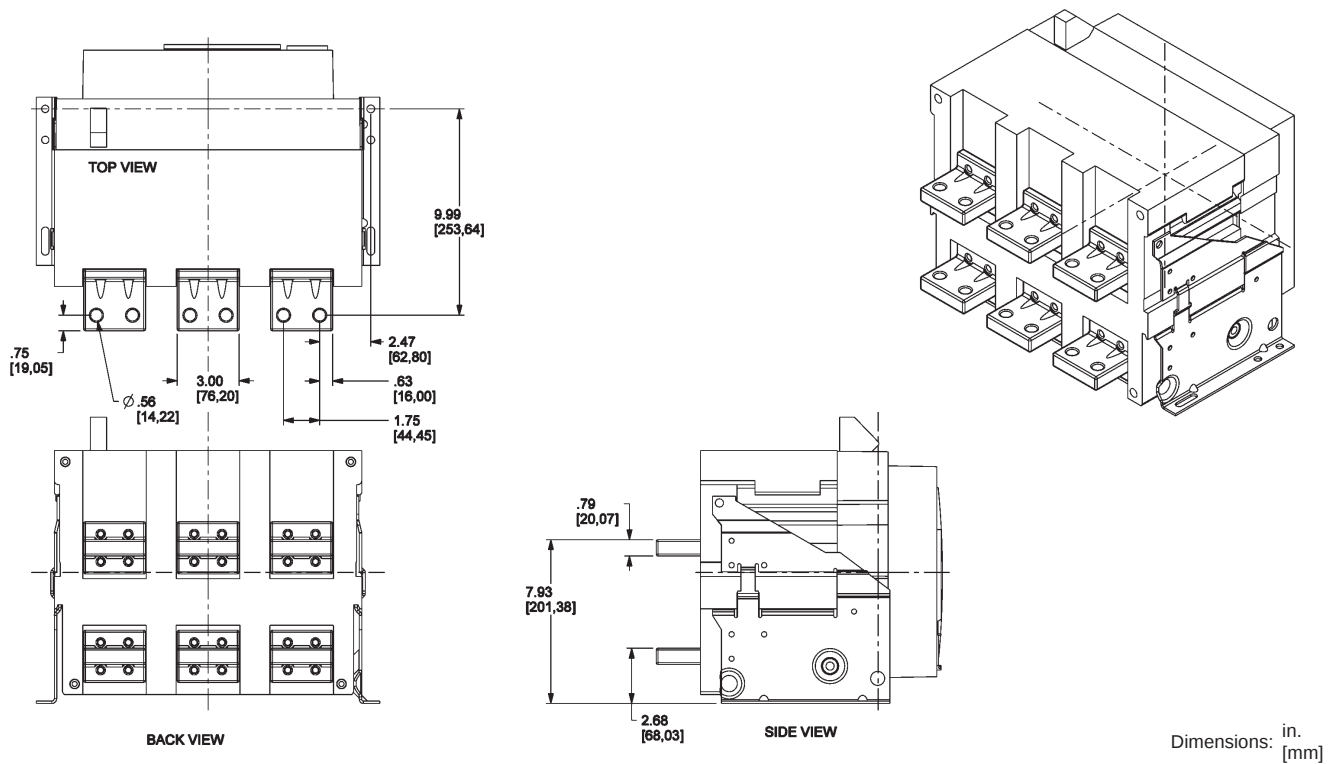

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 89: 800–2000 A Front-Connected Flat (FCF)


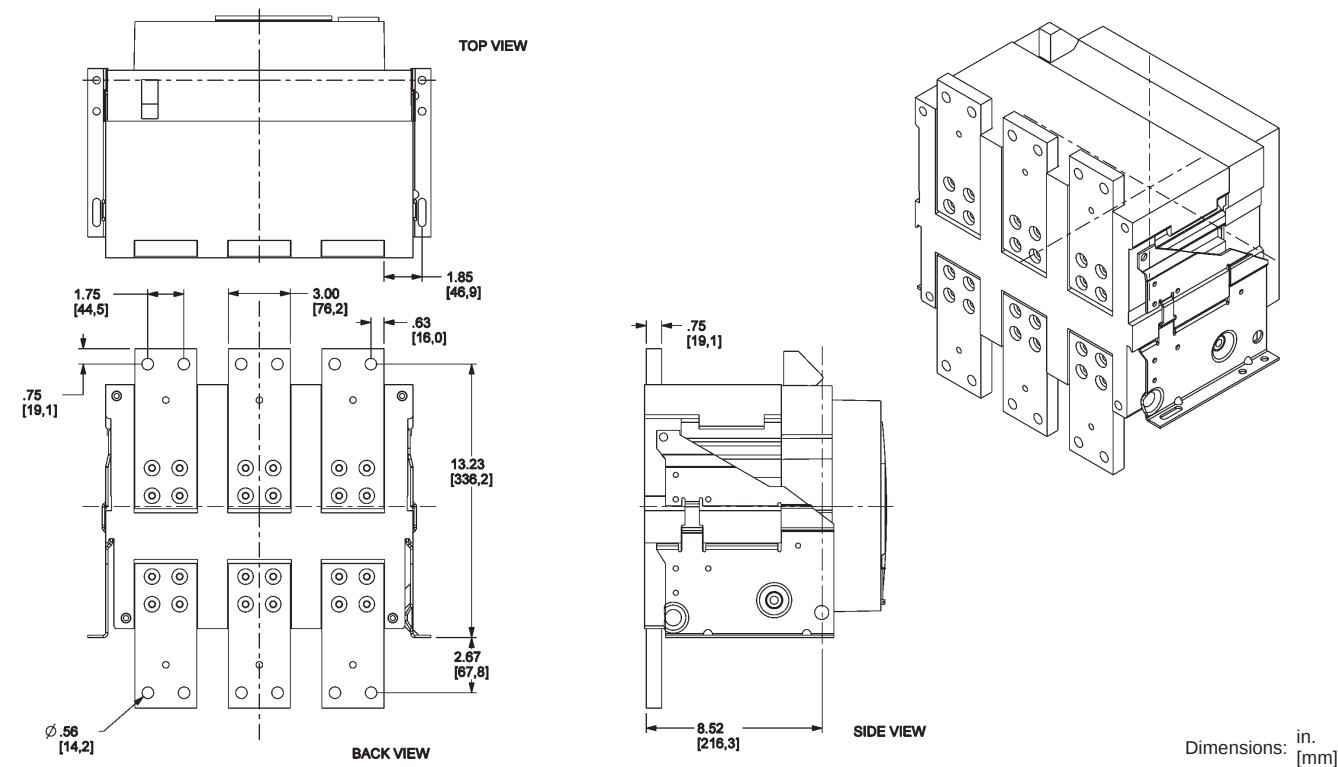


Figure 90: 800–3000 A Front-Connected "T" (FCT)

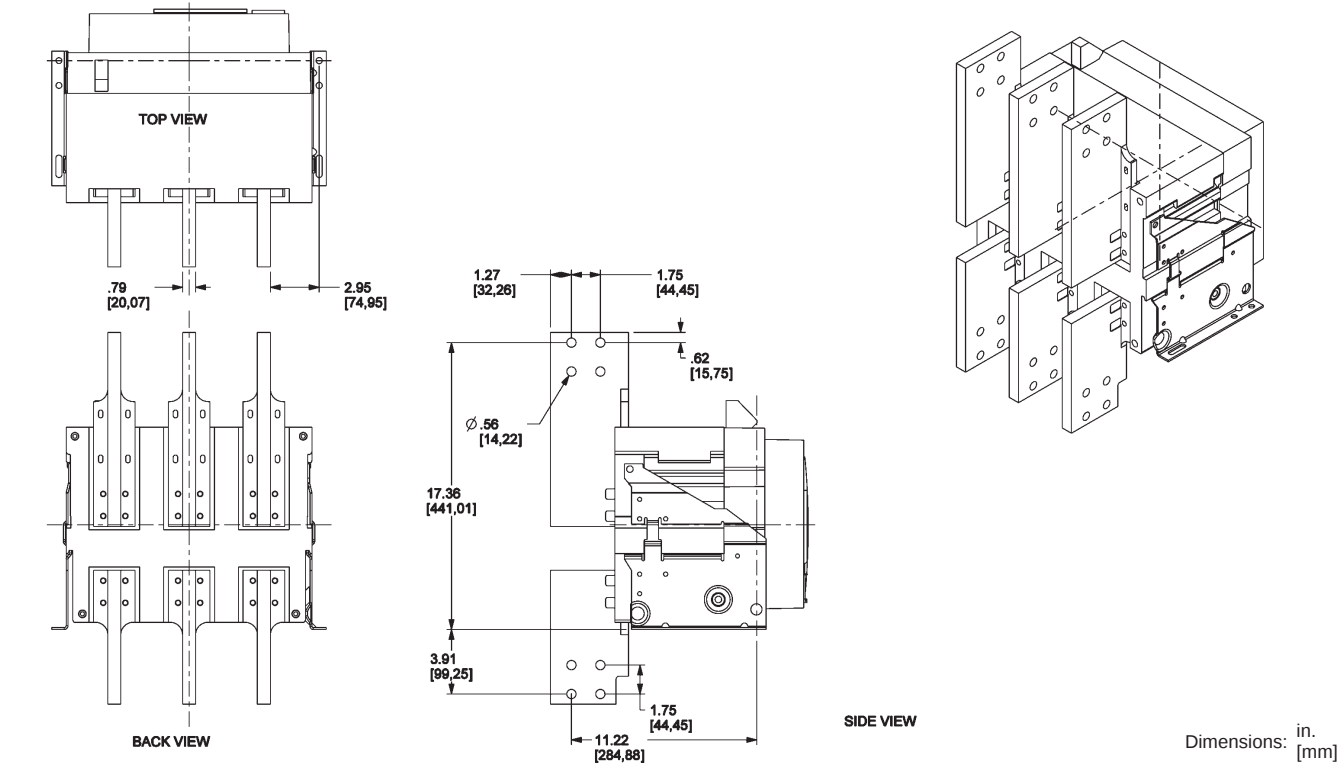

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 91: 2500–3000 A Rear-Connected Vertical "T" Horizontal (RCTV)


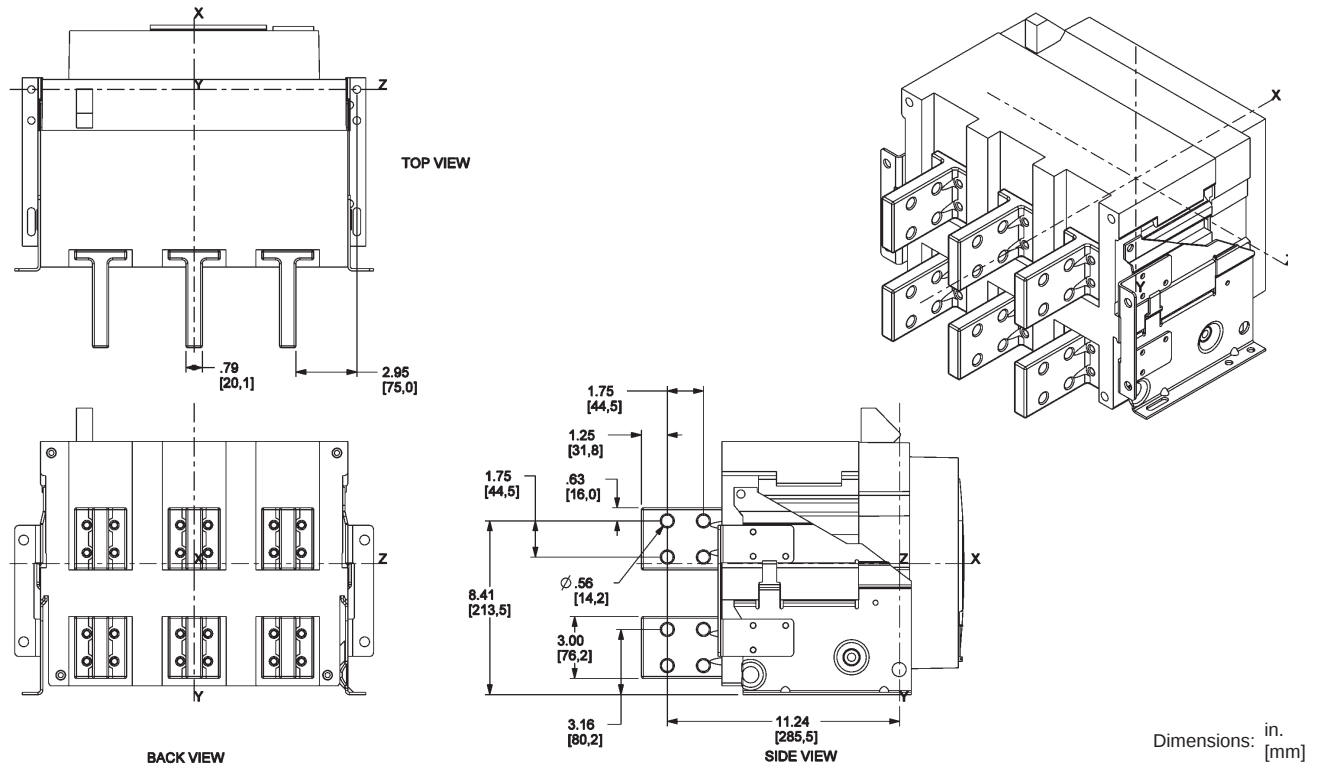


Figure 92: 2500–3000 A Rear-Connected "T" Horizontal (RCTH)

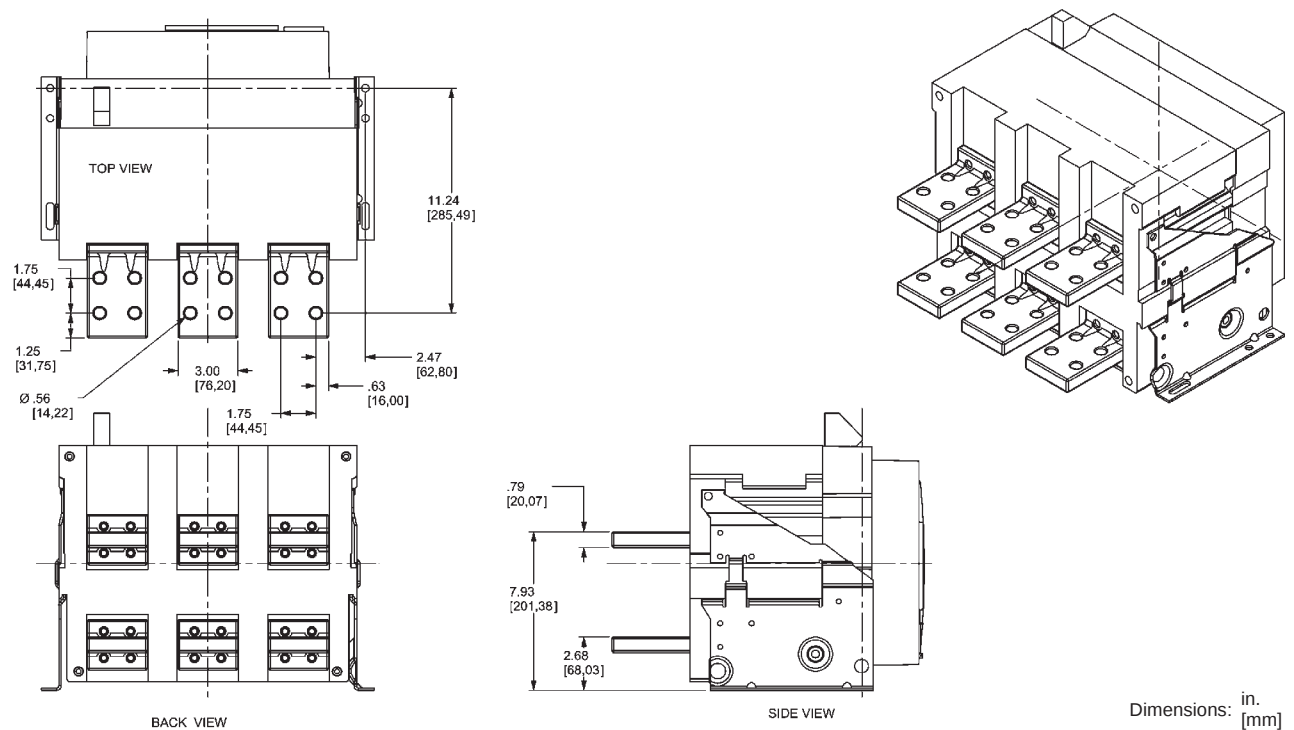

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 93: 2000 A L1 and 3200 A Rear-Connected Offset Vertical (RCOV)


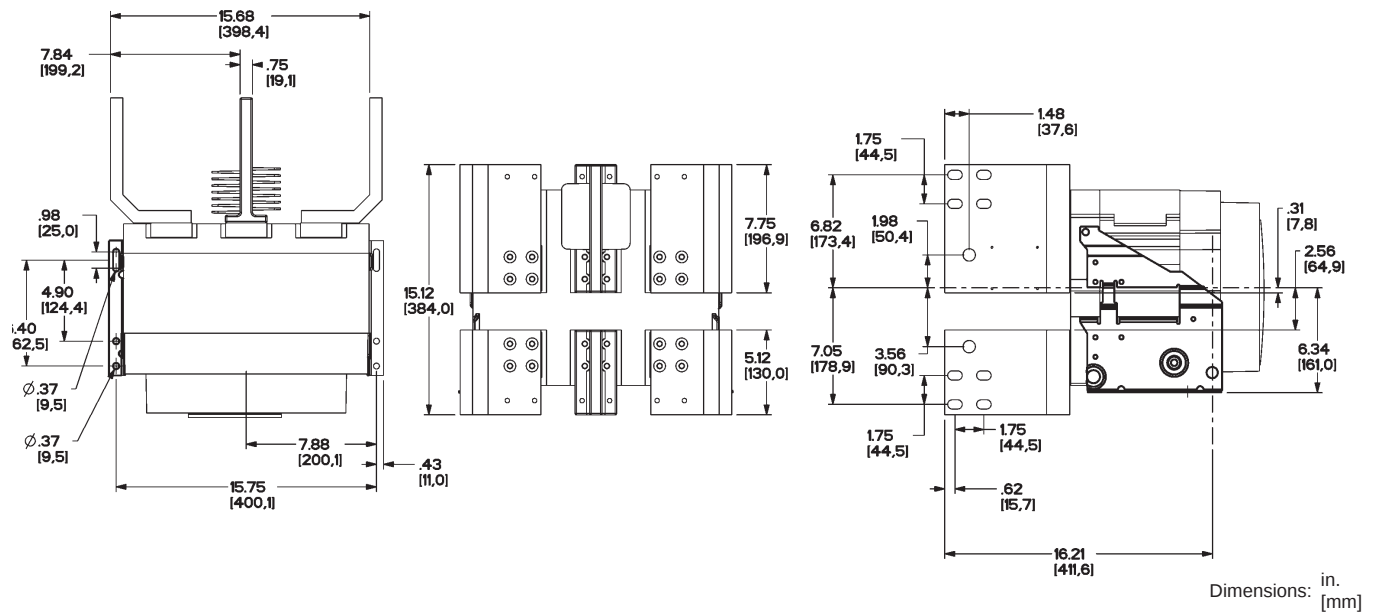


Figure 94: 4000 A (W-Frame) Rear-Connected Offset Vertical (RCOV)

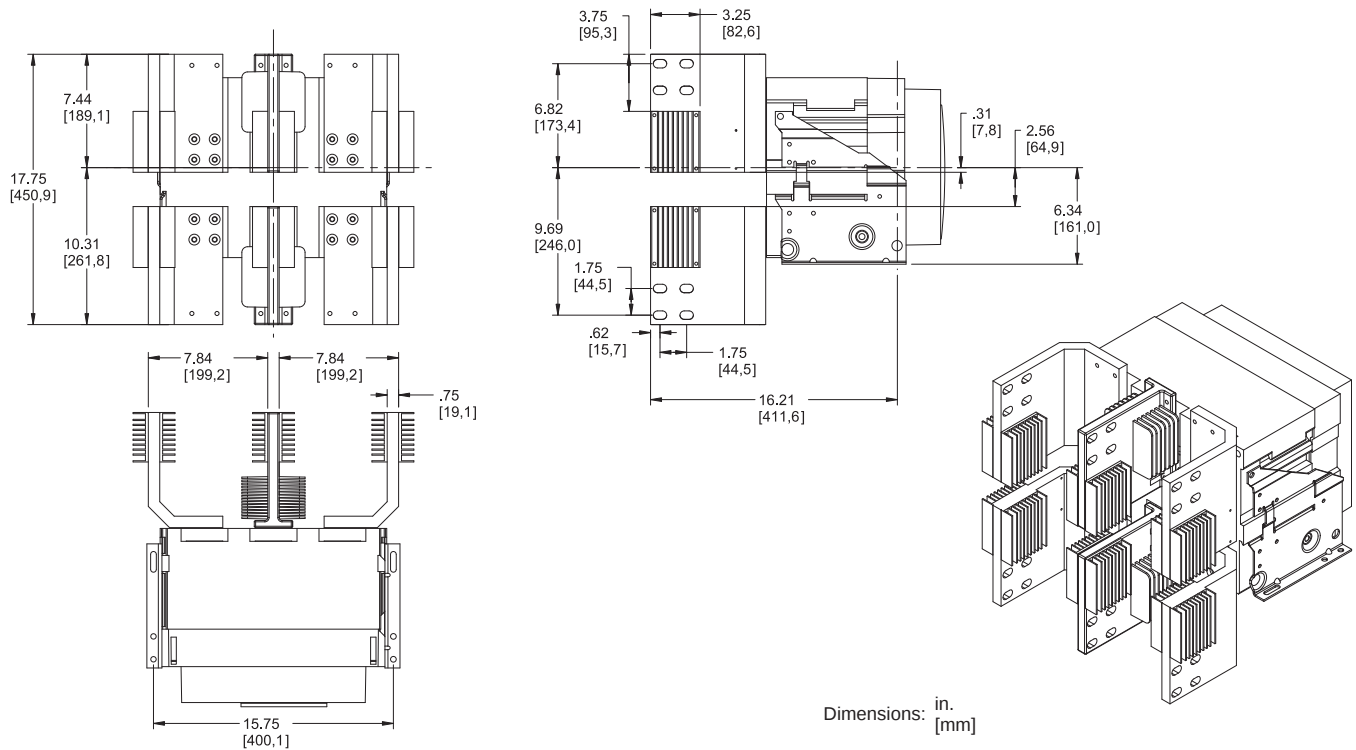

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 95: 4000–6000 A Master Drawing


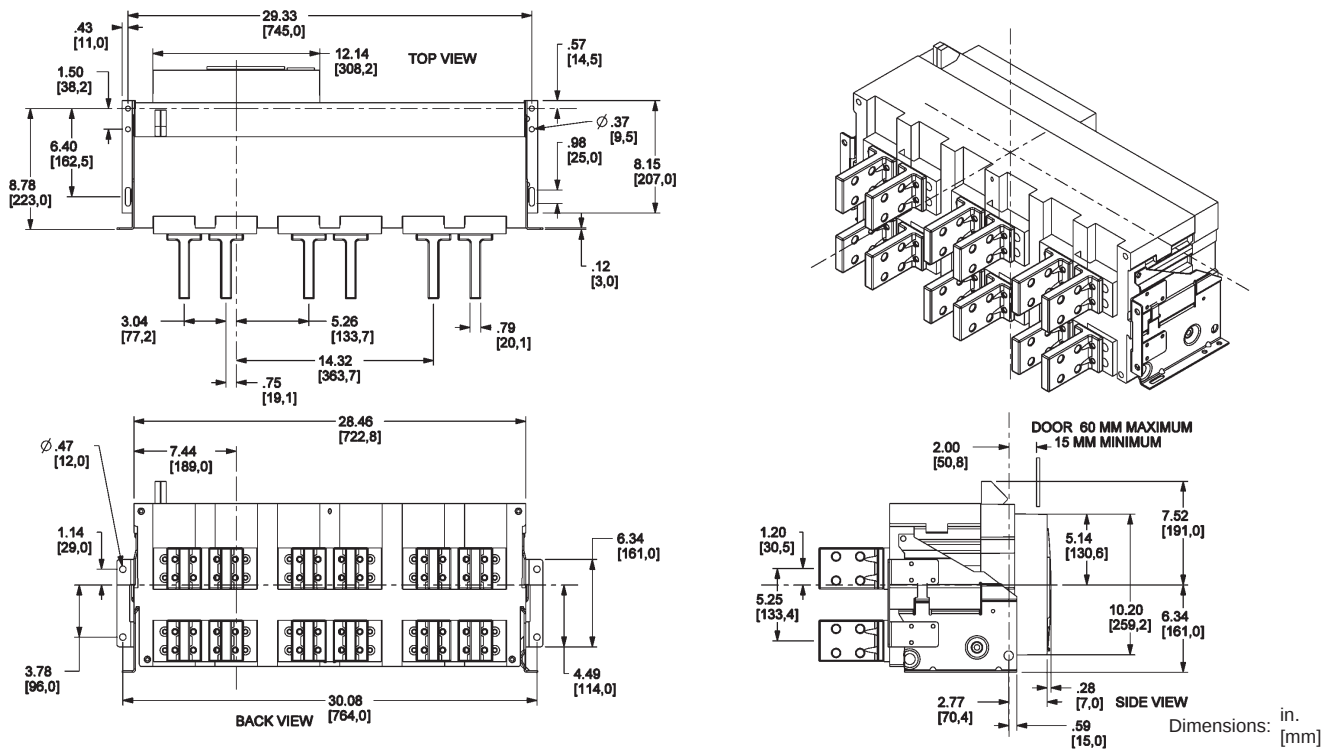


Figure 96: 4000–5000 A Rear-Connected "T" Vertical (RCTV)

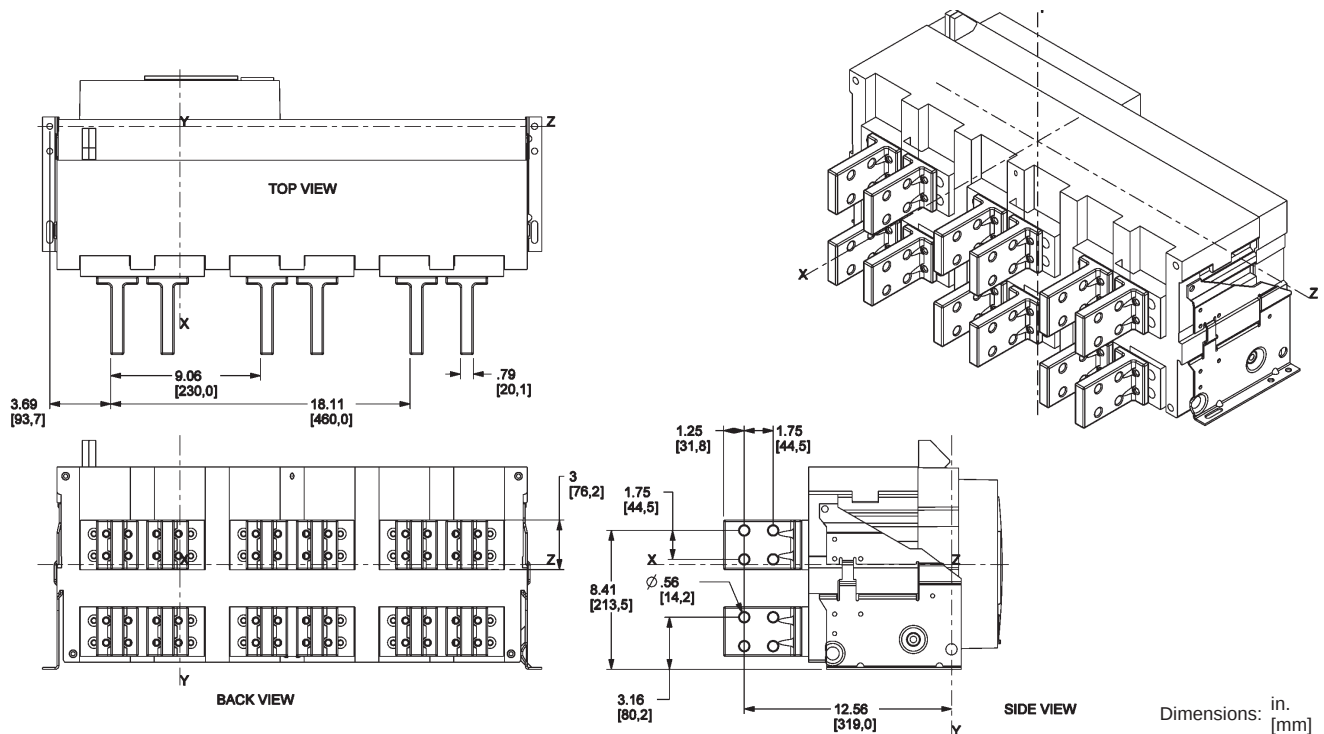

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 97: 4000–5000 A Rear-Connected "T" Horizontal (RCTH)


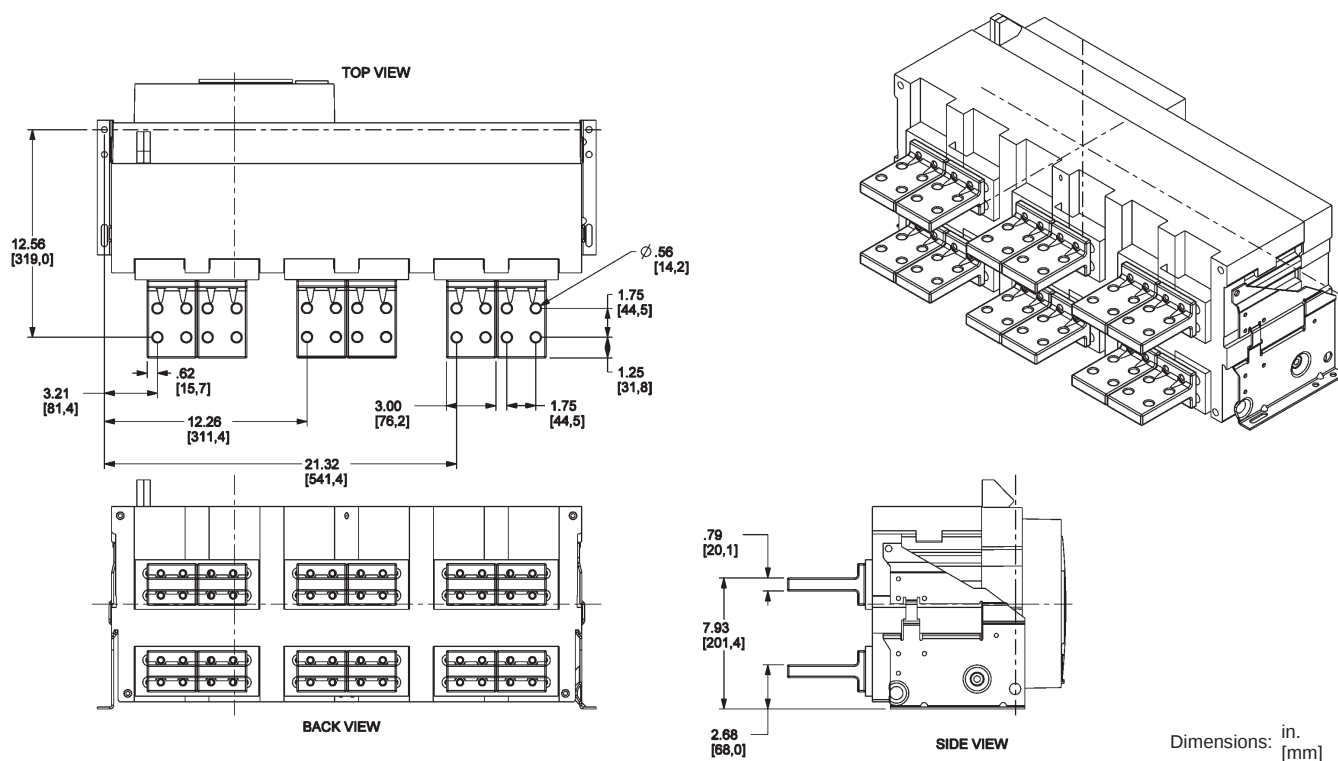


Figure 98: 6000 A Rear-Connected "T" Vertical (RCTV)

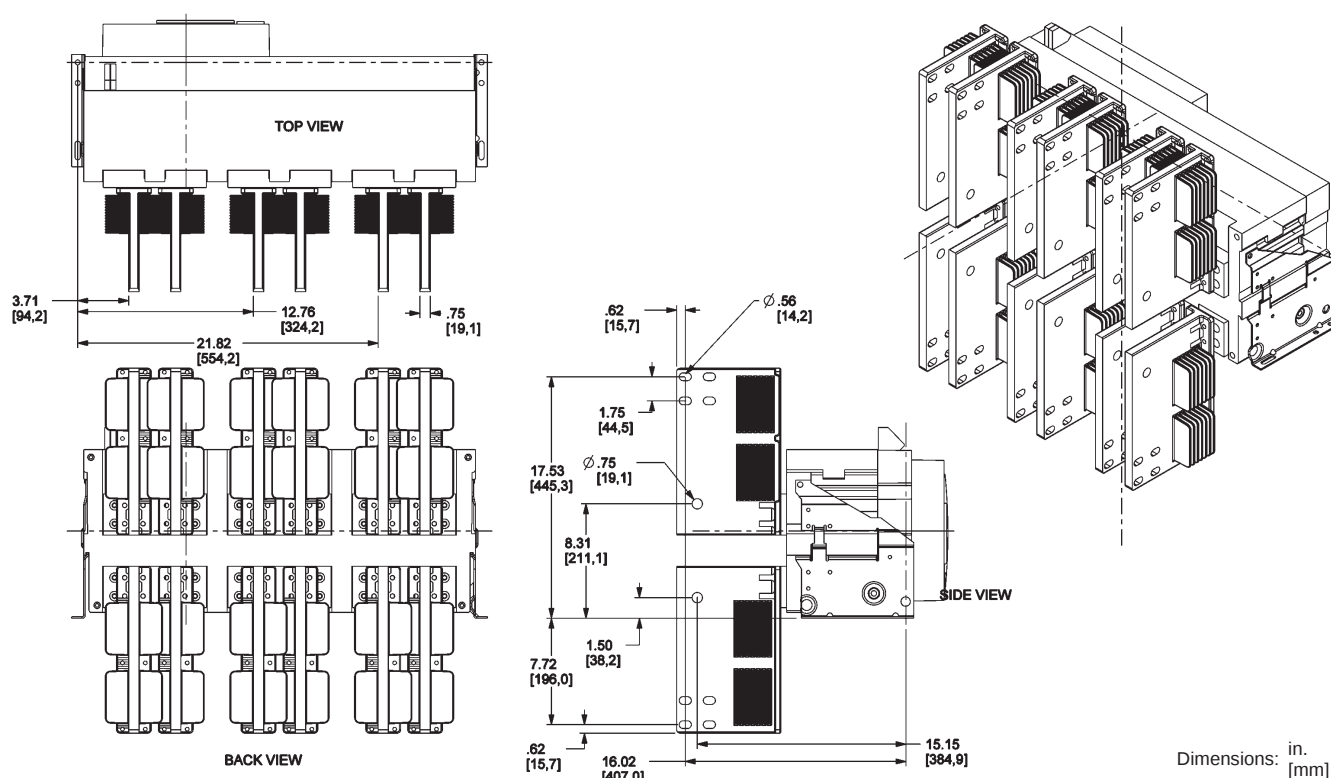

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 99: 800–3200 A and 4000 A (W-Frame) Circuit Breaker Door Cutout


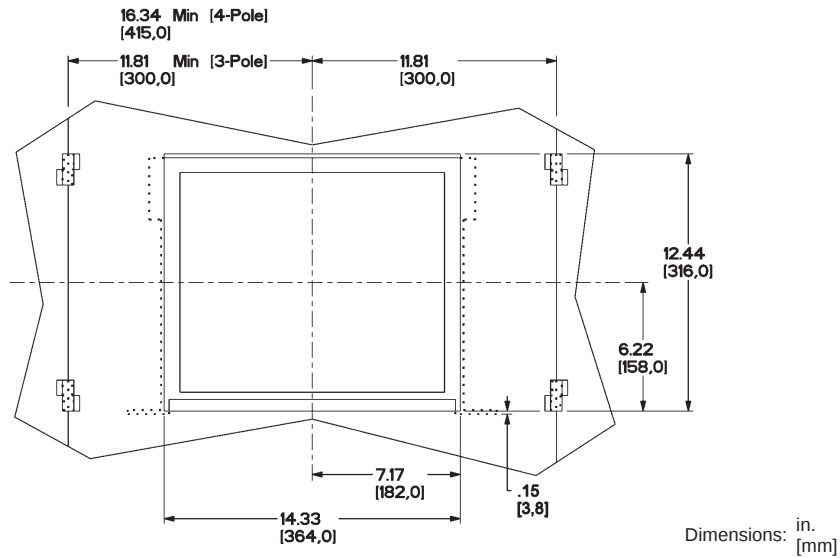



Figure 100: 4000–6000 A Door Cutout

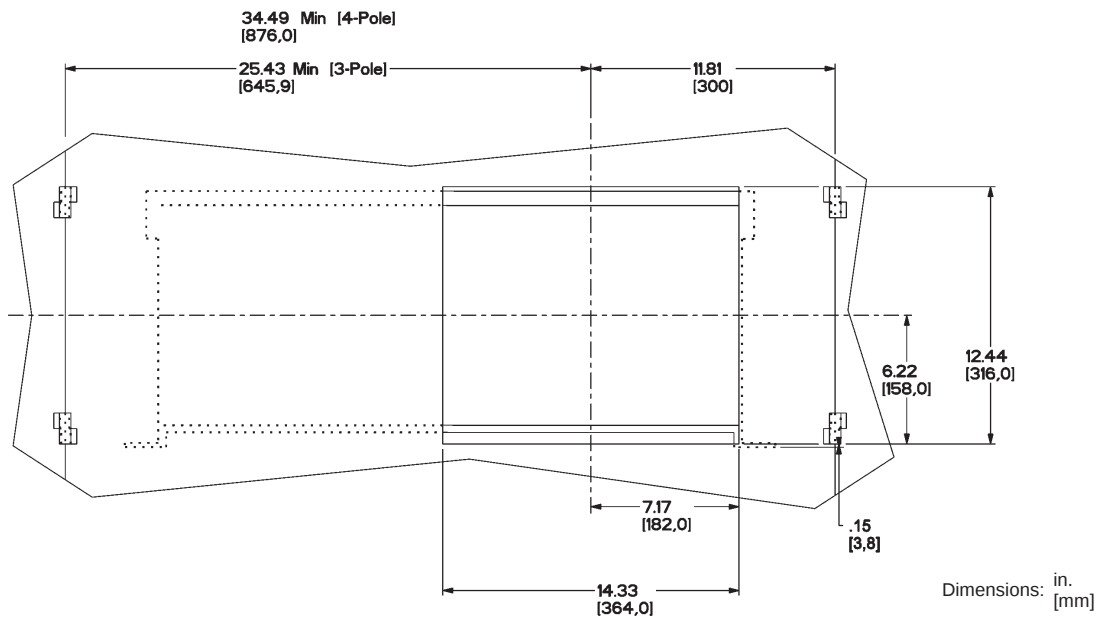

Masterpact™ NT and NW Universal Power Circuit Breakers
Masterpact NW Dimensional Drawings

UL/ANSI 4P Drawout Circuit Breakers

Figure 101: 800–3000 A and 3200 A Master Drawing

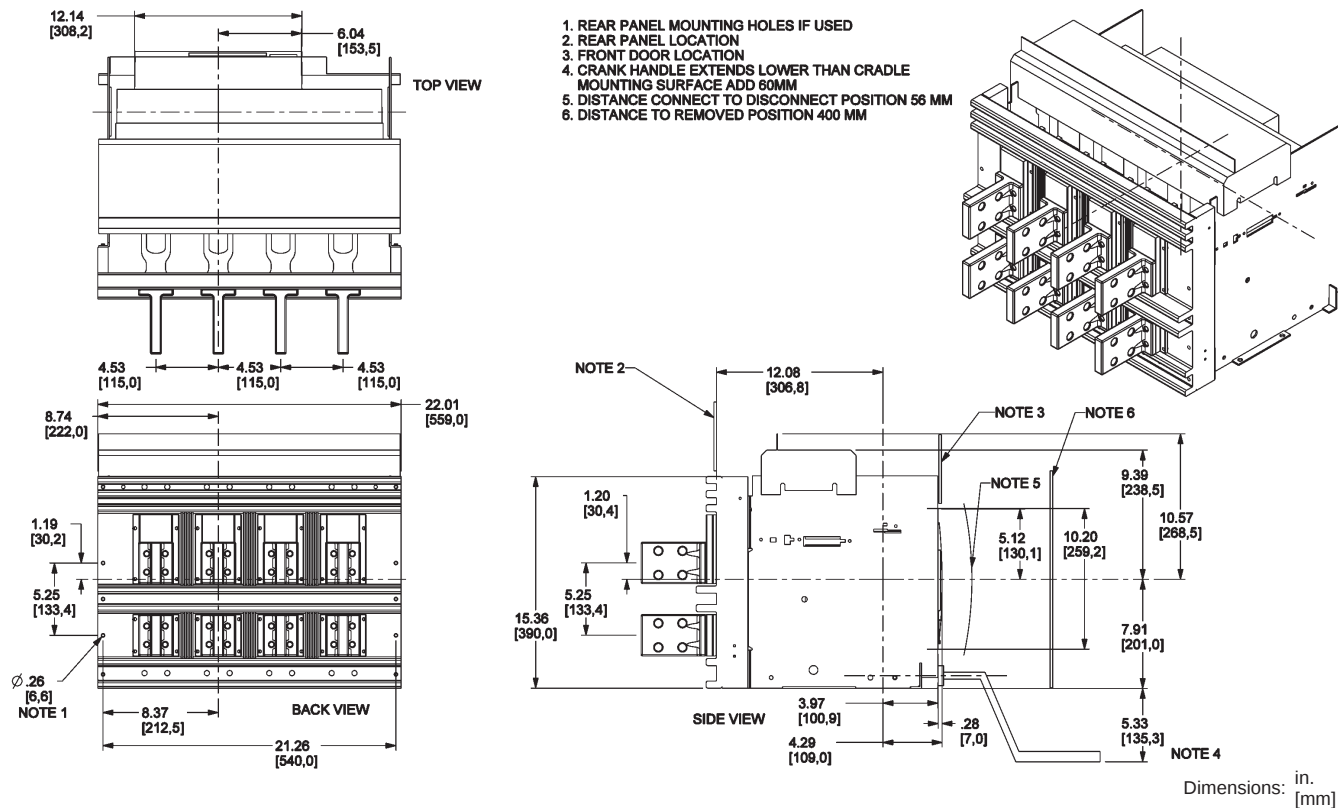

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 102: 800–2000 A Rear-Connected "T" Vertical (RCTV)


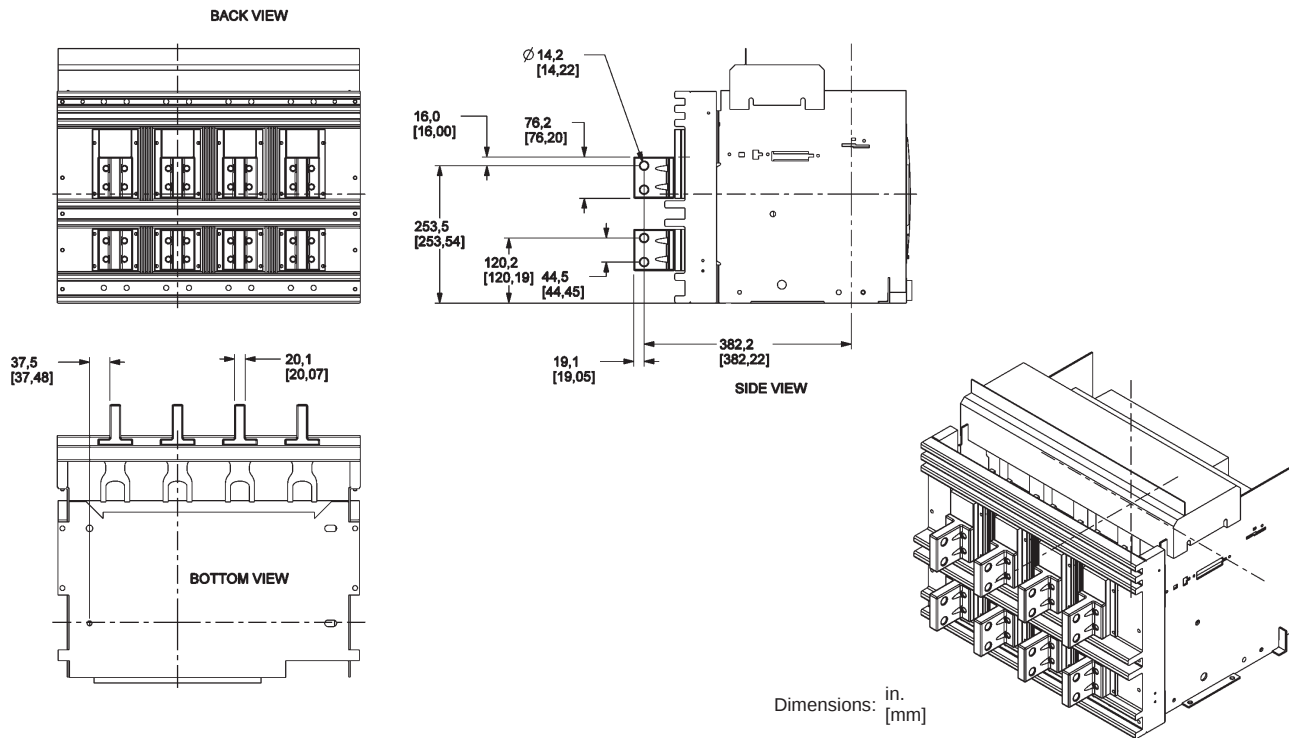


Figure 103: 800–2000 A Rear-Connected "T" Horizontal (RCTH)

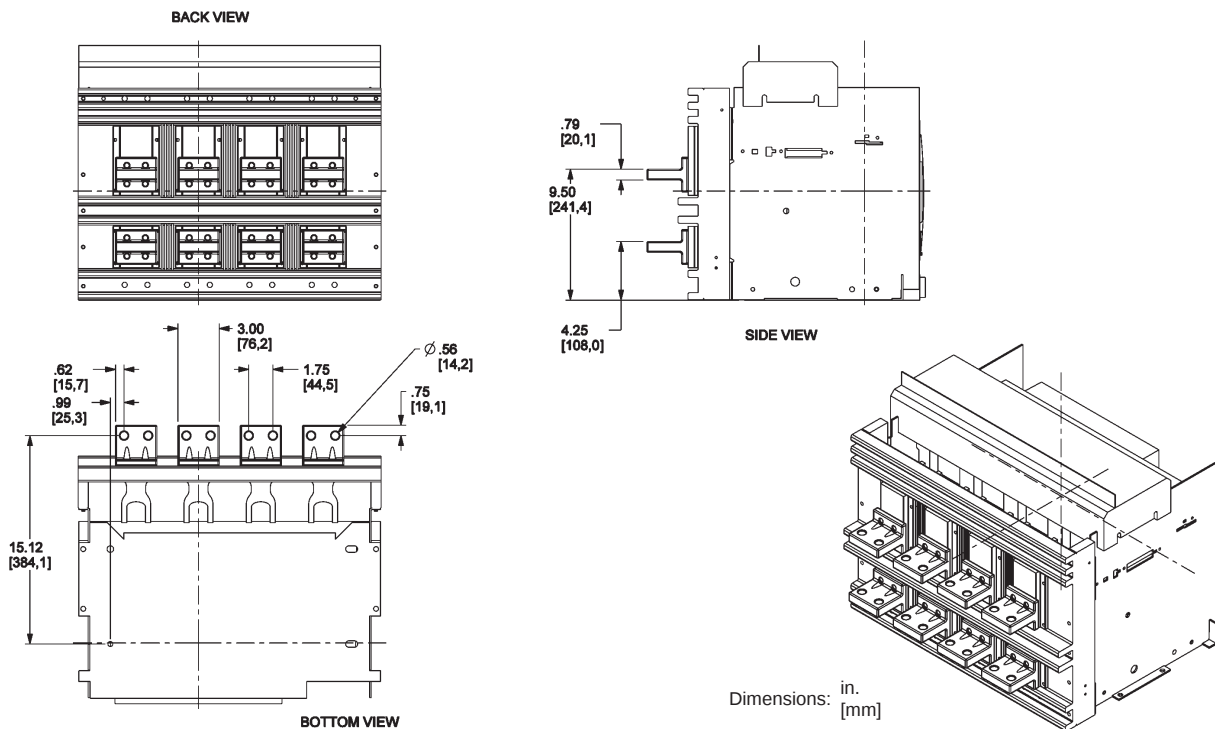

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 104: 800–2000 A Front-Connected Flat (FCF)


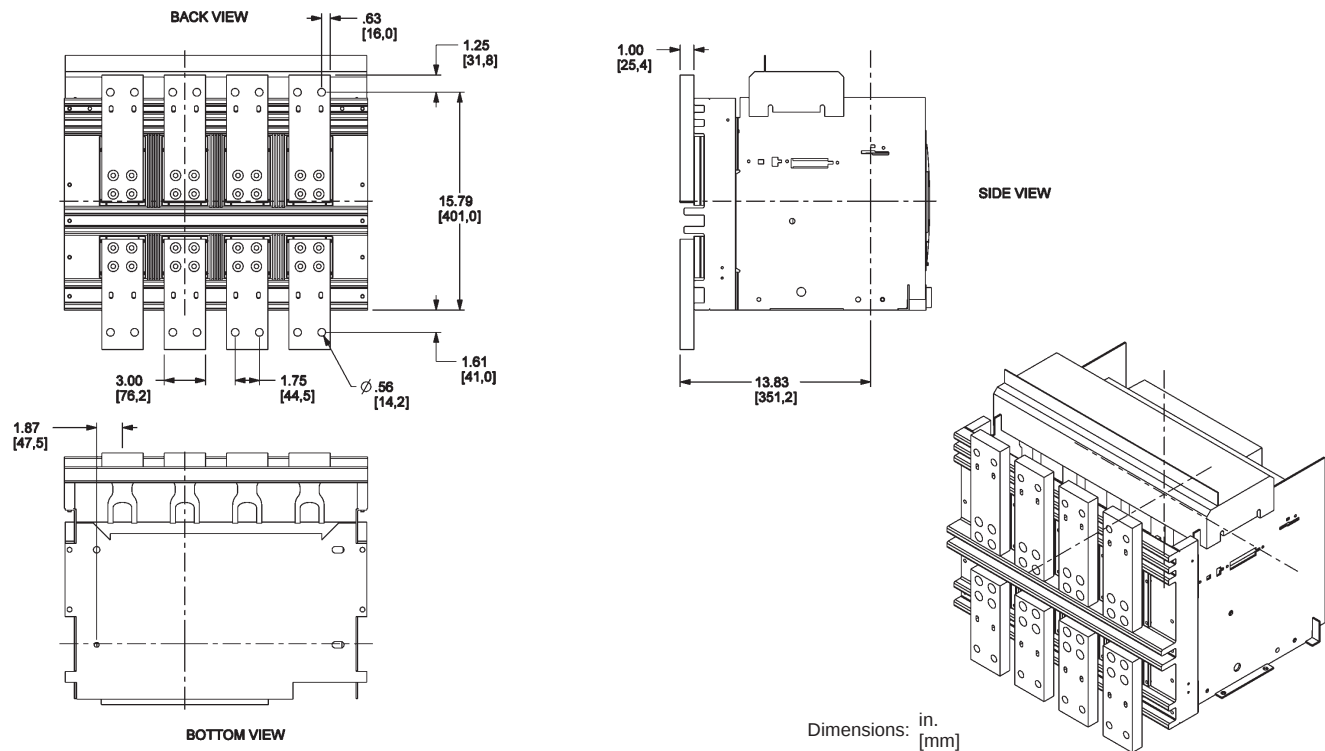


Figure 105: 800–3000 A Front-Connected "T" (FCT)

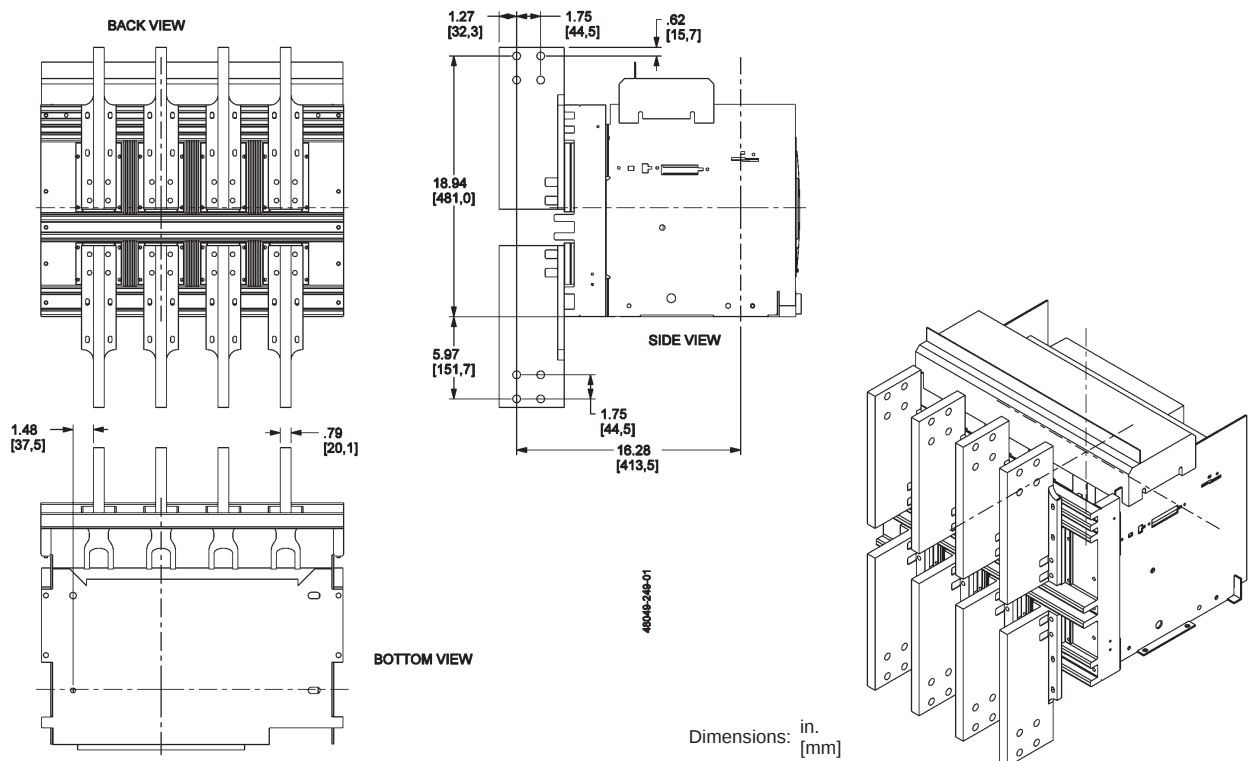

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 106: 2500–3000 A Rear-Connected "T" Vertical (RCTV)



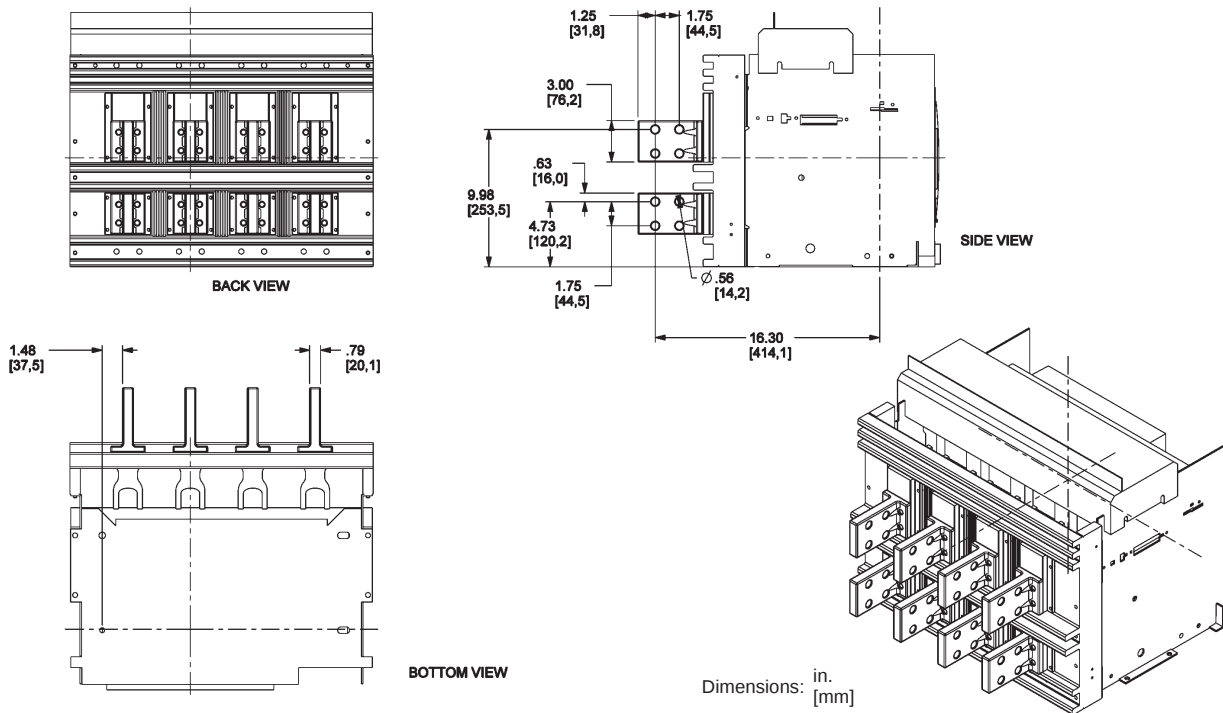


Figure 107: 2500–3000 A Rear-Connected "T" Horizontal (RCTH)

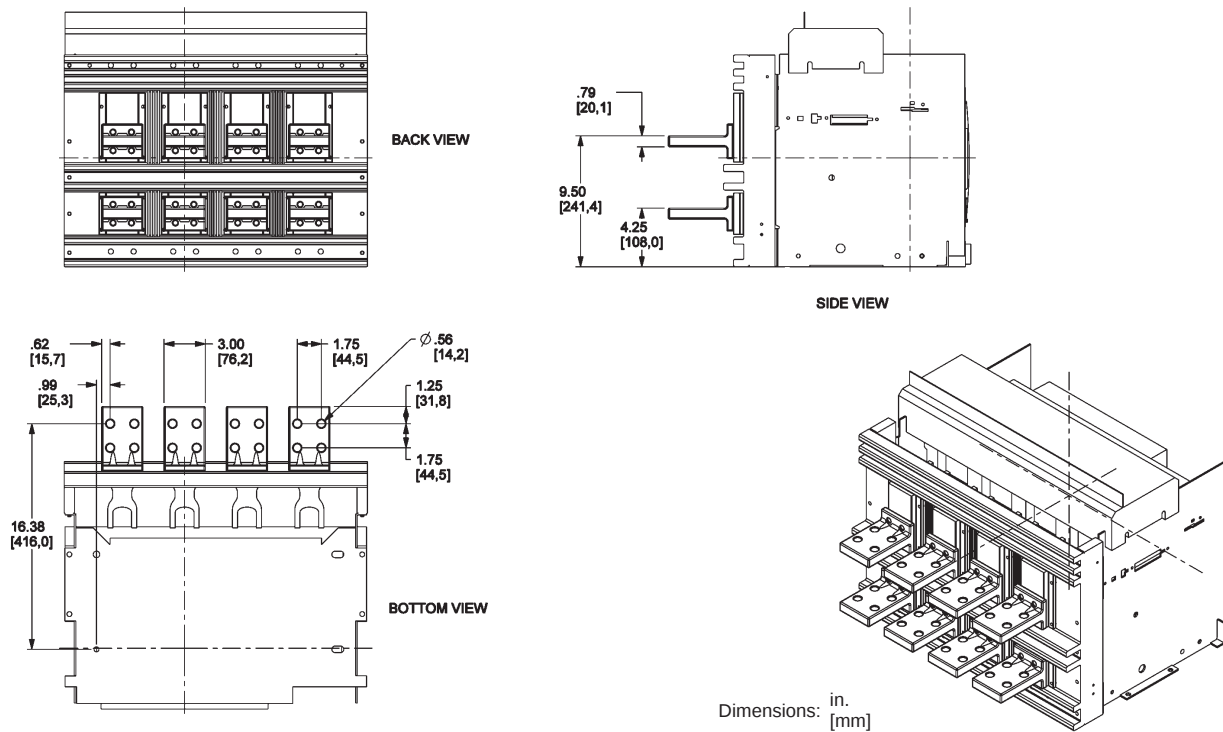

Masterpact™ NT and NW Universal Power Circuit Breakers
Masterpact NW Dimensional Drawings

Figure 108: 2000 A L1 and 3200 A Rear-Connected Offset Vertical (RCOV)

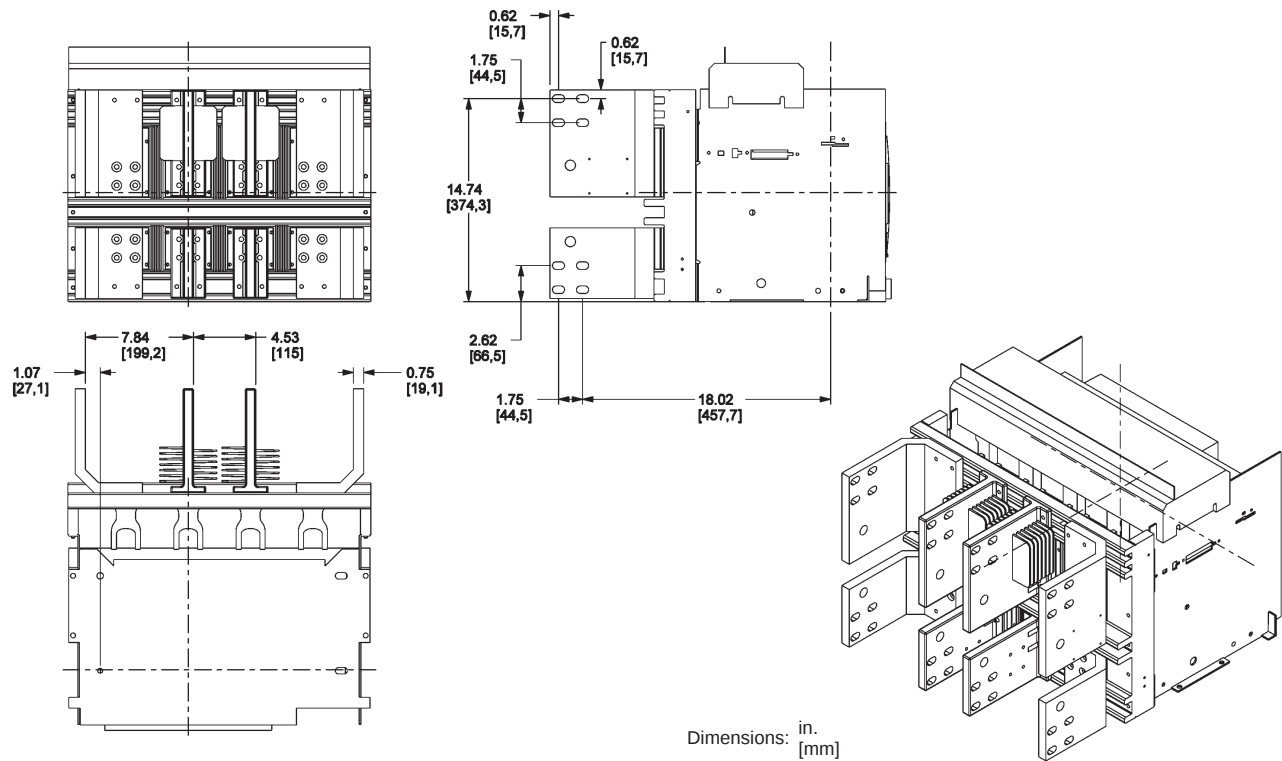

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 109: 3200 A L1 and 4000–6000 A Master Drawing


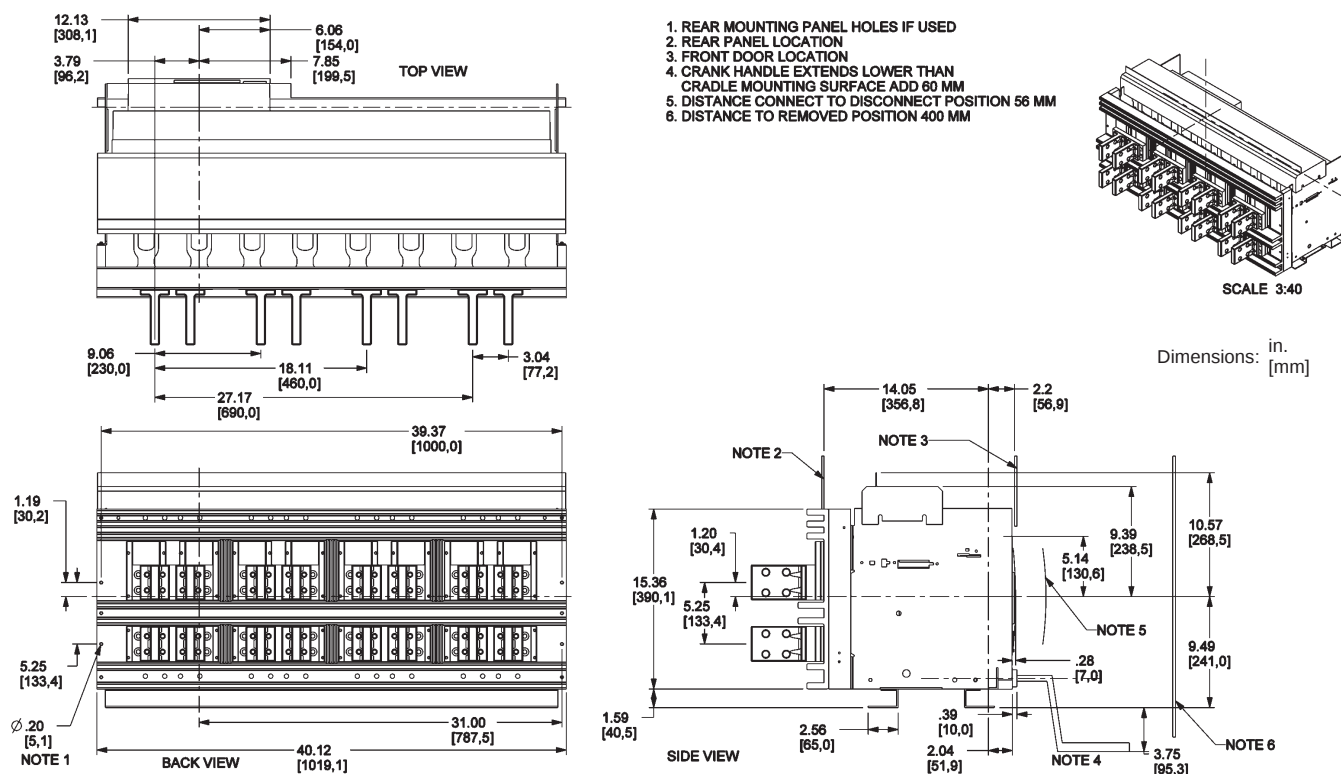


Figure 110: 3200 A L1 and 4000–5000 A Rear-Connected "T" Vertical (RCTV)

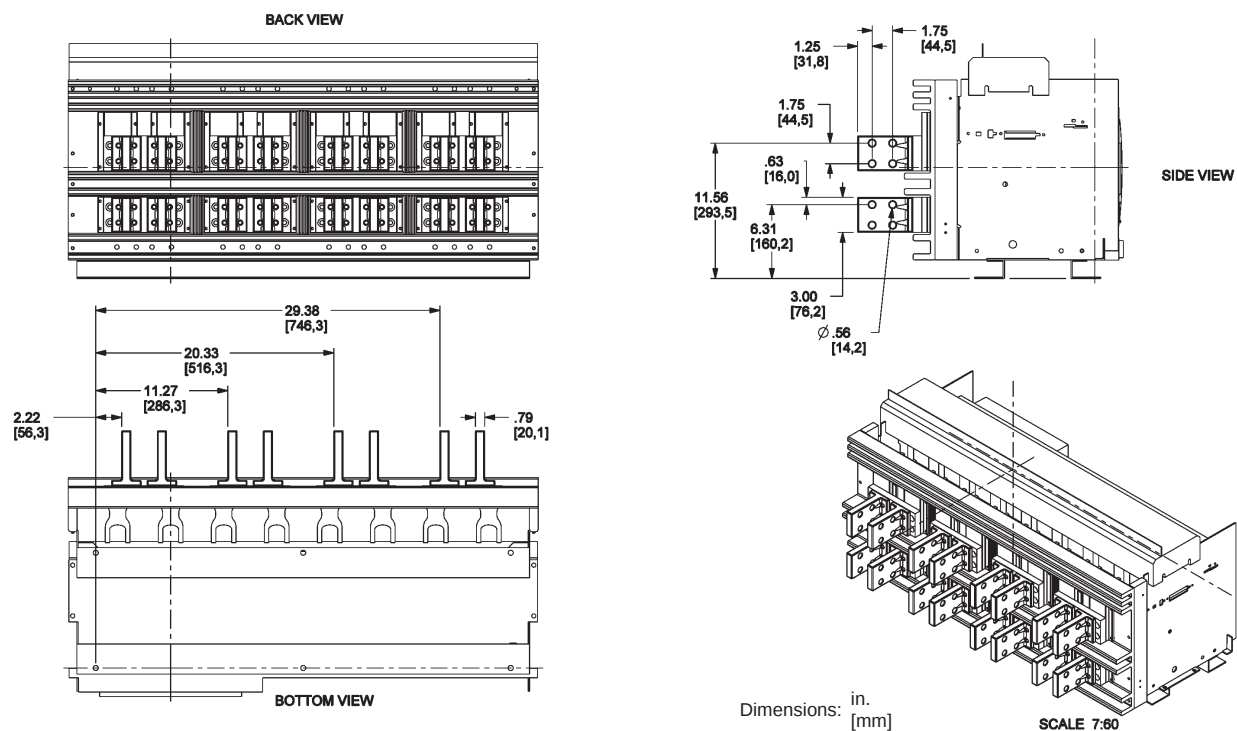

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 111: 3200 A L1 and 4000–5000 A Rear-Connected "T" Horizontal (RCTH)


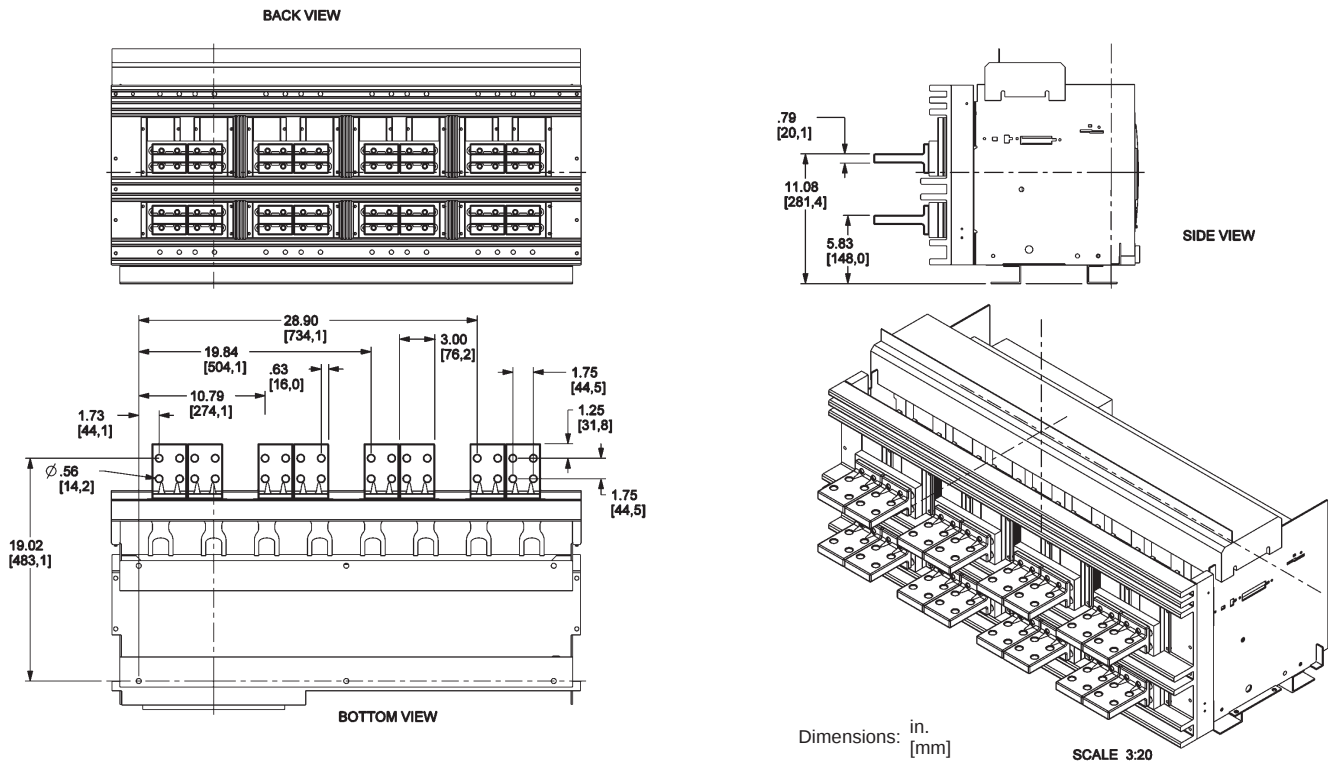


Figure 112: 3200 A L1 and 4000 A Front-Connected Flat (FCF)

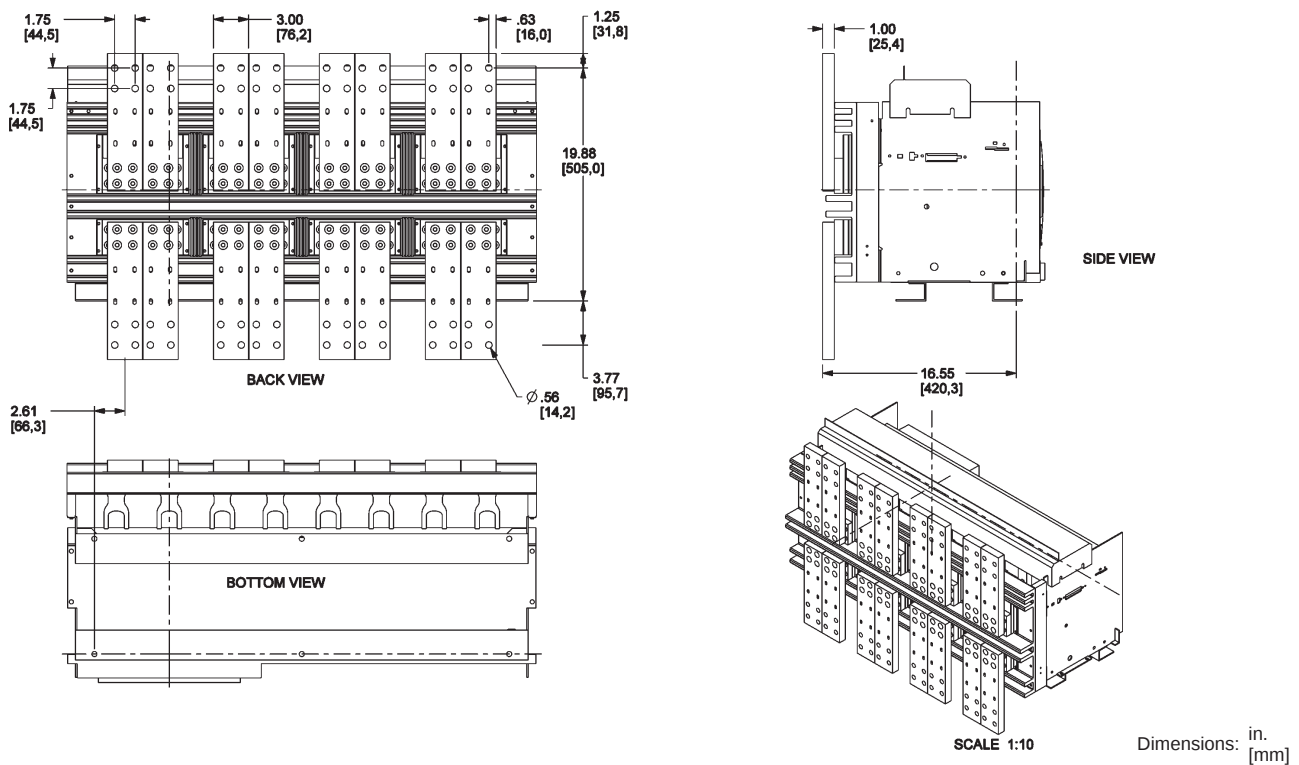

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 113: 3200 A L1 and 4000–5000 A Front-Connected "T" (FCT)


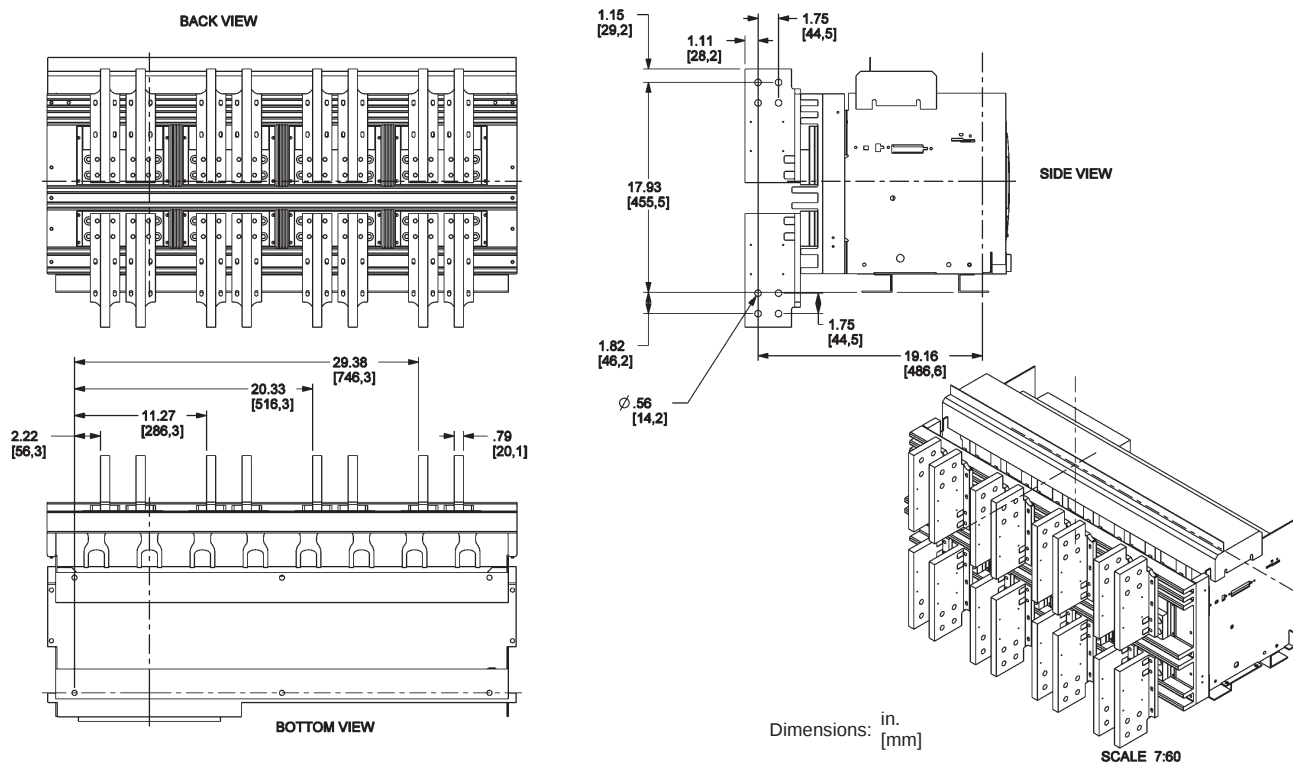


Figure 114: 6000 A Rear-Connected "T" Vertical (RCTV)

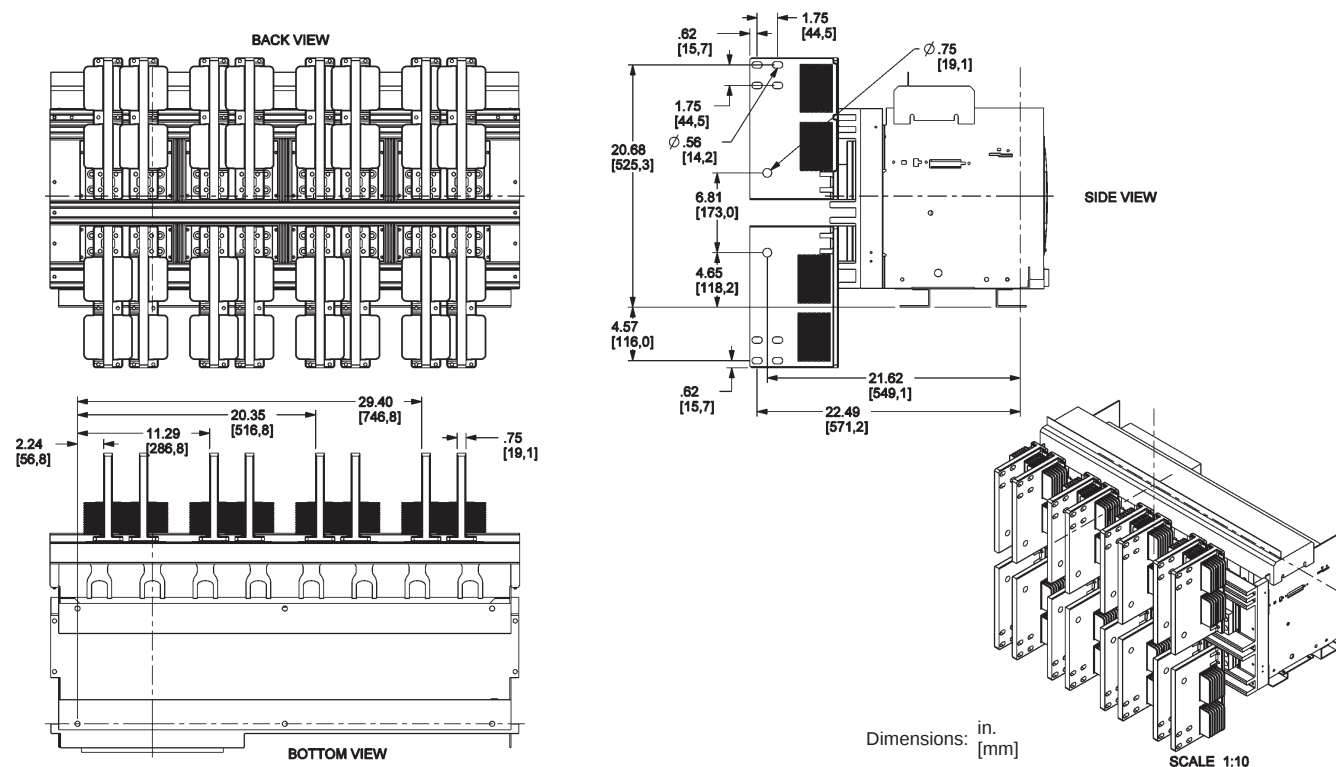

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

UL/ANSI 4P Fixed Circuit Breakers

Figure 115: 800–3000 A, 3200 A and 4000 A (W-Frame) Master Drawing


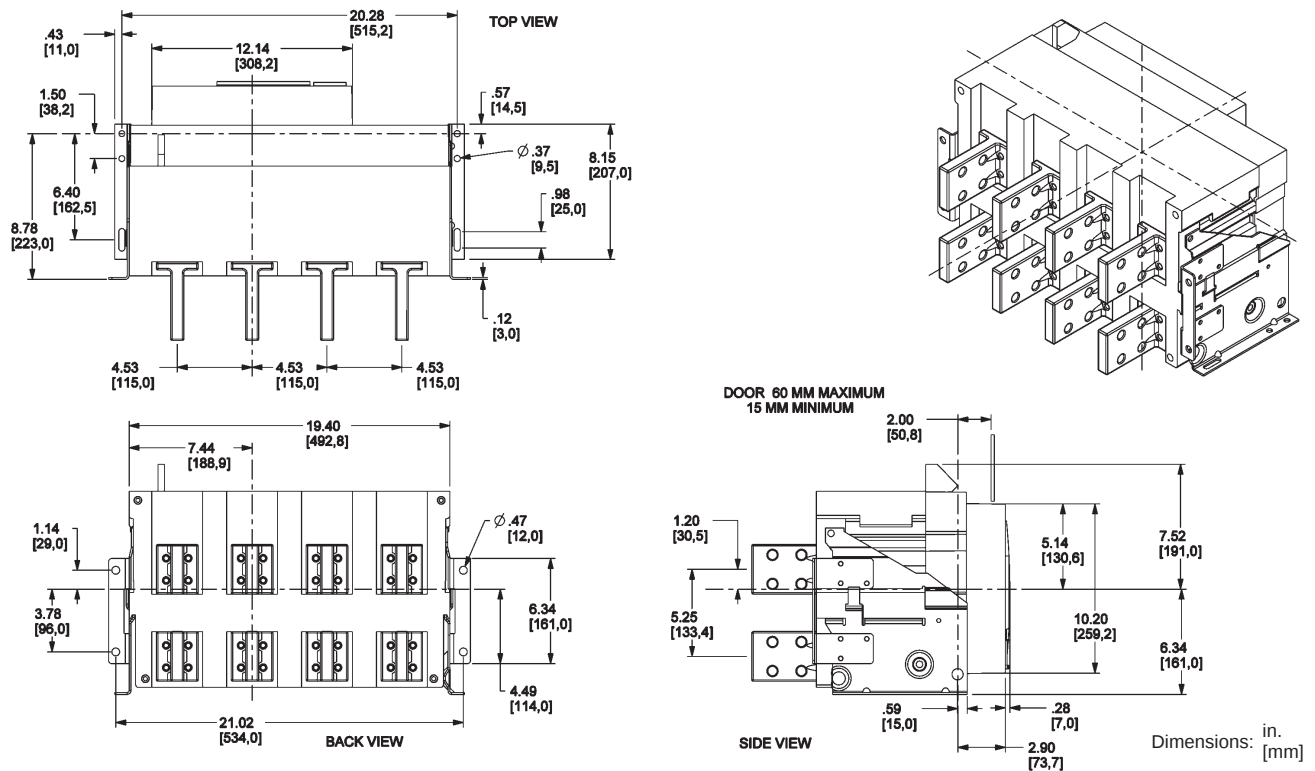


Figure 116: 800–2000 A Rear-Connected "T" Vertical (RCTV)

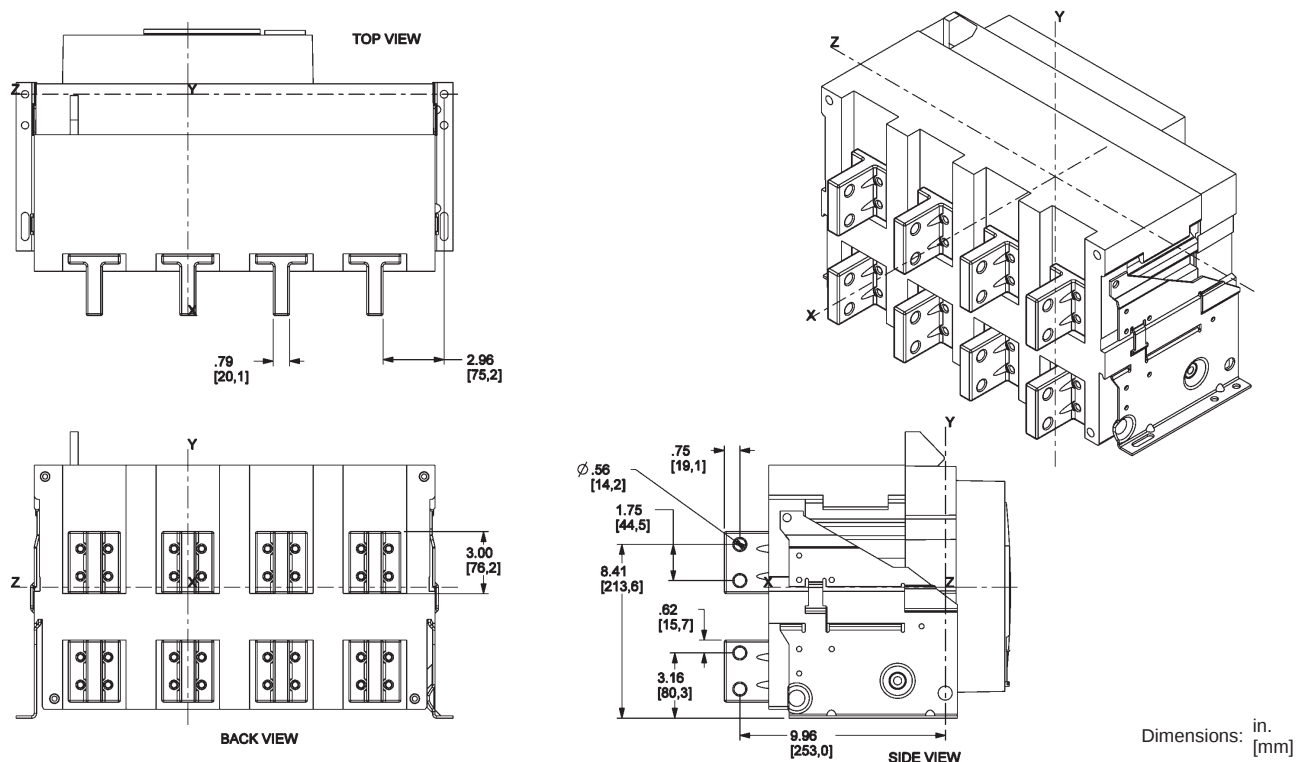

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 117: 800–2000 A Rear-Connected "T" Horizontal (RCTH)


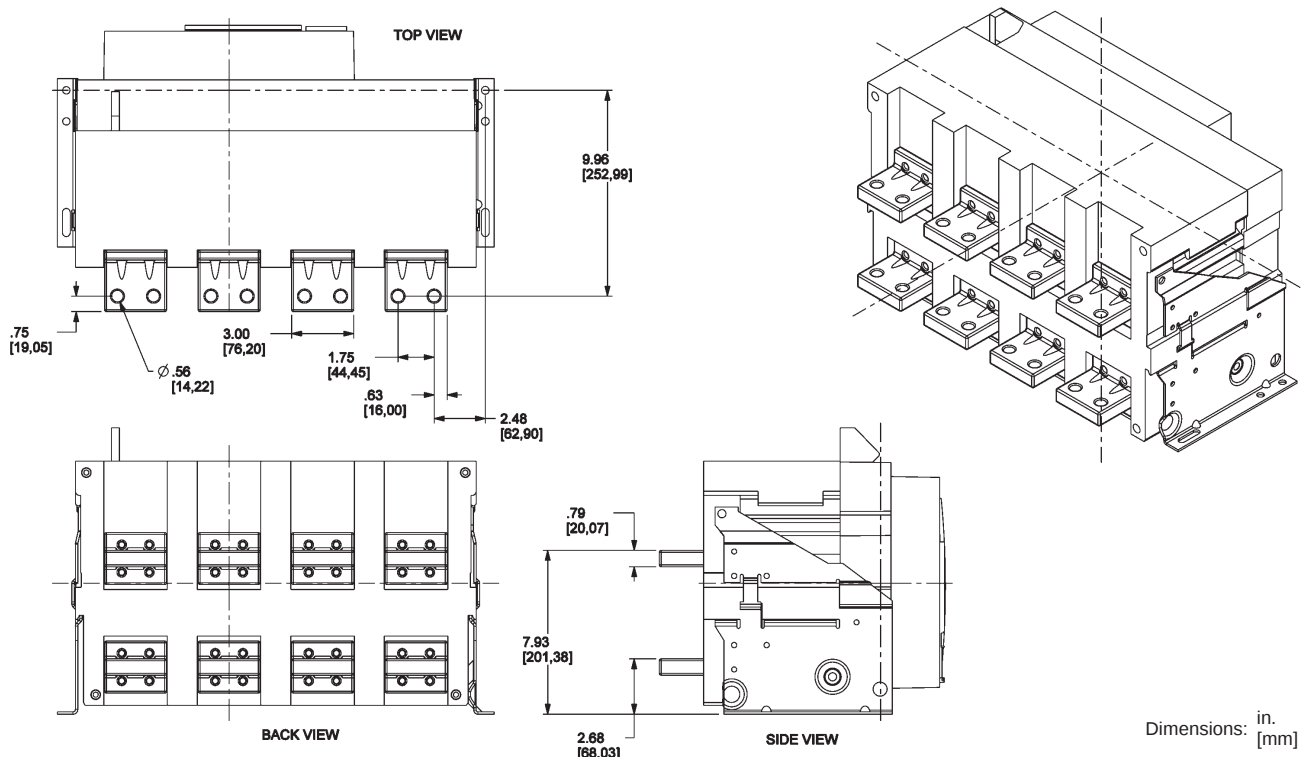


Figure 118: 800–2000 A Front-Connected Flat (FCF)

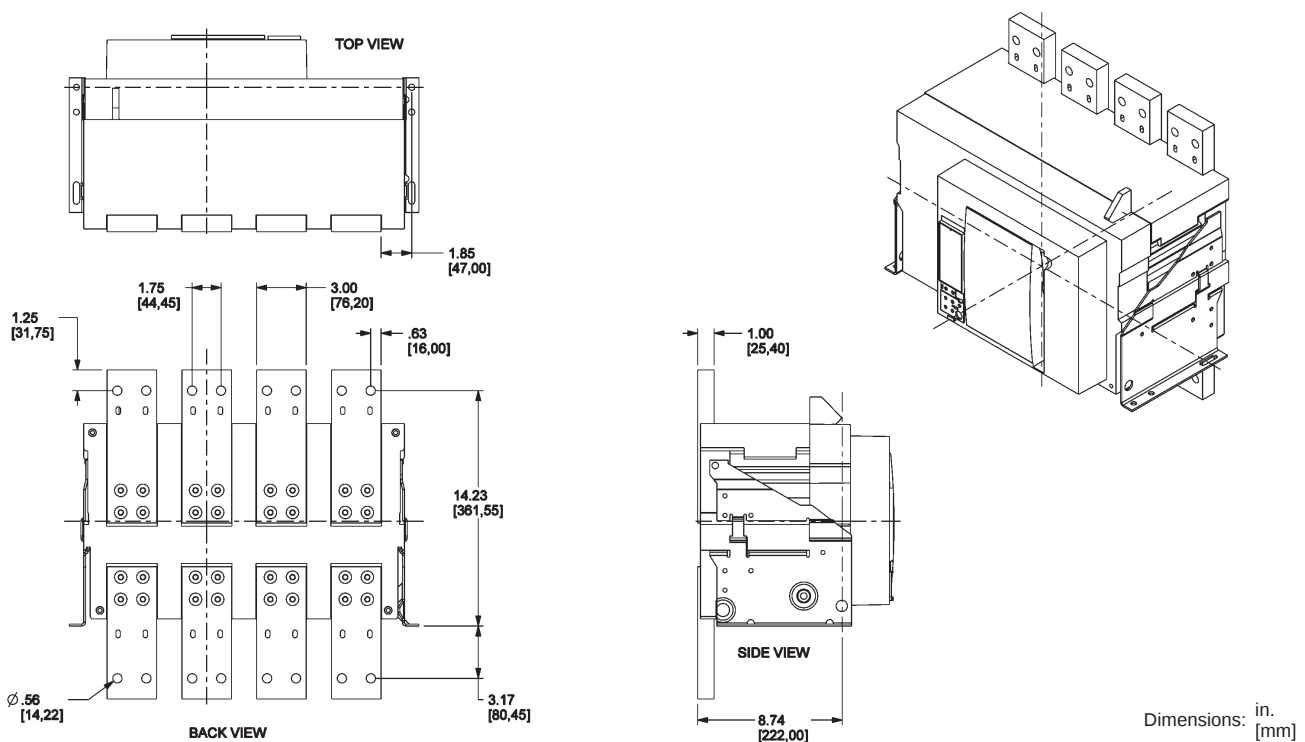

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 119: 800–3000 A Front-Connected "T" (FCT)


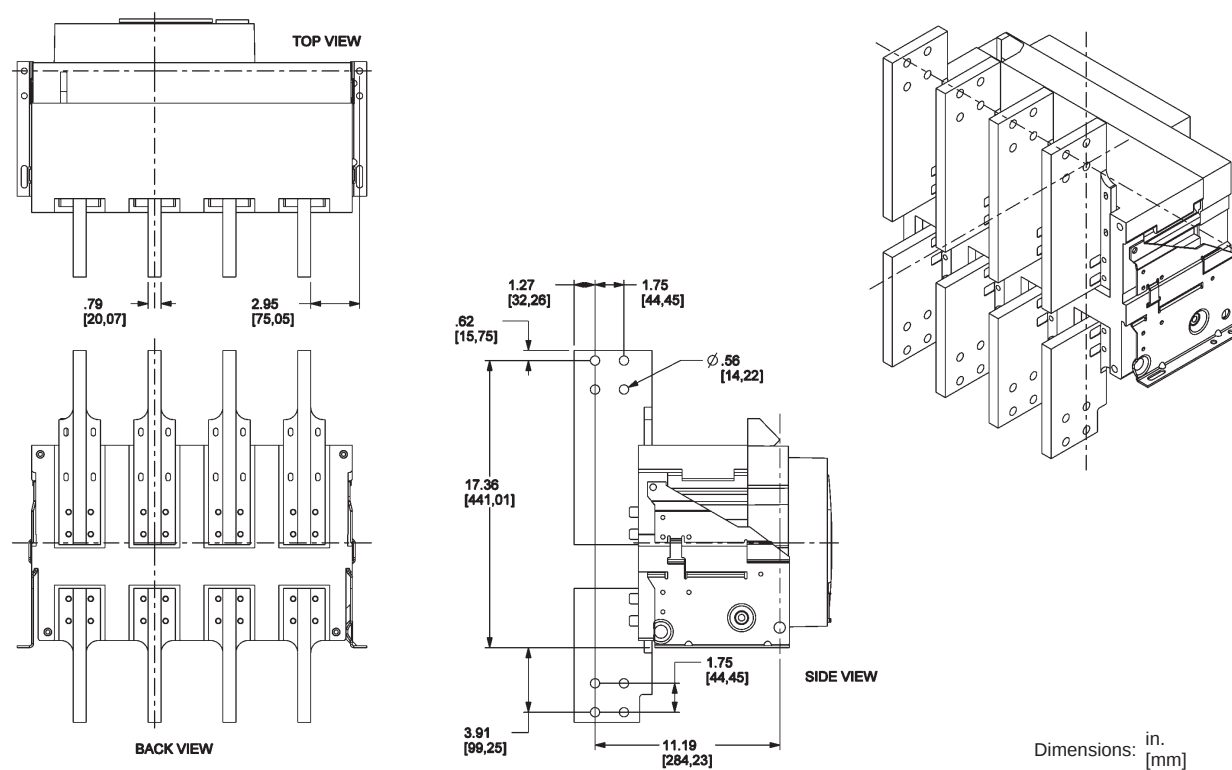


Figure 120: 2000 A L1 and 3200 A Rear-Connected Offset Vertical (RCOV)

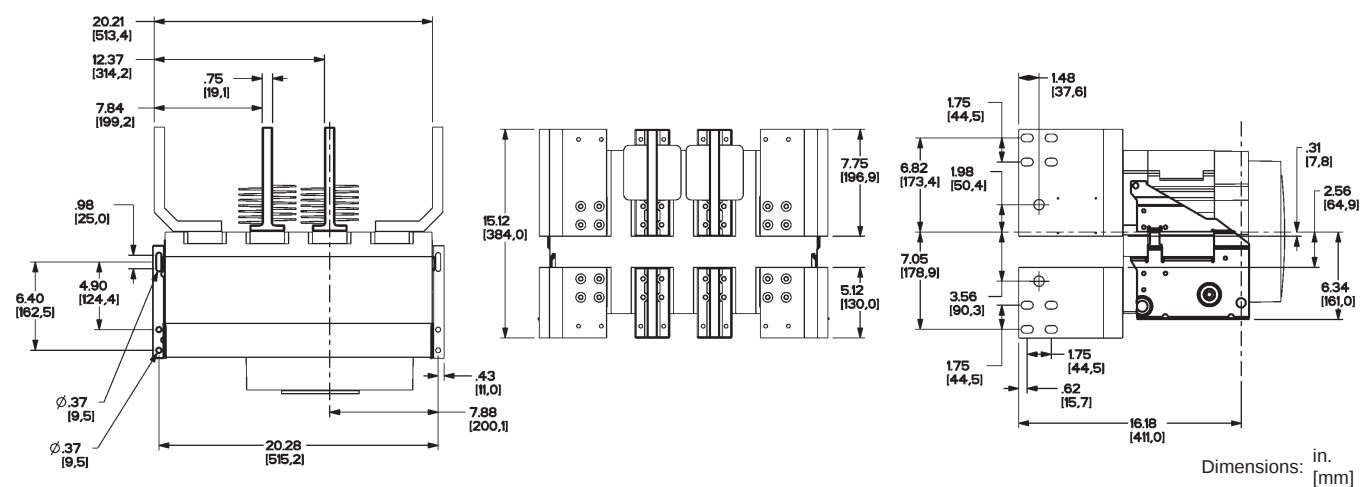

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 121: 2500–3000 A Rear Vertical "T" Horizontal (RCTV)


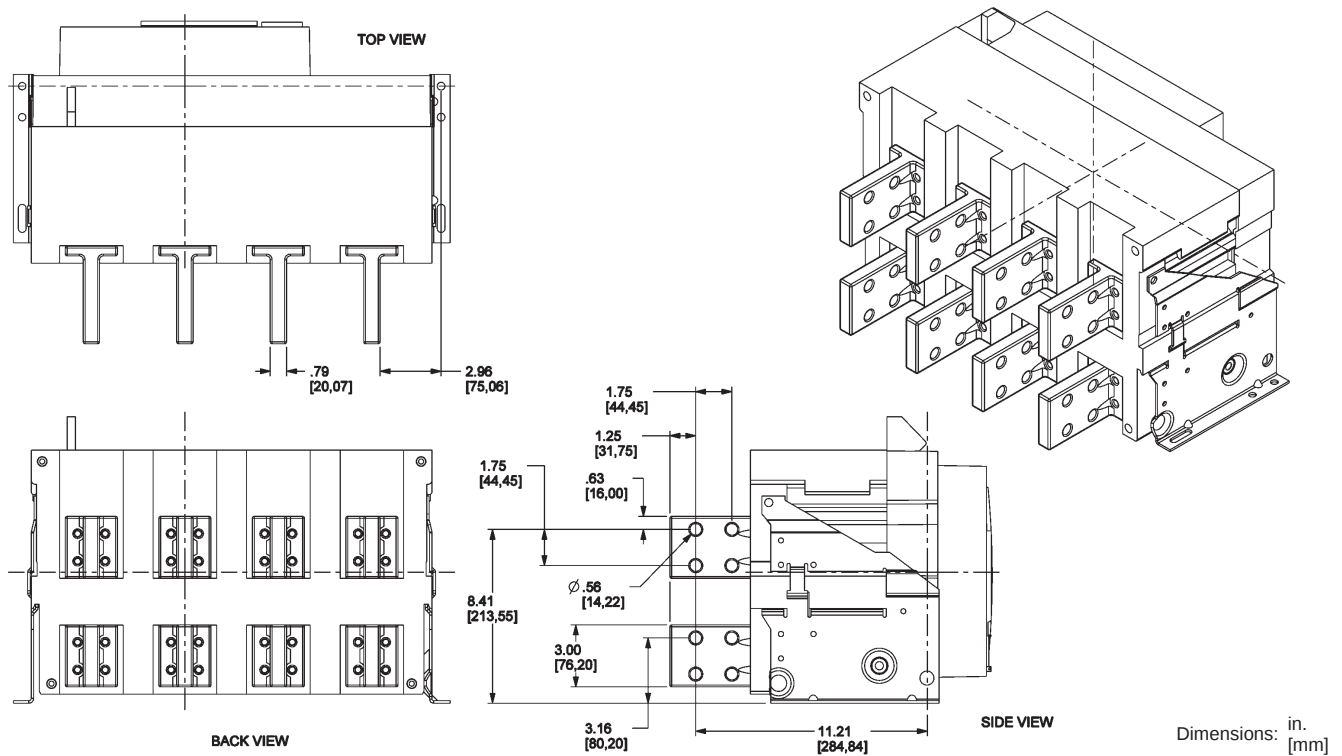


Figure 122: 2500–3000 A Rear-Connected "T" Horizontal (RCTH)

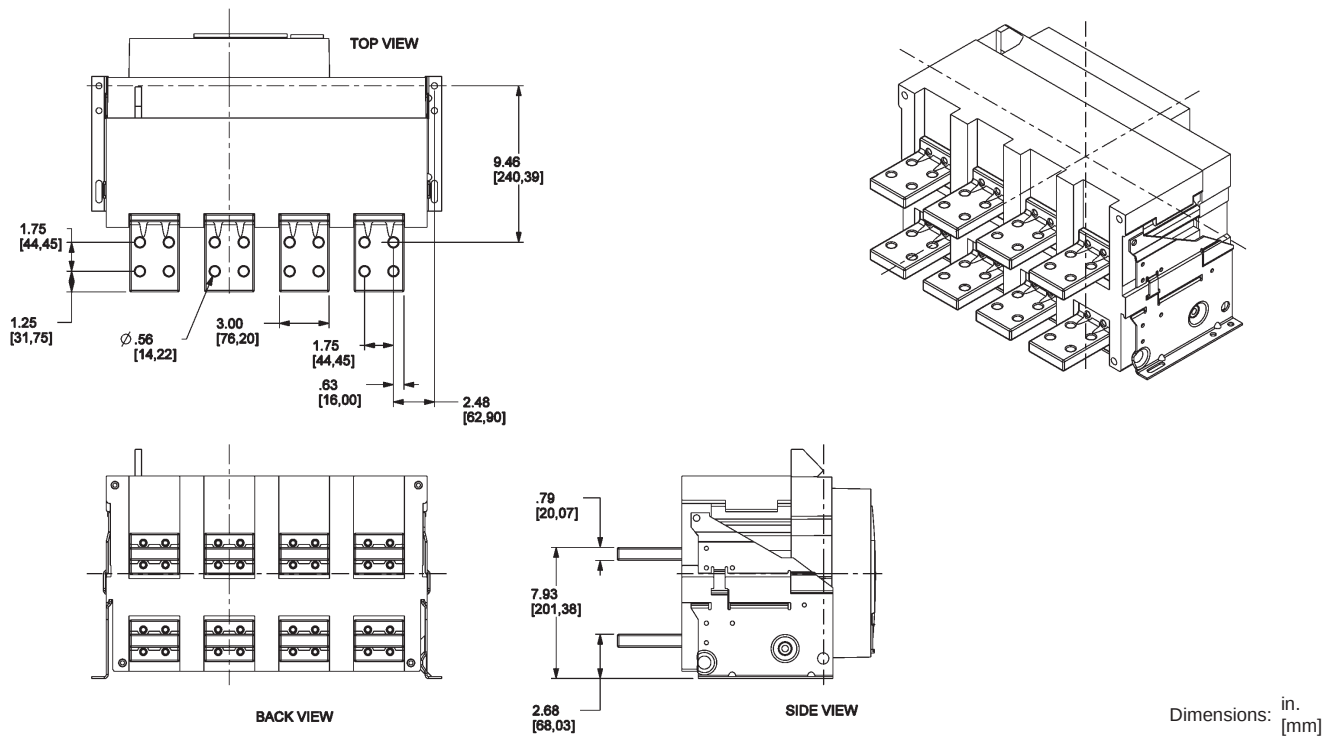

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 123: 4000–6000 A Master Drawing


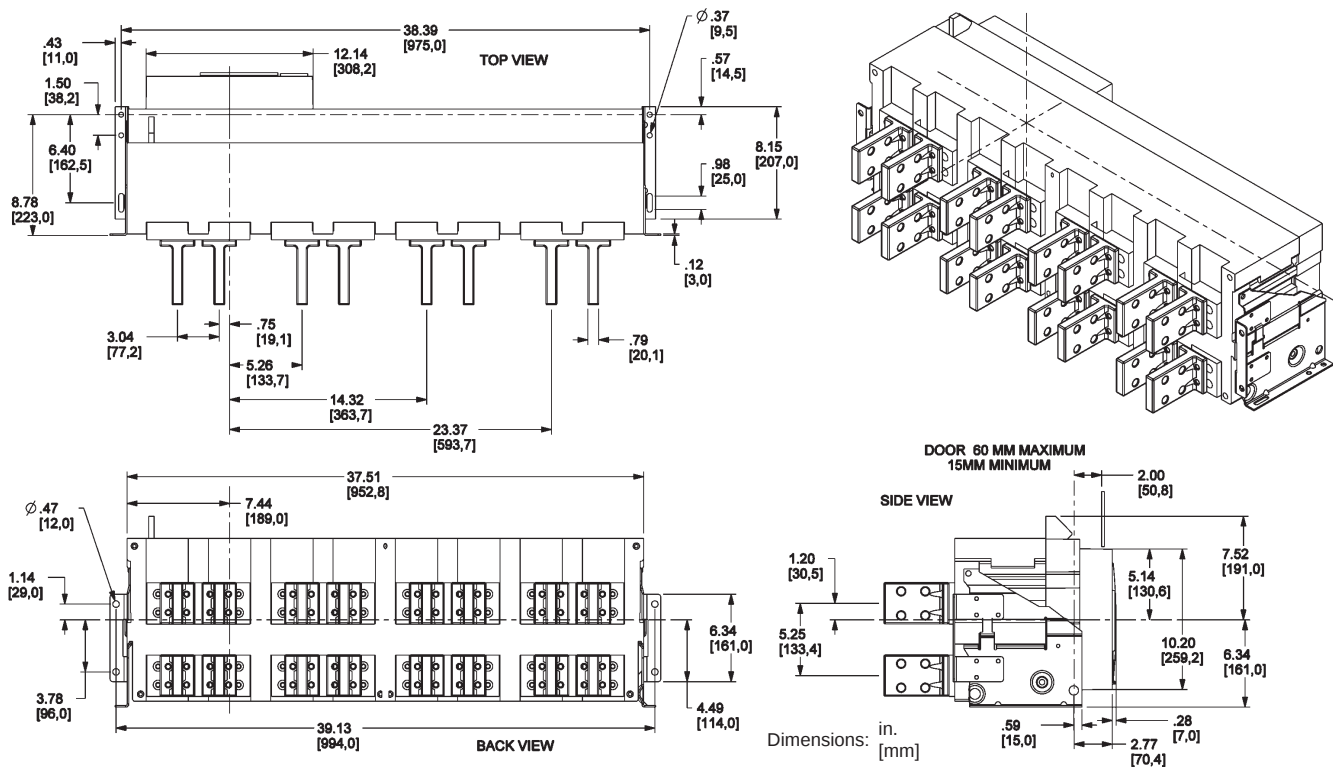


Figure 124: 4000–5000 A Rear-Connected "T" Vertical (RCTV)

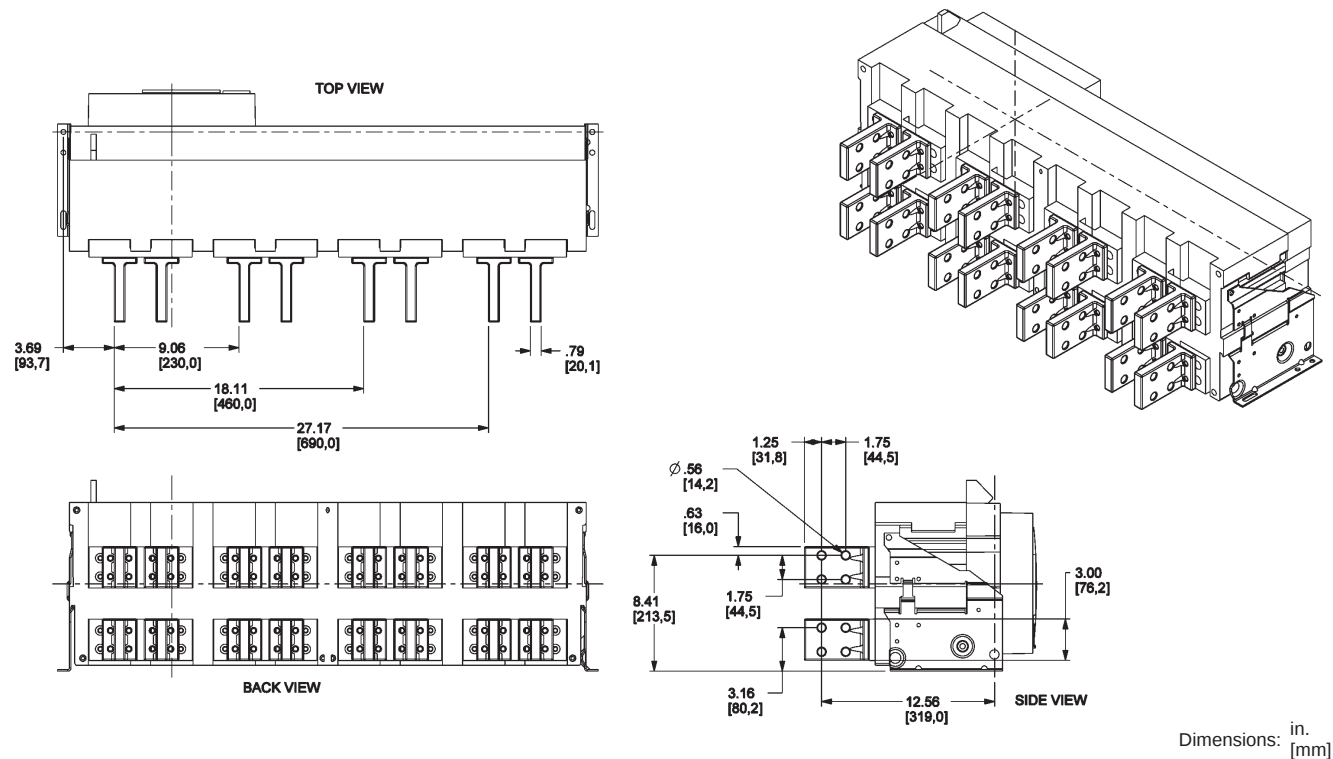

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 125: 4000–5000 A Rear-Connected "T" Horizontal (RCTH)


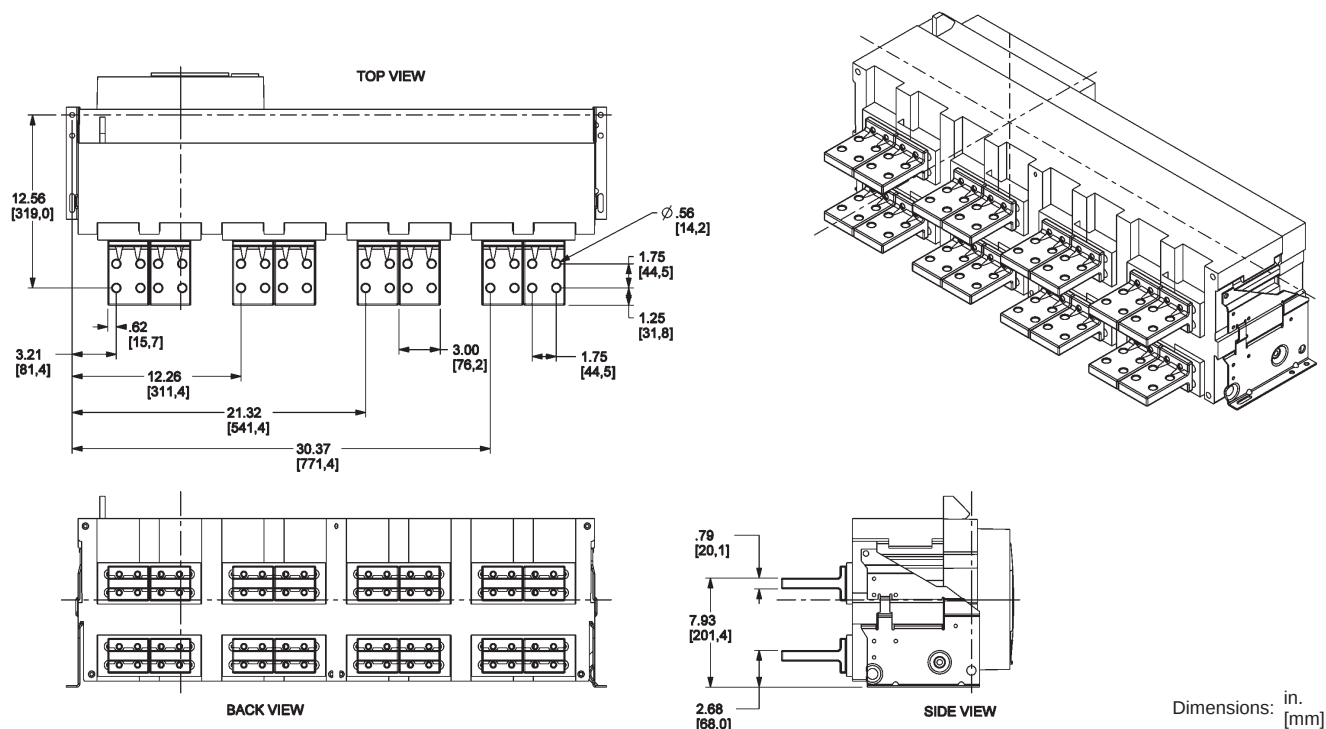



Figure 126: 6000 A Rear-Connected "T" Vertical (RCTV)

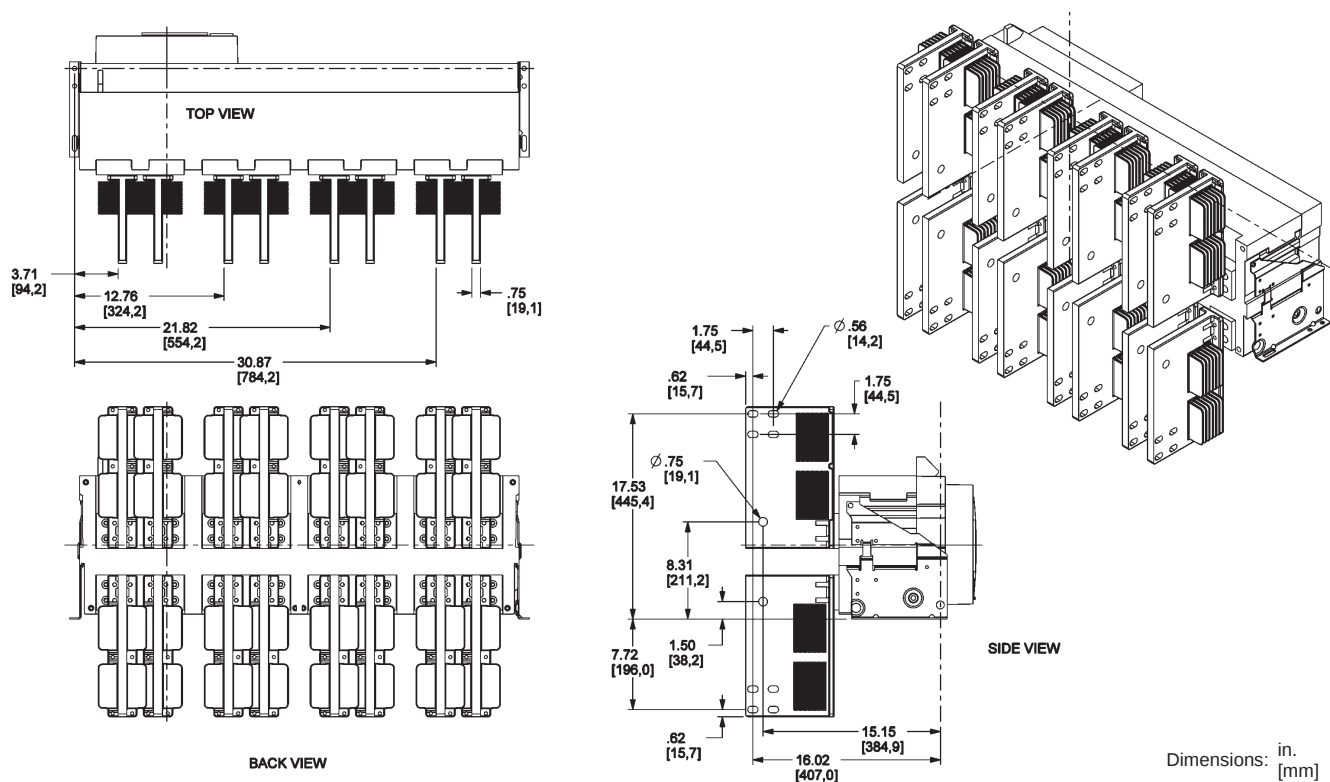

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 127: Pan Drawings for 3P and 4P Circuit Breakers

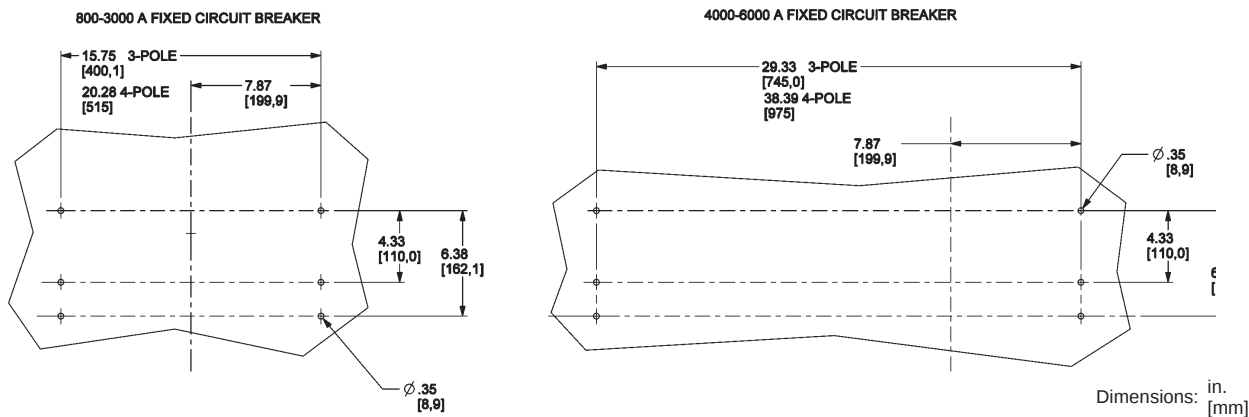

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Neutral Current Transformers

Figure 128: Neutral Current Transformer 100–250 A, 400–2000 A

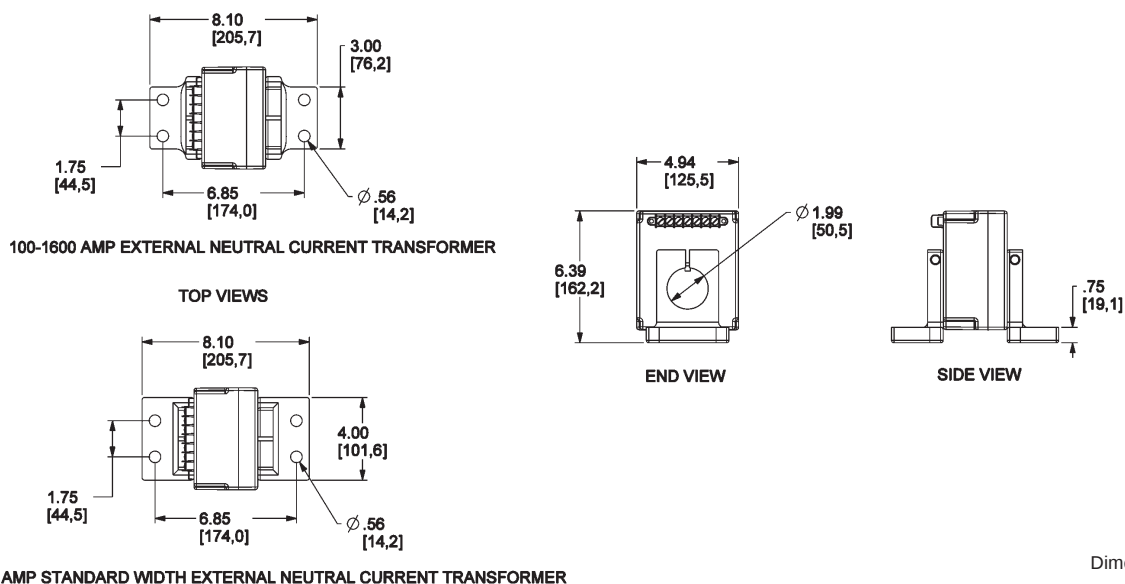


Figure 129: Neutral Current Transformer 2000–4000 A


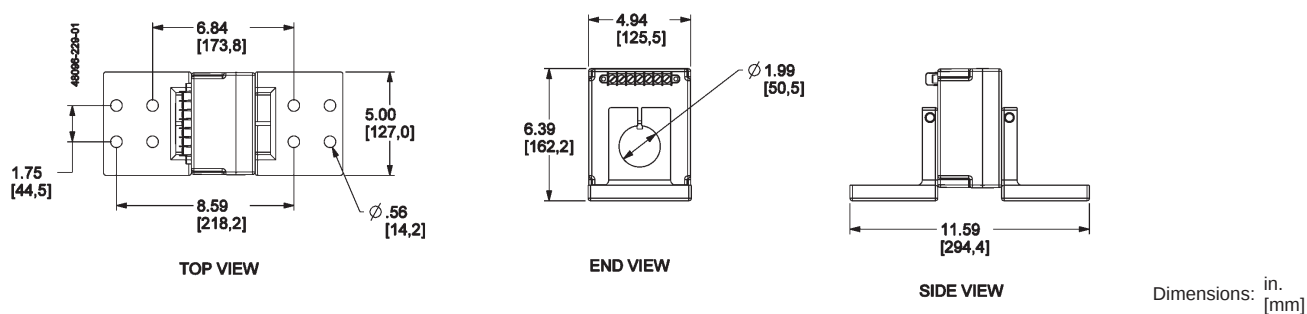


Figure 130: Double Neutral Current Transformer 2000–6300 A

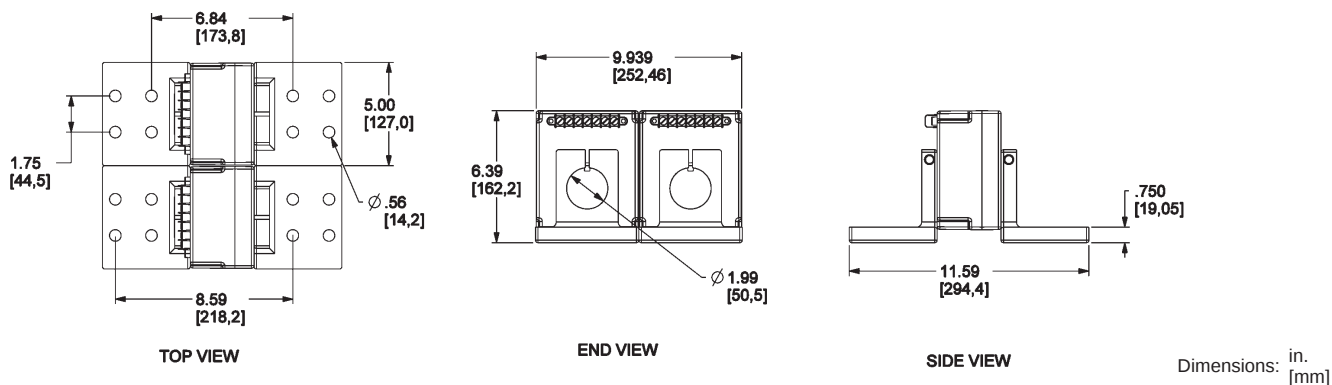


Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 131: MDGF/SGR Current Transformer

- NOTES:
- 1. PER UL 1446
 - 2. TEMPERATURE RATING OF 155 DEGREES C

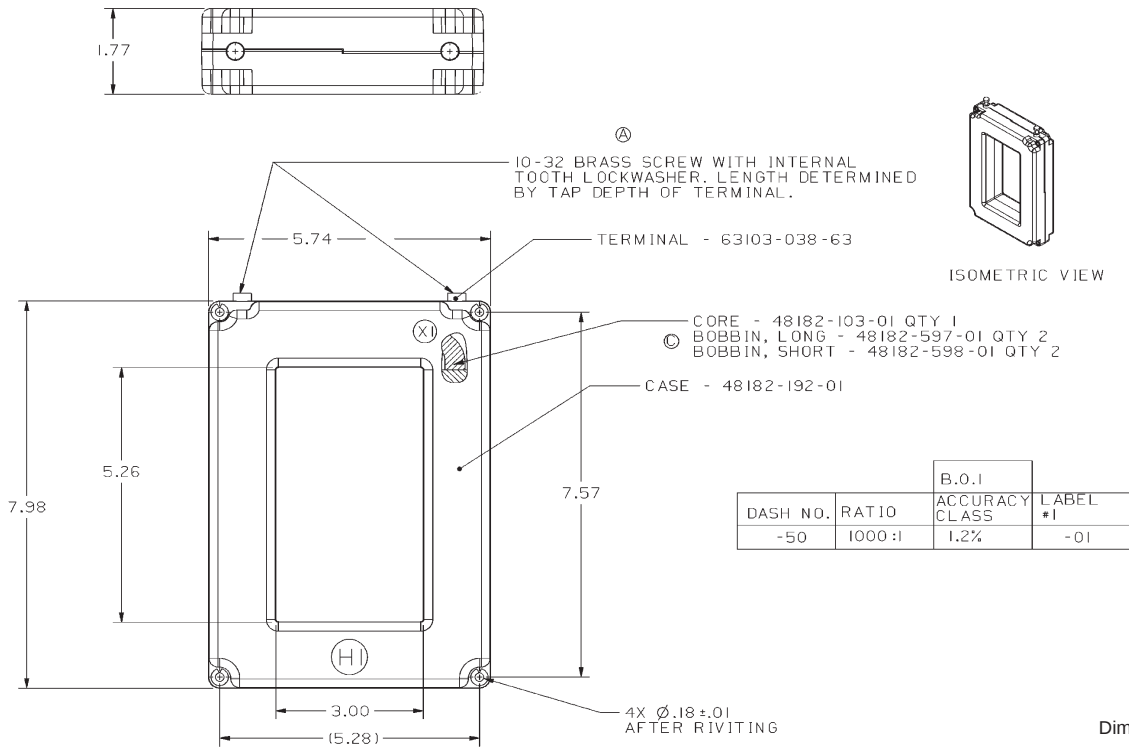


Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

IEC 3P Drawout Circuit Breakers*

Figure 132: 800–3200 A Rear-Connected "T" Vertical (RCTV)

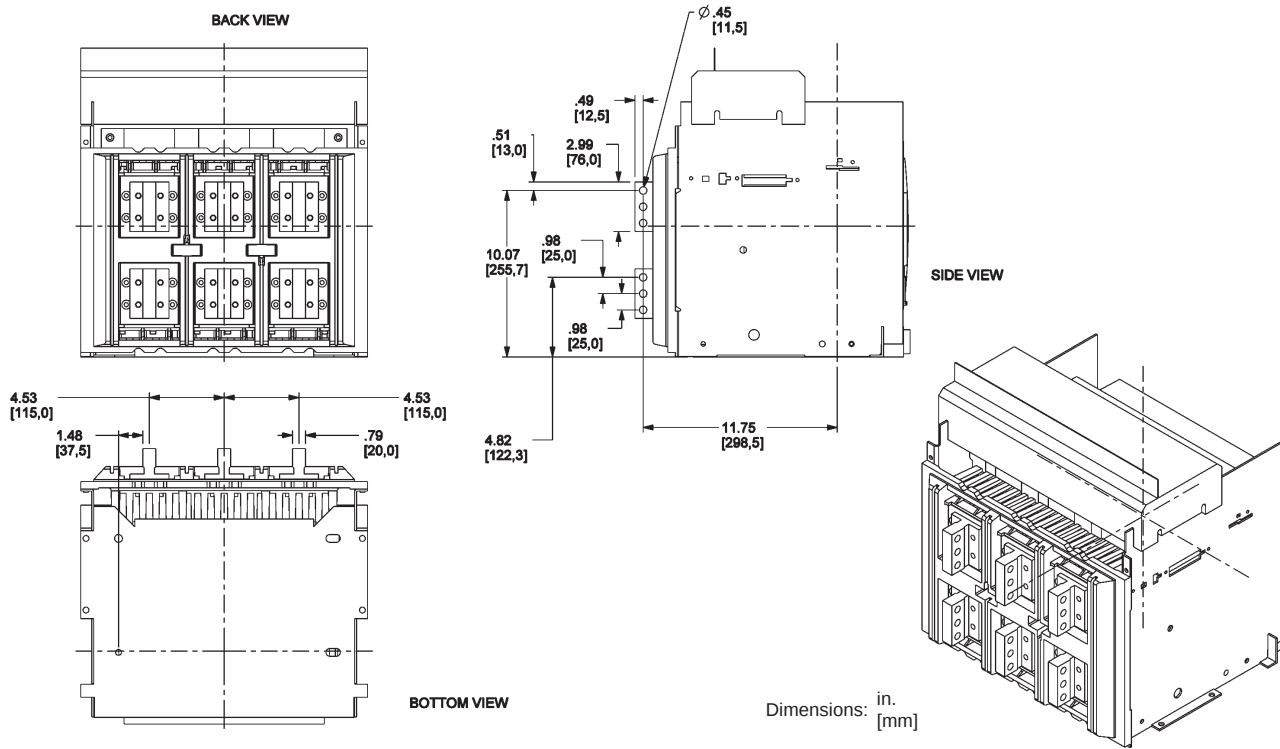

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 133: 800–3200 A Rear-Connected "T" Horizontal (RCTH)


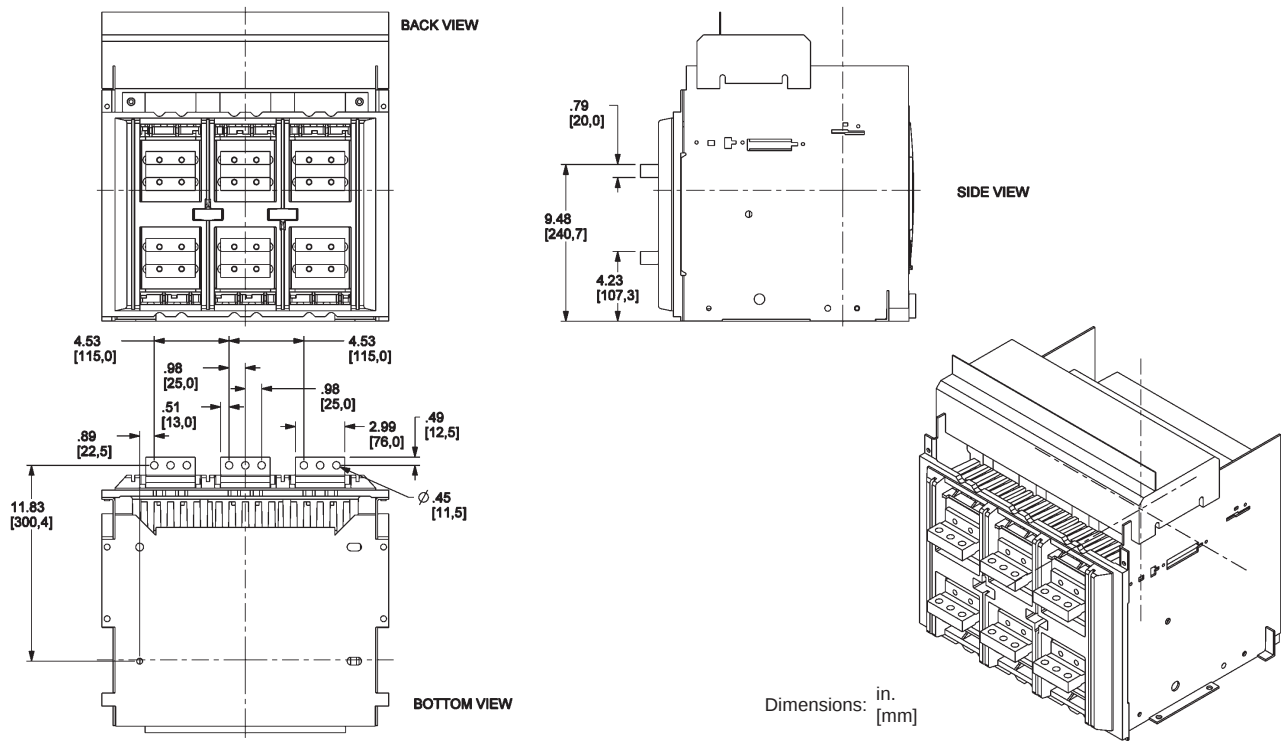


Figure 134: 800–3200 A Front-Connected Flat (FCF)

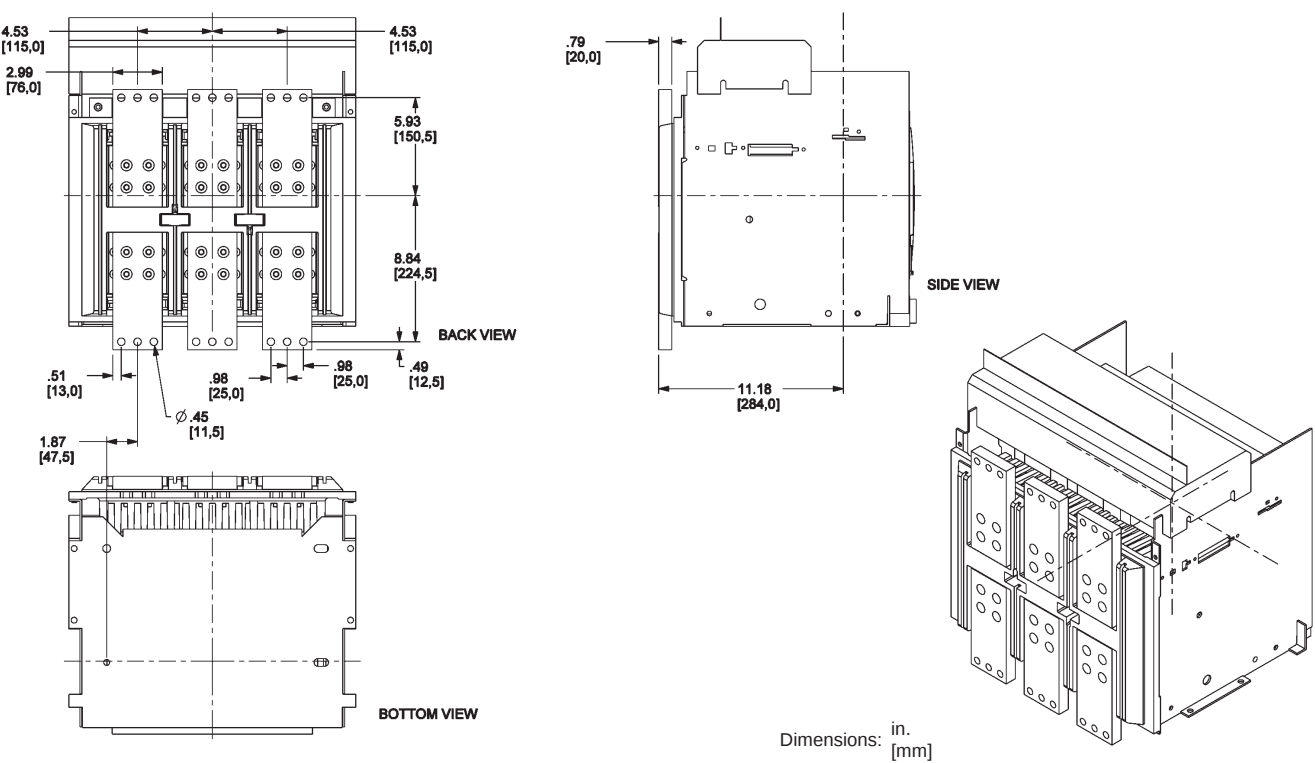

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 135: 4000 A Rear-Connected "T" Vertical (RCTV)


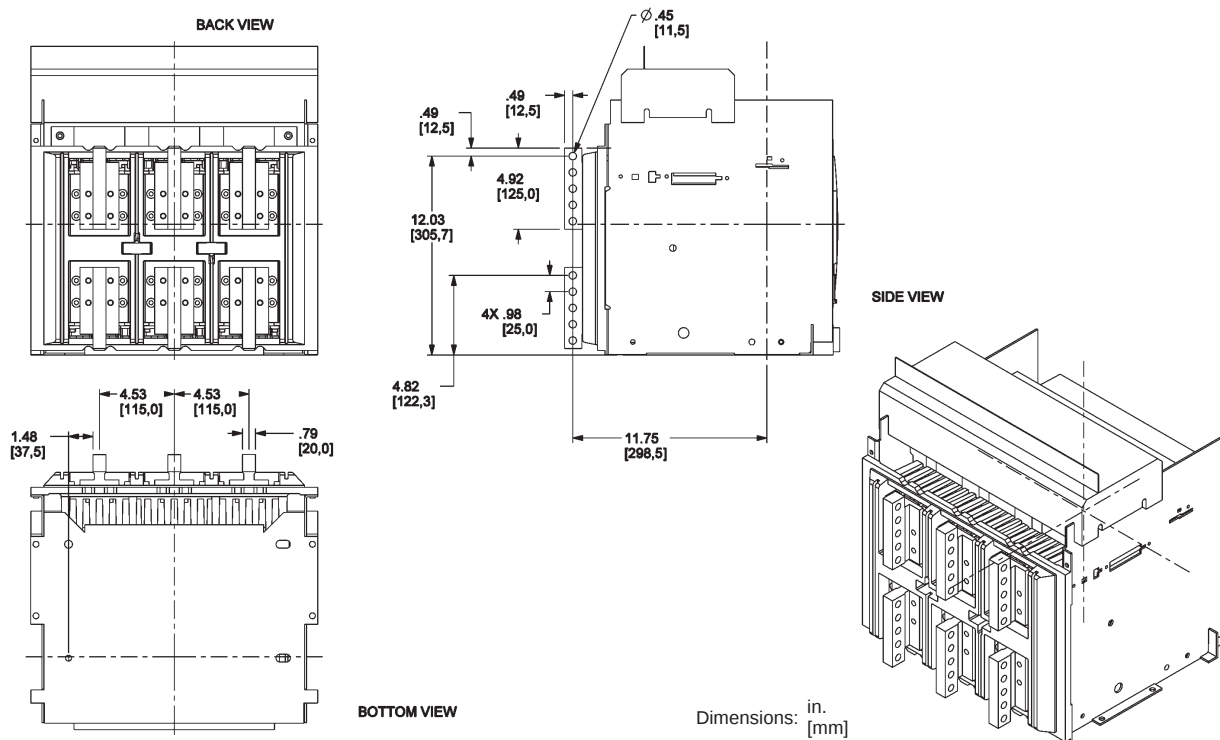


Figure 136: 4000 A Rear-Connected "T" Horizontal (RCTH)

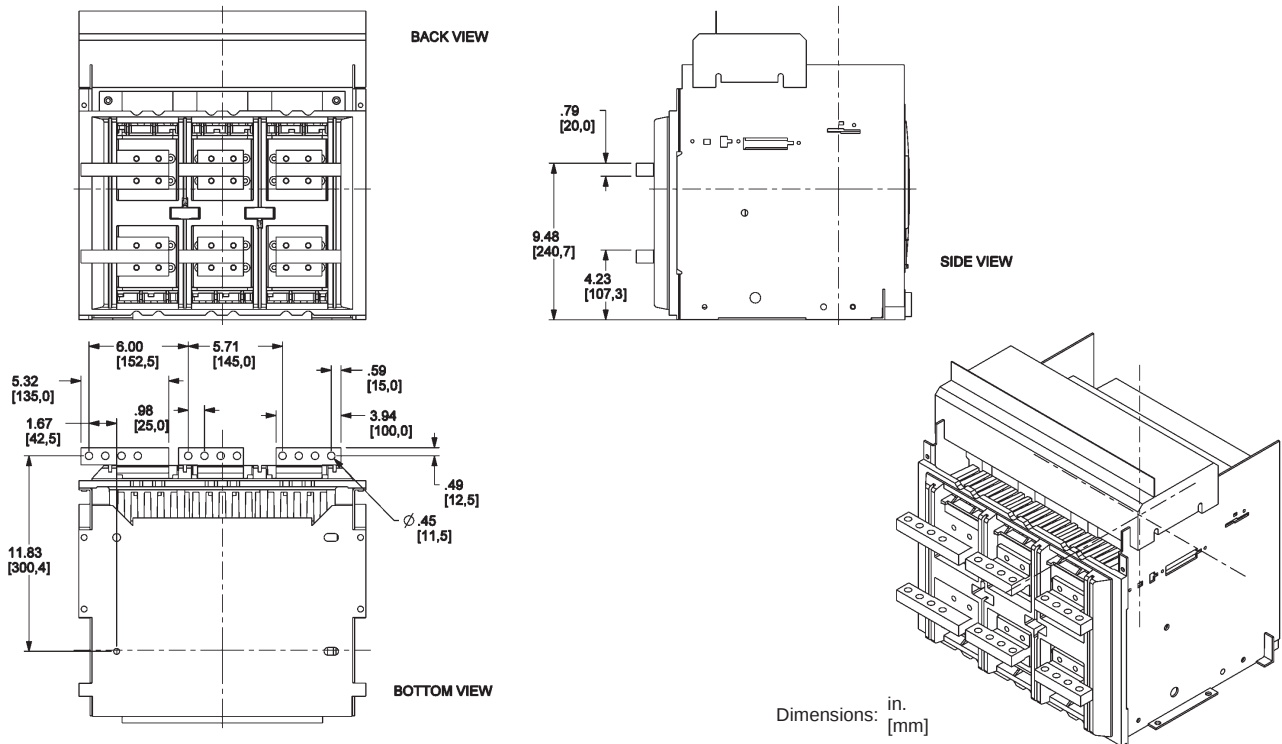

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 137: 5000 A Rear-Connected "T" Vertical (RCTV)


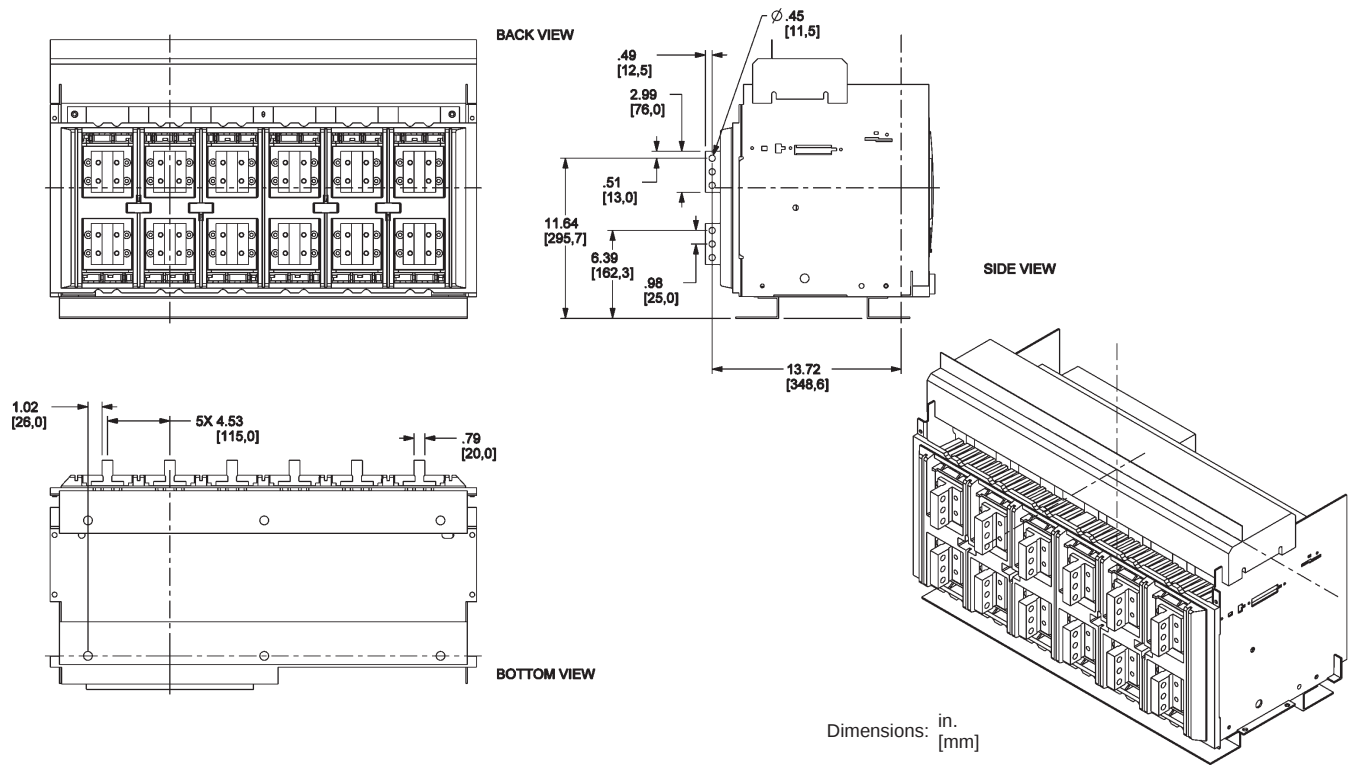



Figure 138: 5000 A Rear-Connected "T" Horizontal (RCTH)

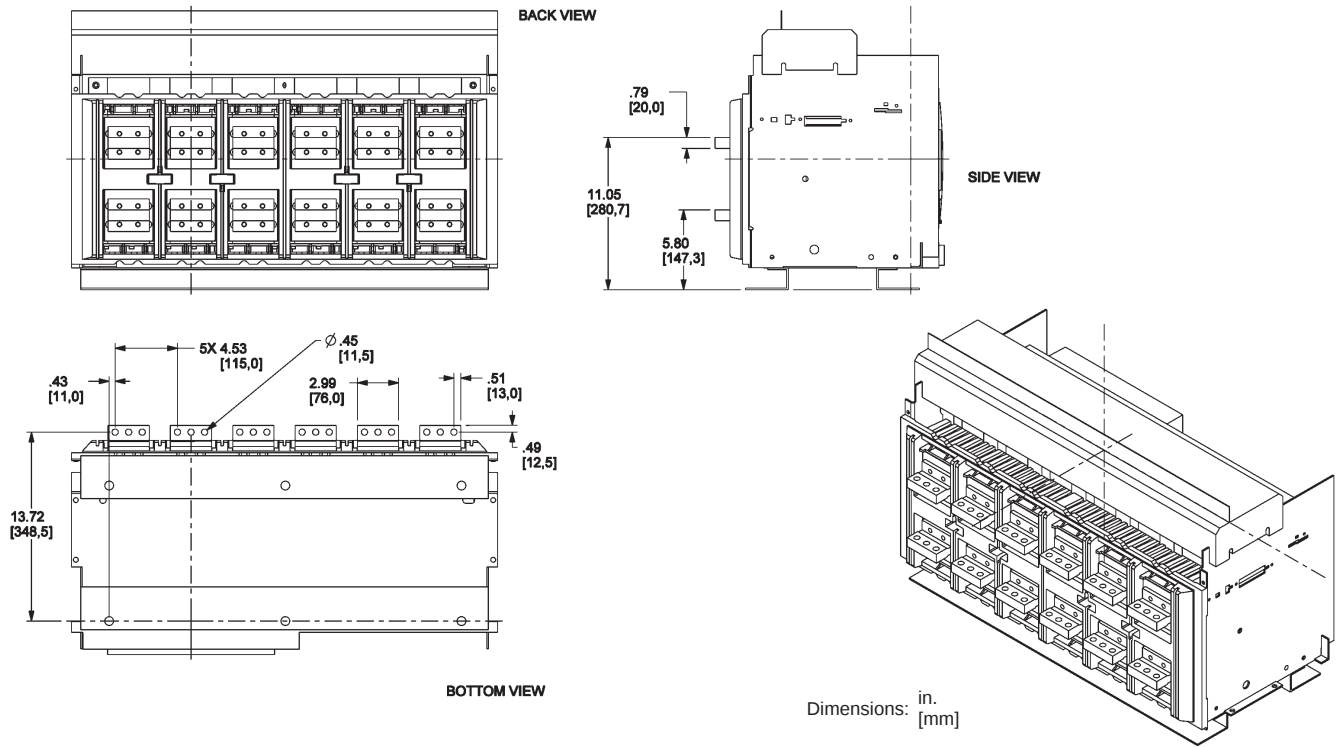

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 139: 6300 A Rear-Connected "T" Vertical (RCTV)

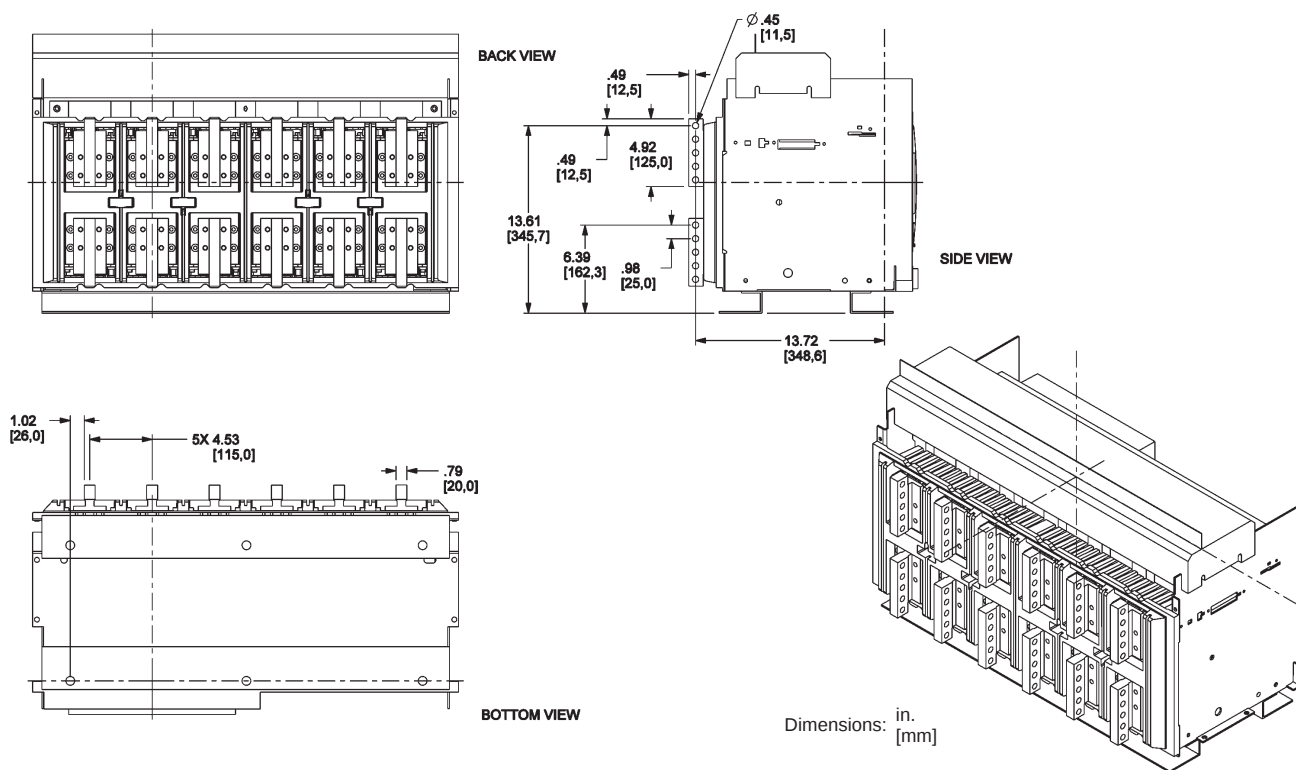

Masterpact™ NT and NW Universal Power Circuit Breakers
Masterpact NW Dimensional Drawings

IEC 3P Fixed Circuit Breakers

Figure 140: 800–3200 A Rear-Connected "T" Vertical (RCTV)


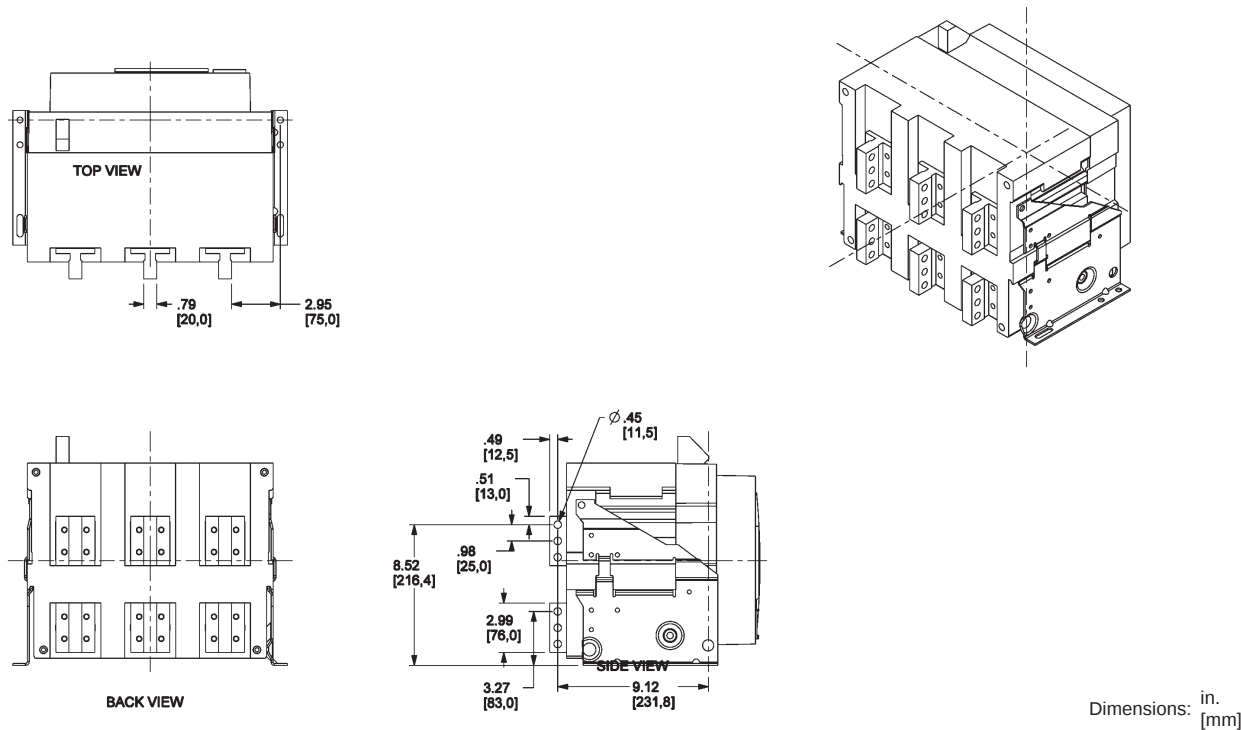


Figure 141: 800–3200 A Rear-Connected "T" Horizontal (RCTH)

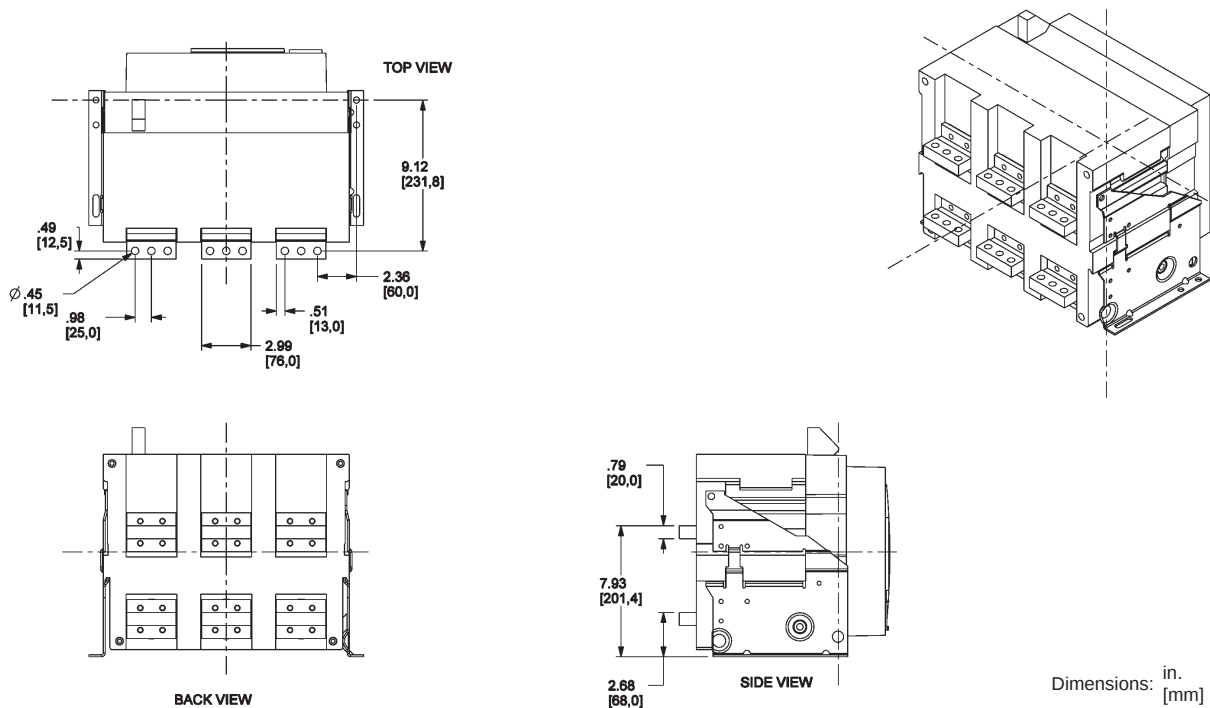

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 142: 800–3200 A Front-Connected Flat (FCF)


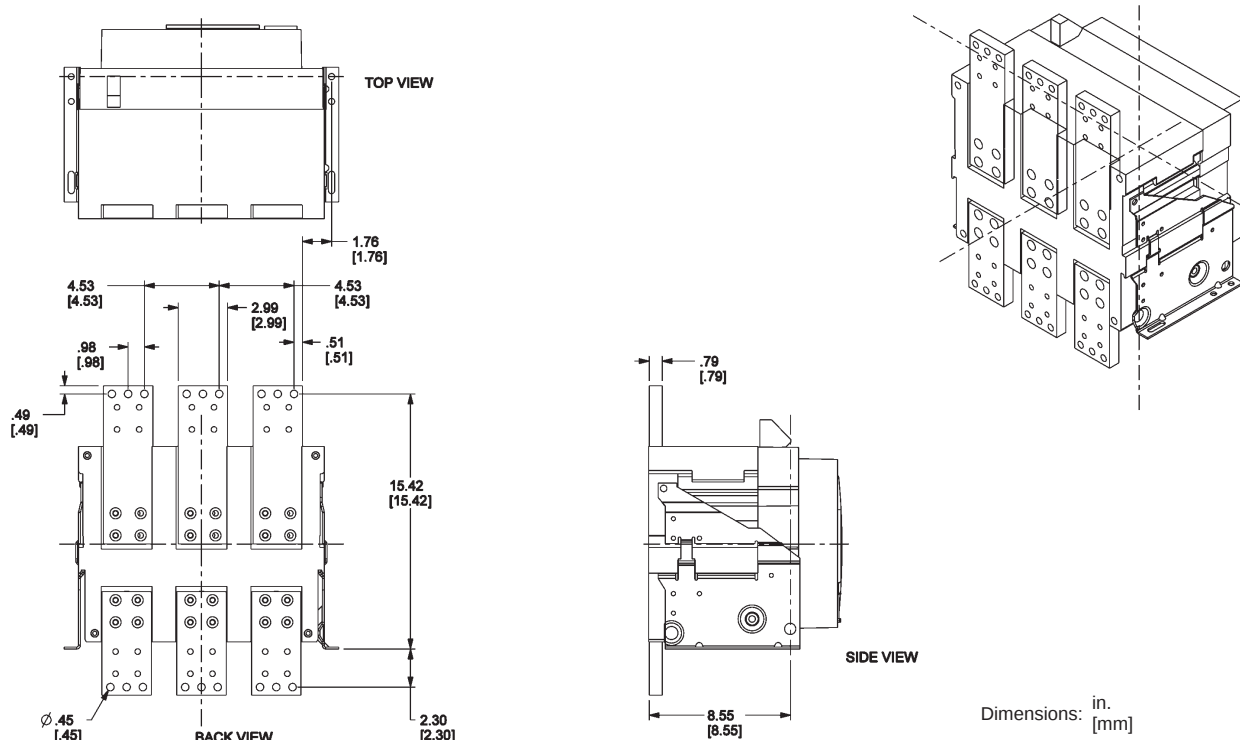


Figure 143: 4000 A Rear-Connected "T" Vertical (RCTV)

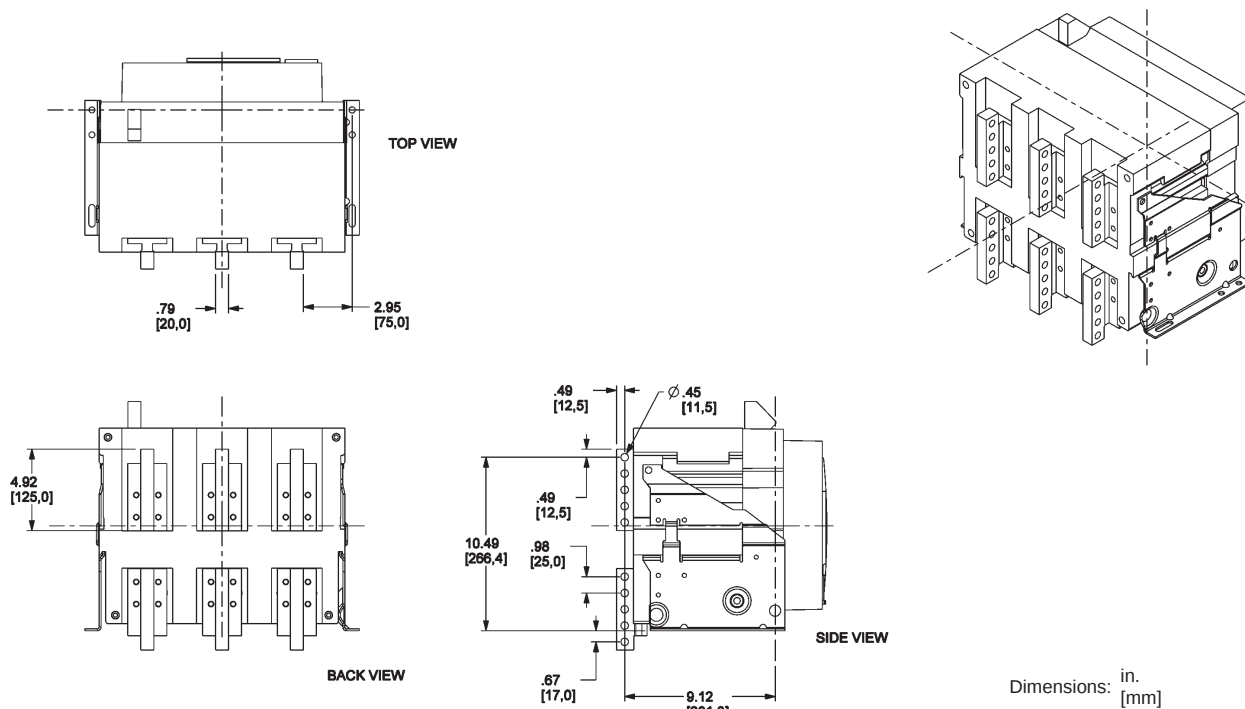

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 144: 4000 A Rear-Connected "T" Horizontal (RCTH)


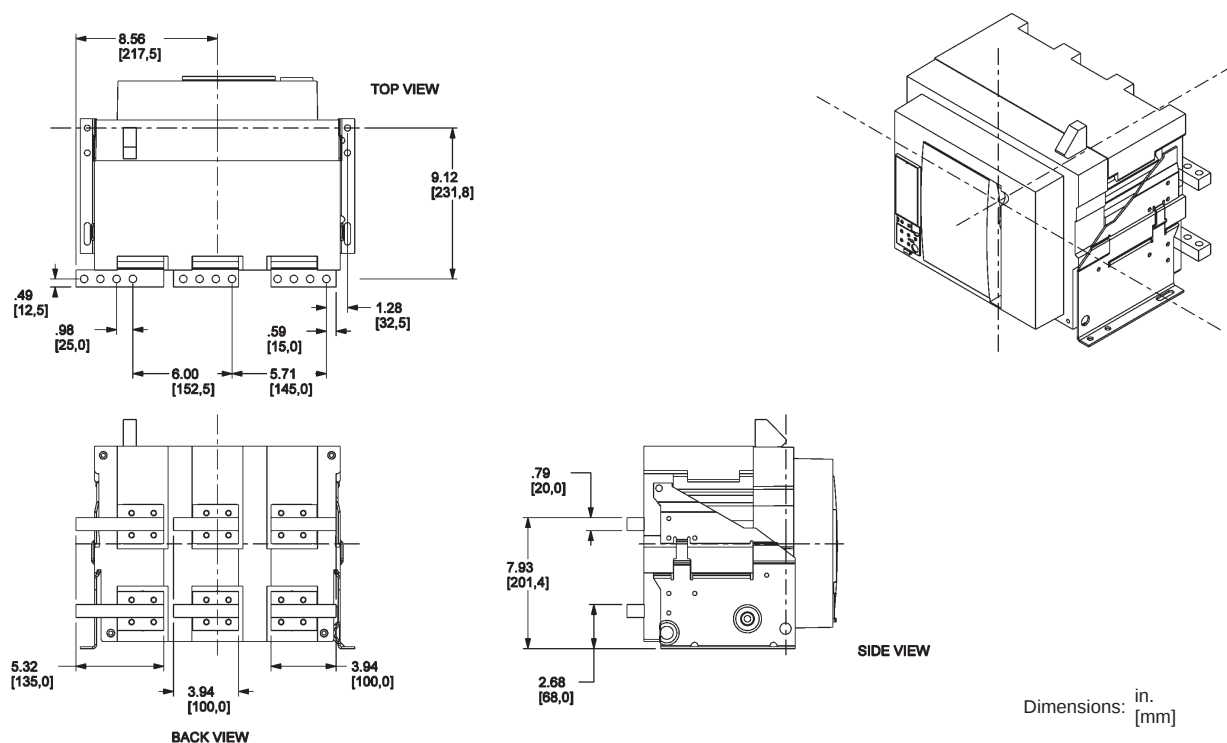


Figure 145: 5000 A Rear-Connected "T" Vertical (RCTV)

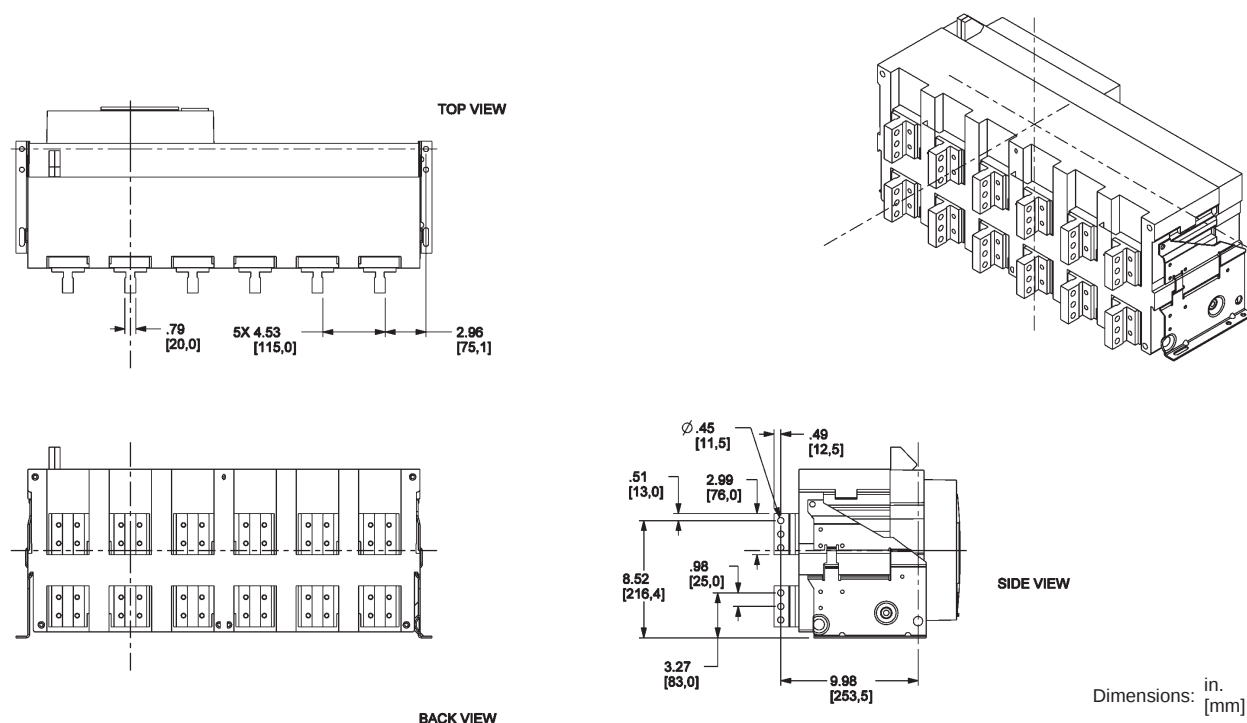

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 146: 5000 A Rear-Connected "T" Horizontal (RCTH)


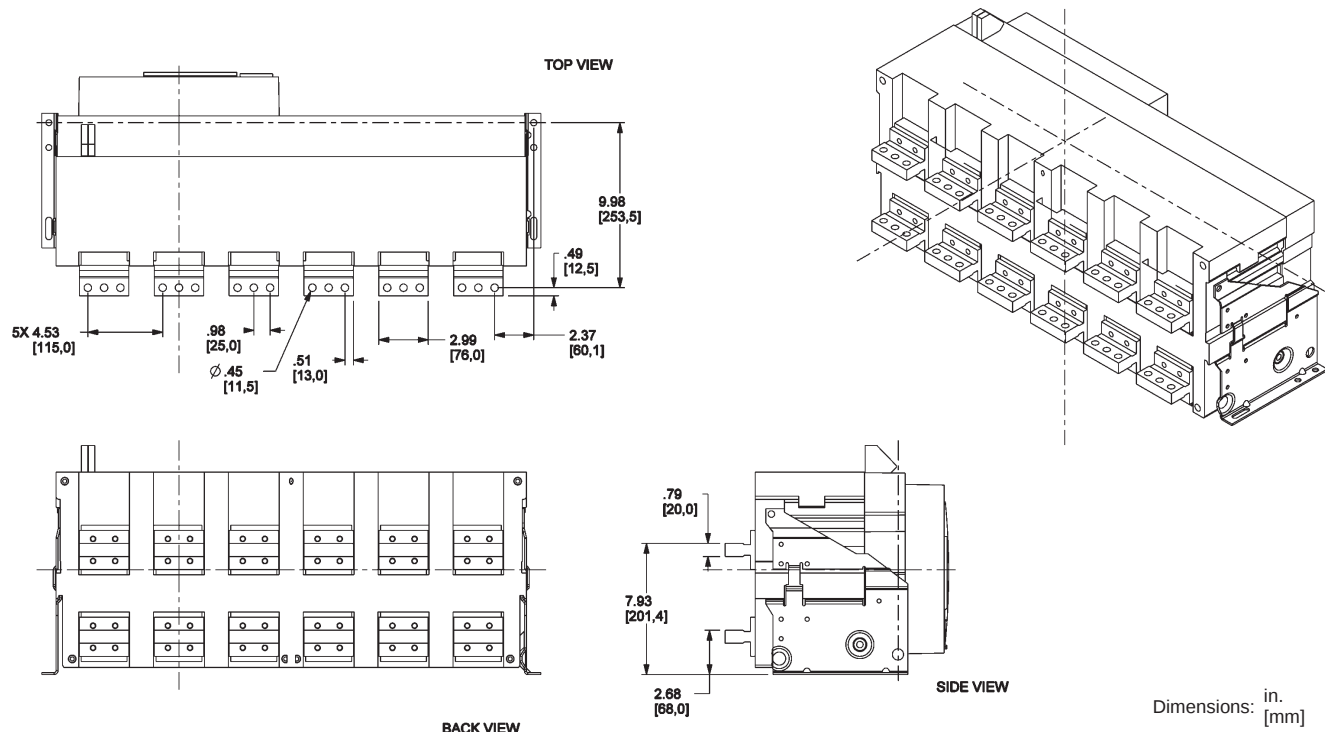



Figure 147: 6300 A Rear-Connected "T" Vertical (RCTV)

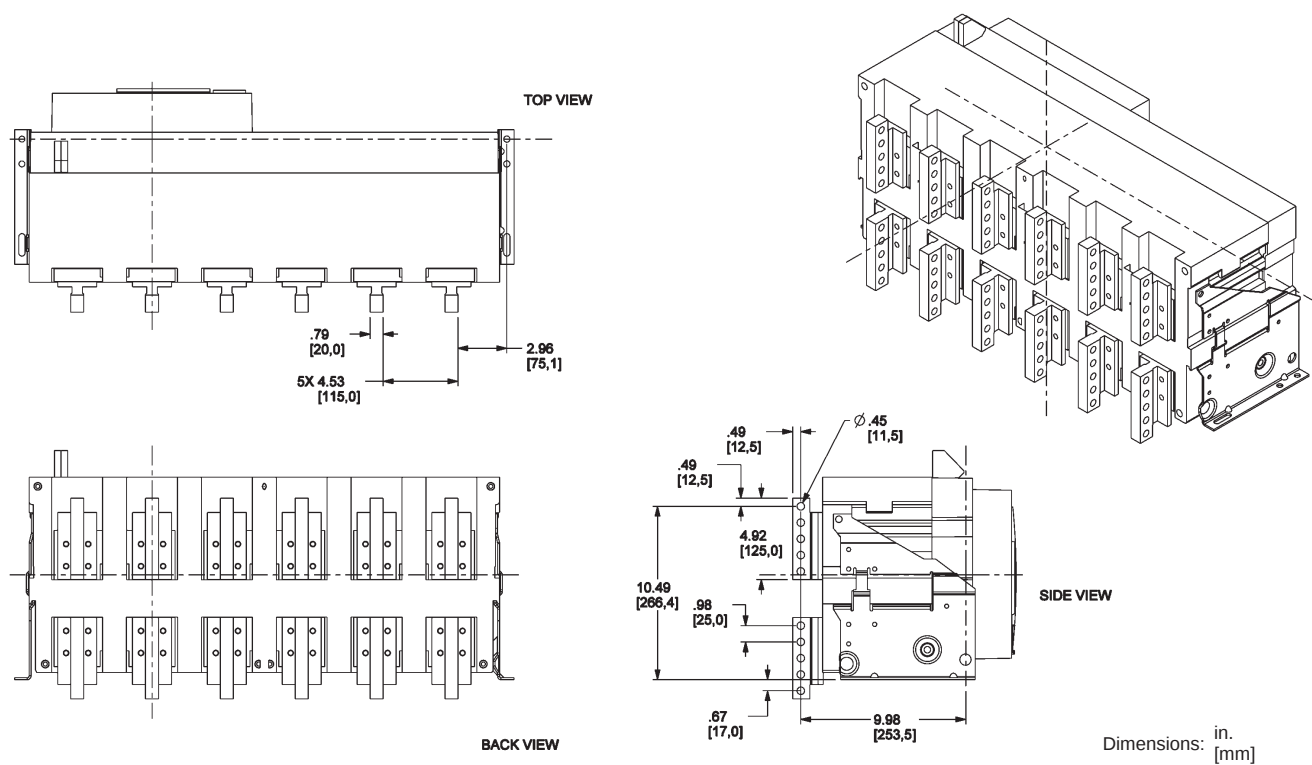

Masterpact™ NT and NW Universal Power Circuit Breakers
Masterpact NW Dimensional Drawings

IEC 4P Drawout Circuit Breakers

Figure 148: 800–3200 A Rear-Connected "T" Vertical (RCTV)

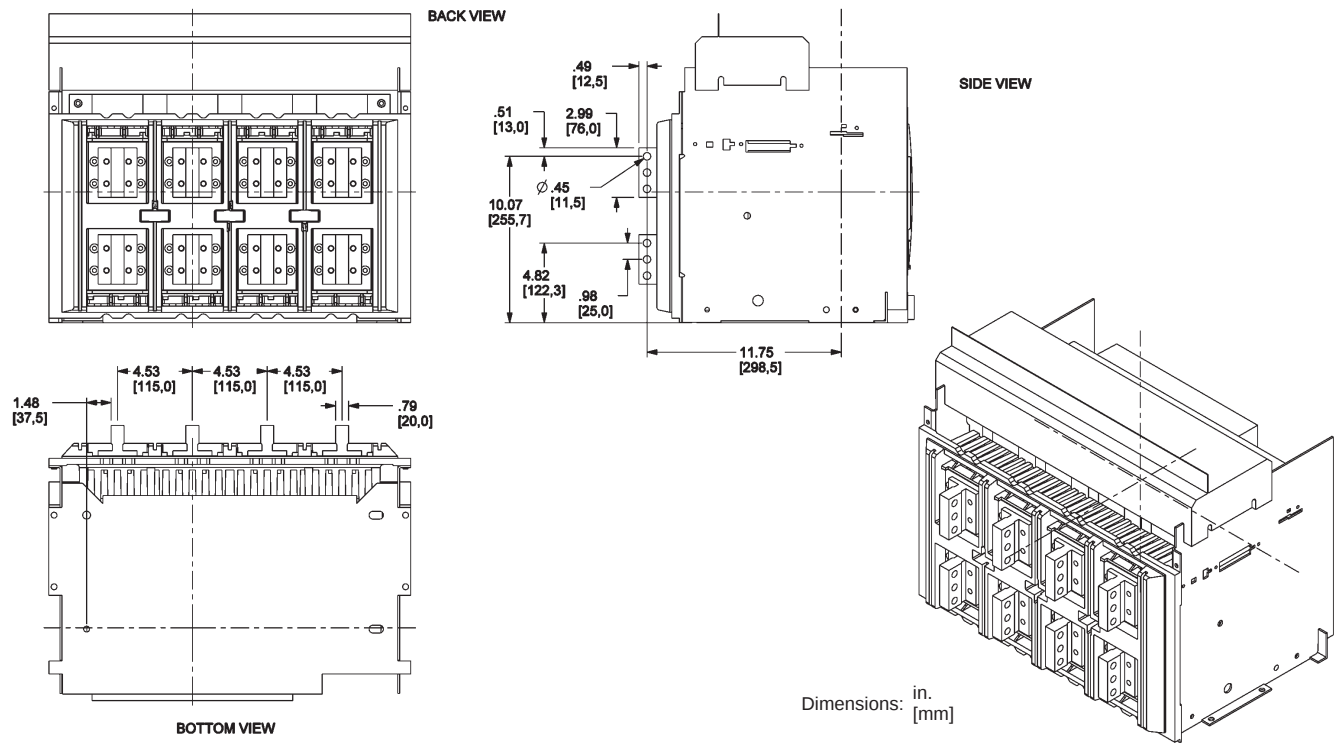

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 149: 800–3200 A Rear-Connected "T" Horizontal (RCTH)


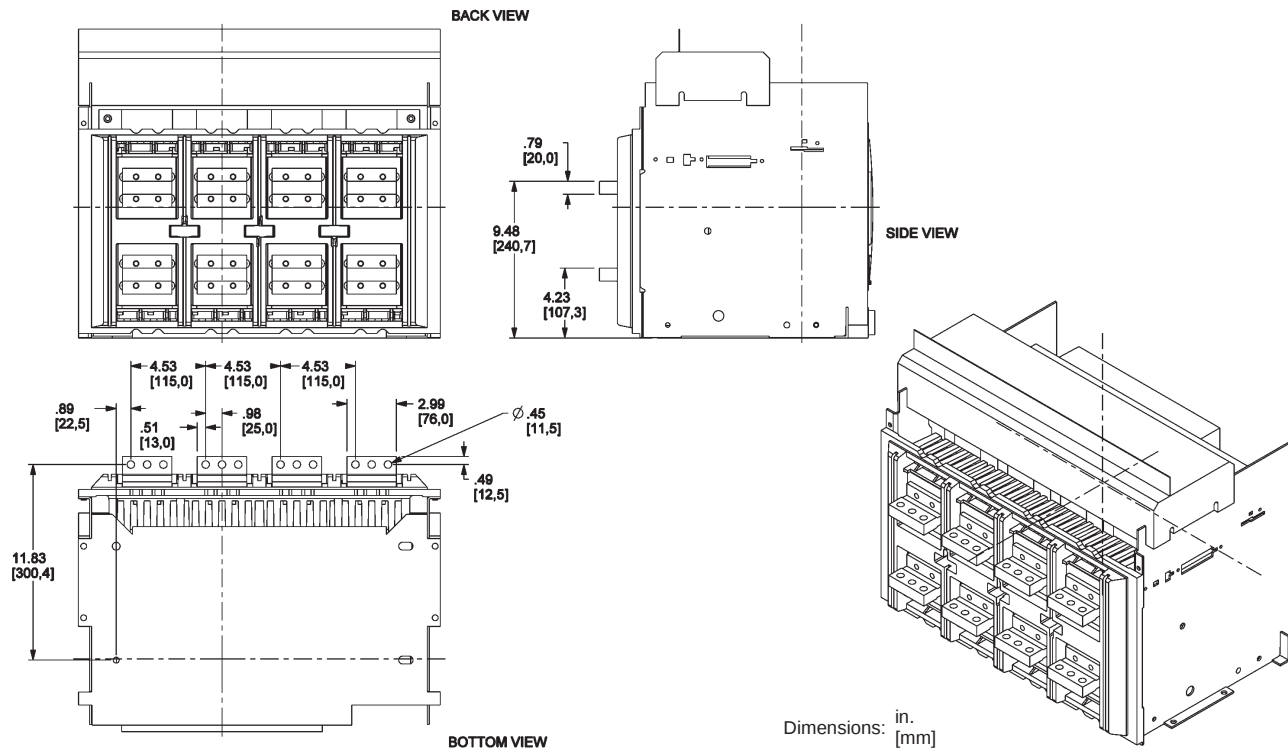


Figure 150: 800–3200 A Front-Connected Flat (FCF)

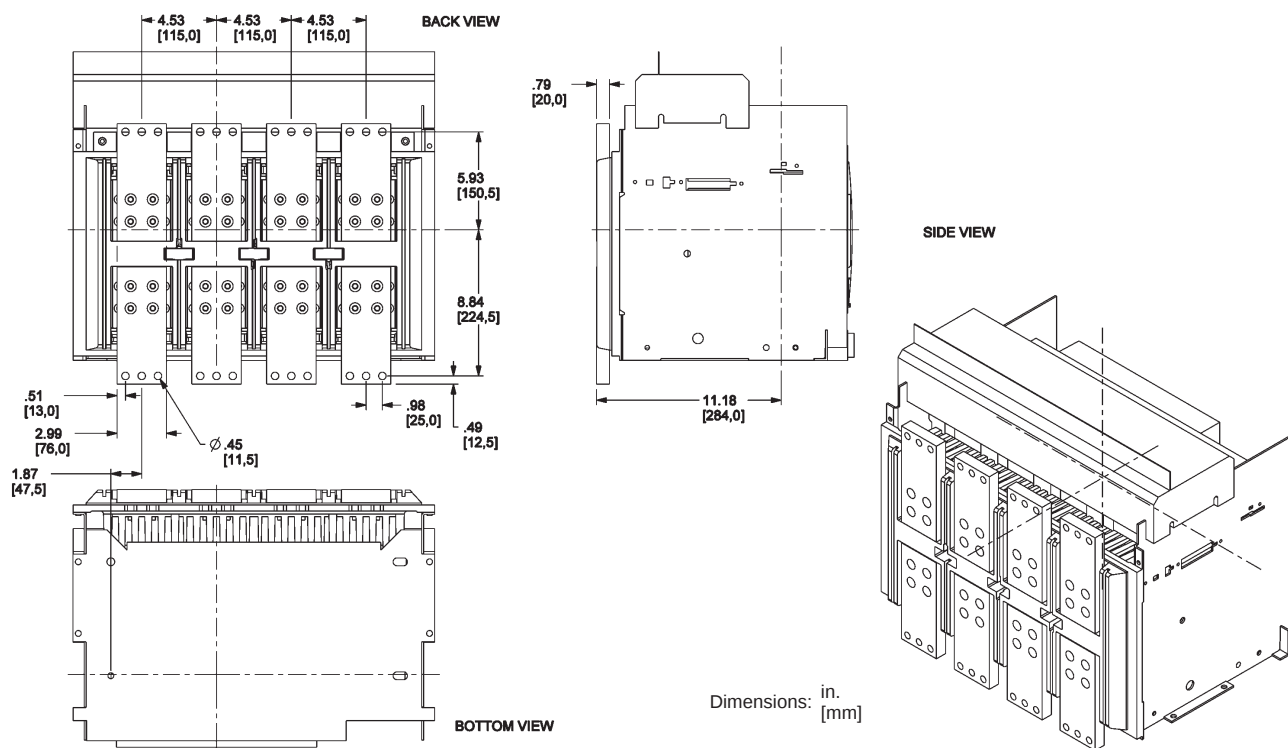

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 151: 4000 A Rear-Connected "T" Vertical (RCTV)


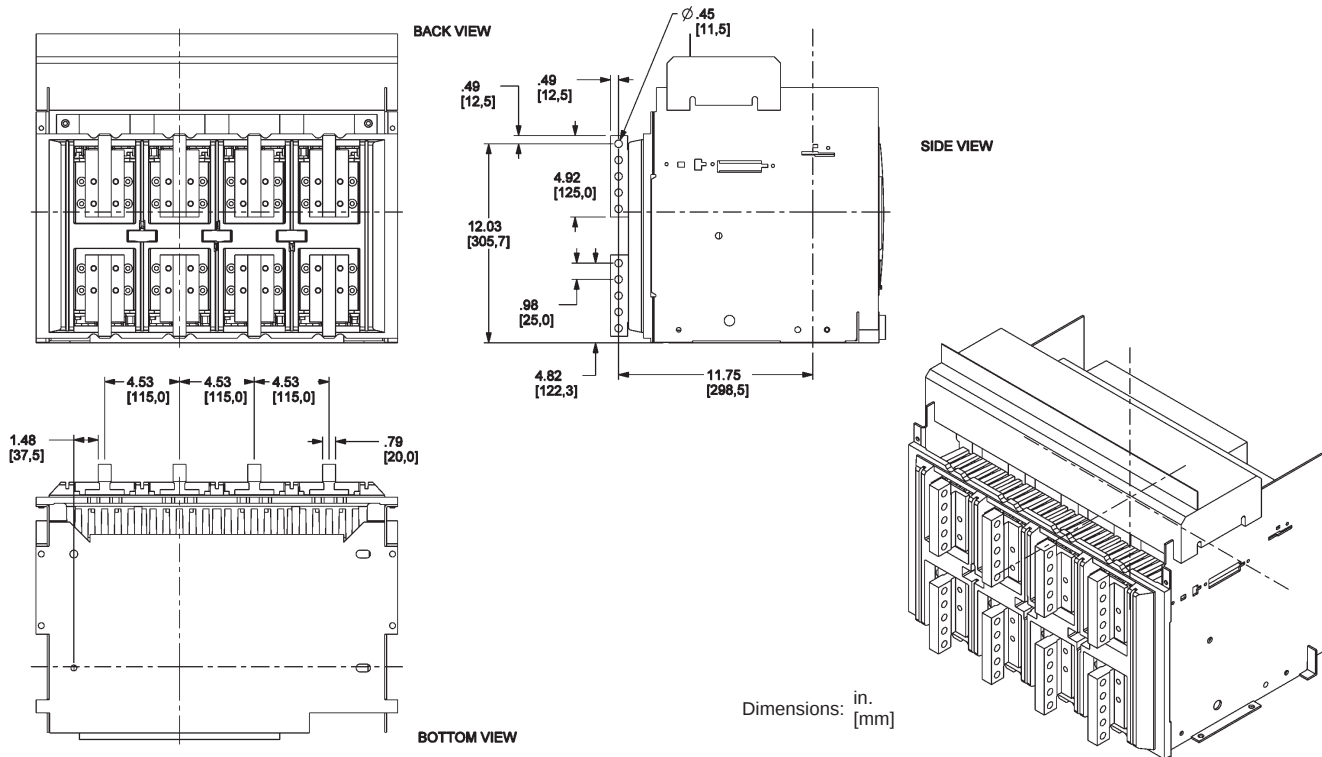


Figure 152: 4000 A Rear-Connected "T" Horizontal (RCTH)

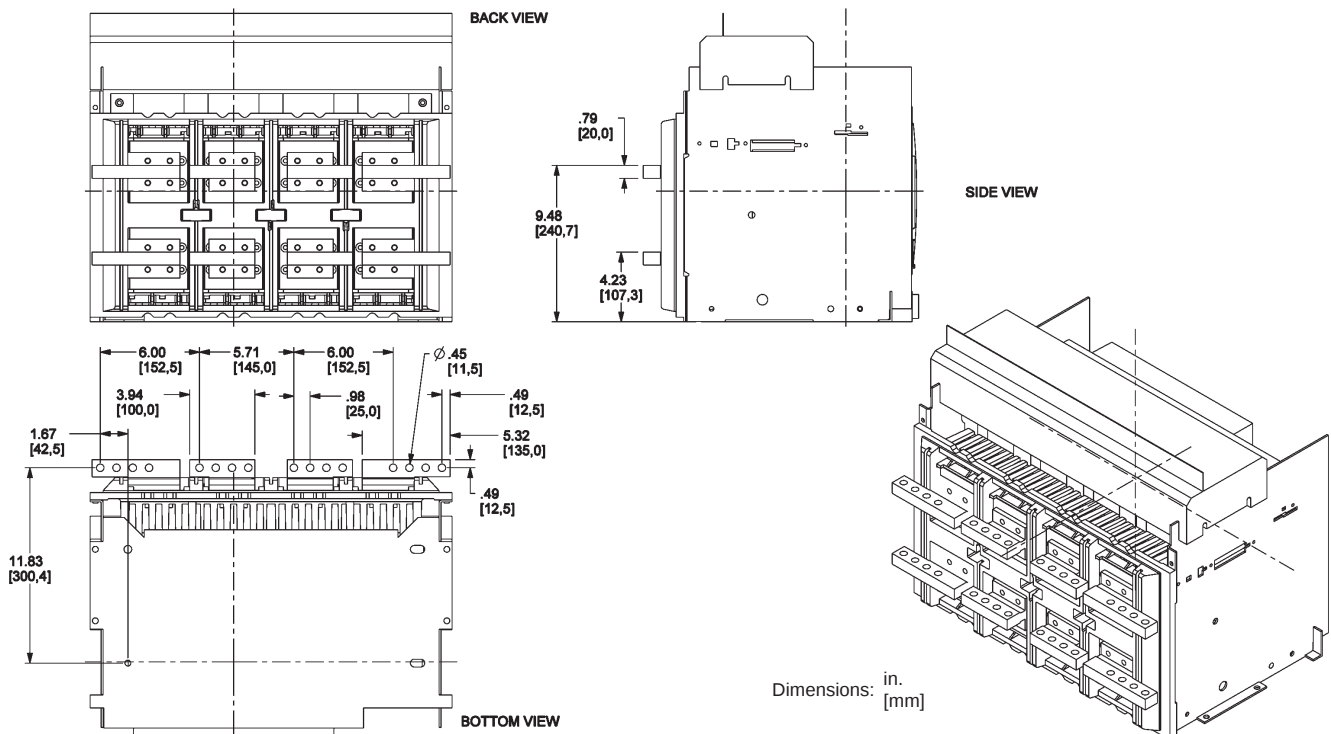

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 153: 5000 A Rear-Connected “T” Vertical (RCTV)


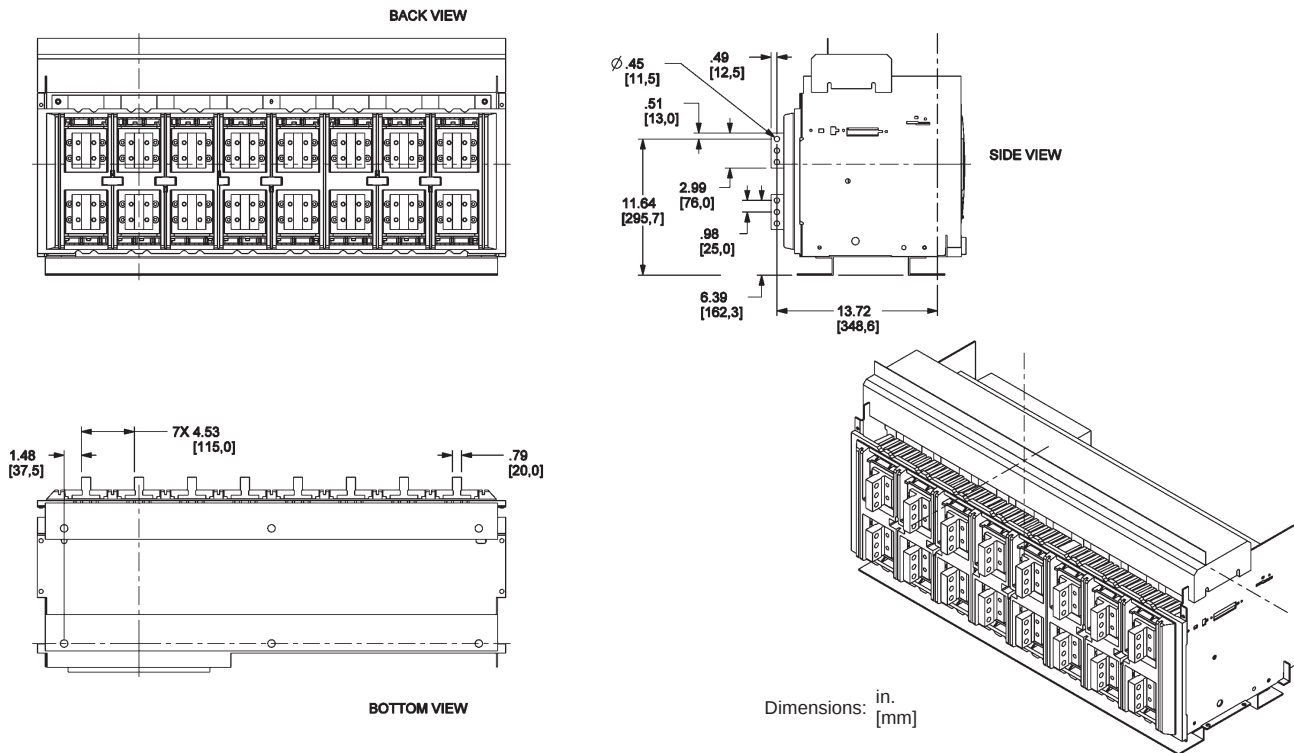



Figure 154: 5000 A Rear-Connected “T” Horizontal (RCTH)

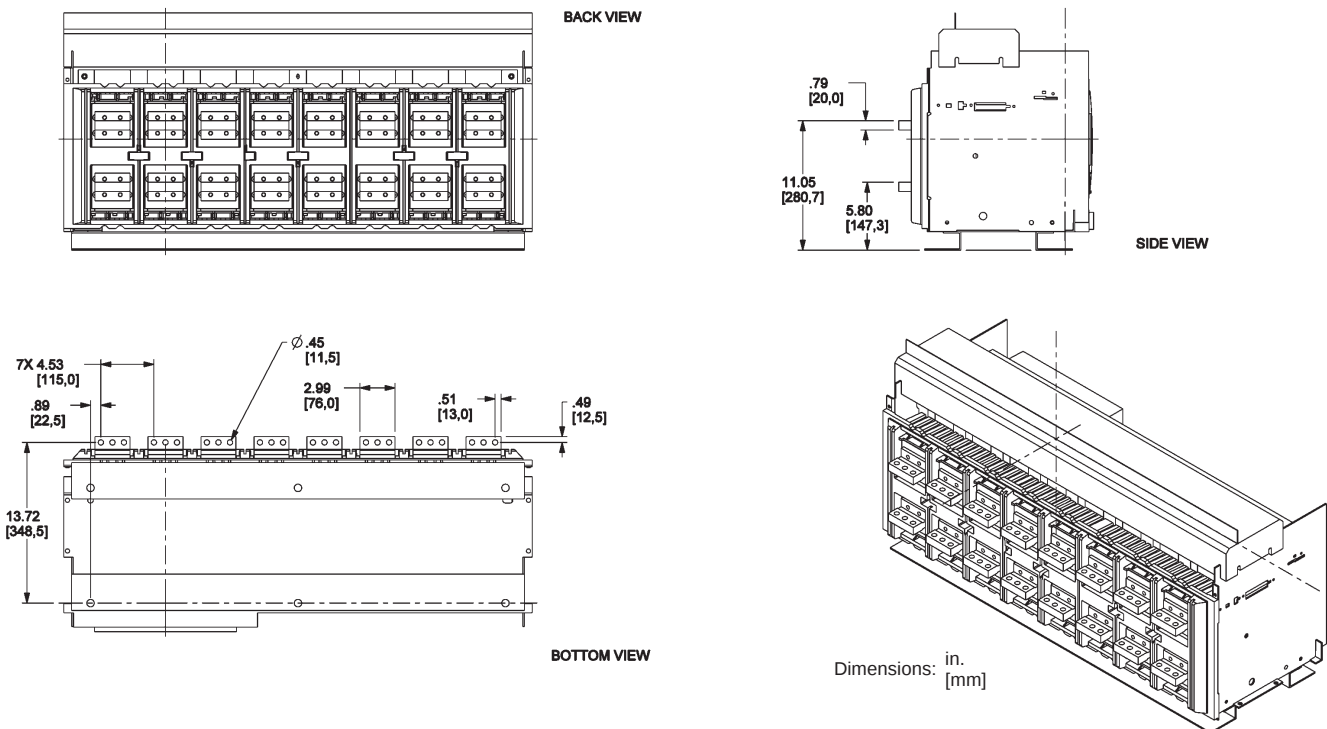

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 155: 6300 A Rear-Connected “T” Vertical (RCTV)

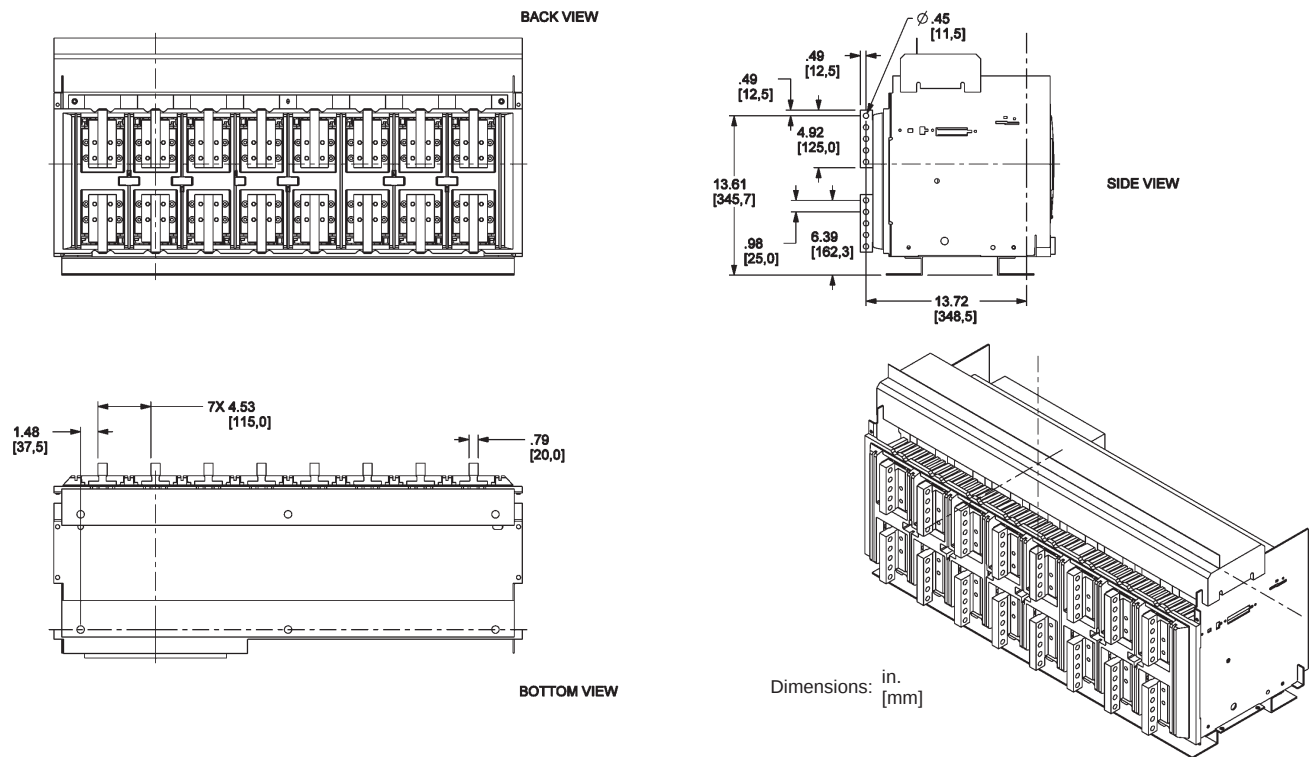


Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

IEC 4P Fixed Circuit Breakers

Figure 156: 800–3200 A Rear-Connected "T" Vertical (RCTV)

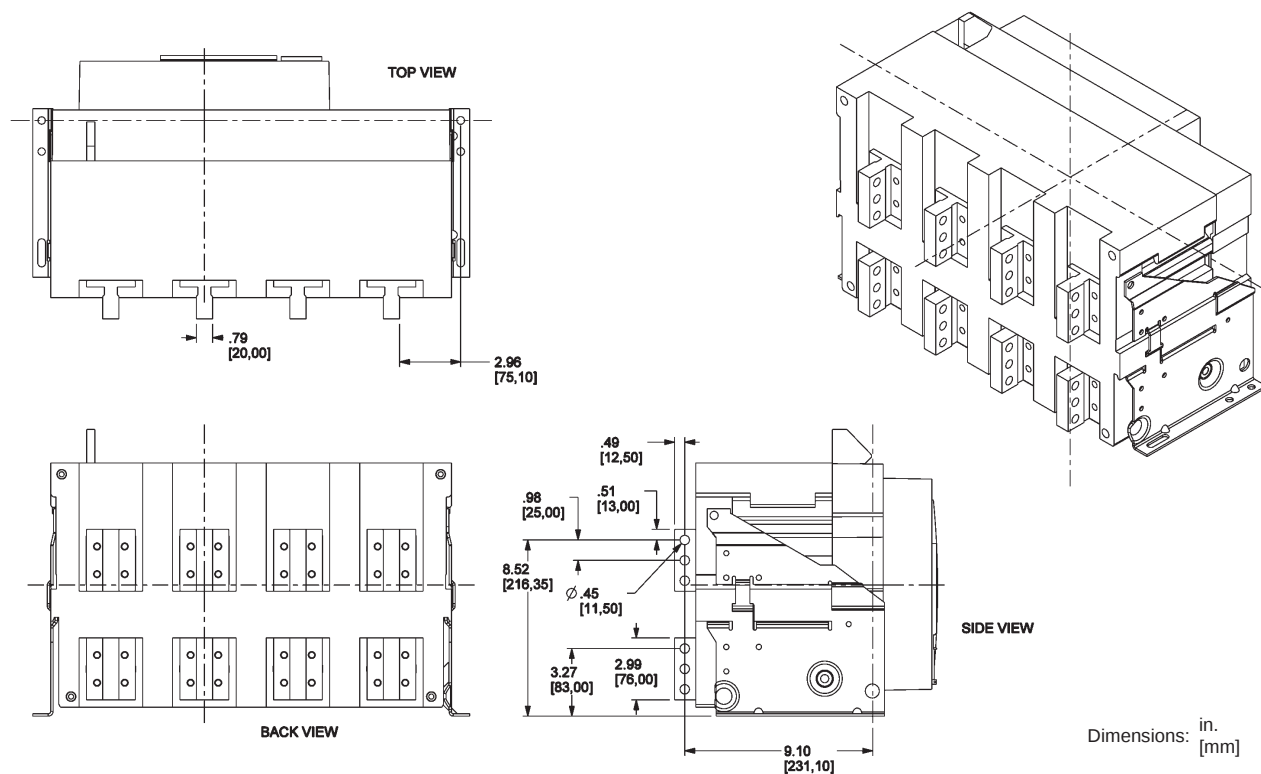

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 157: 800–3200 A Rear-Connected "T" Horizontal (RCTH)


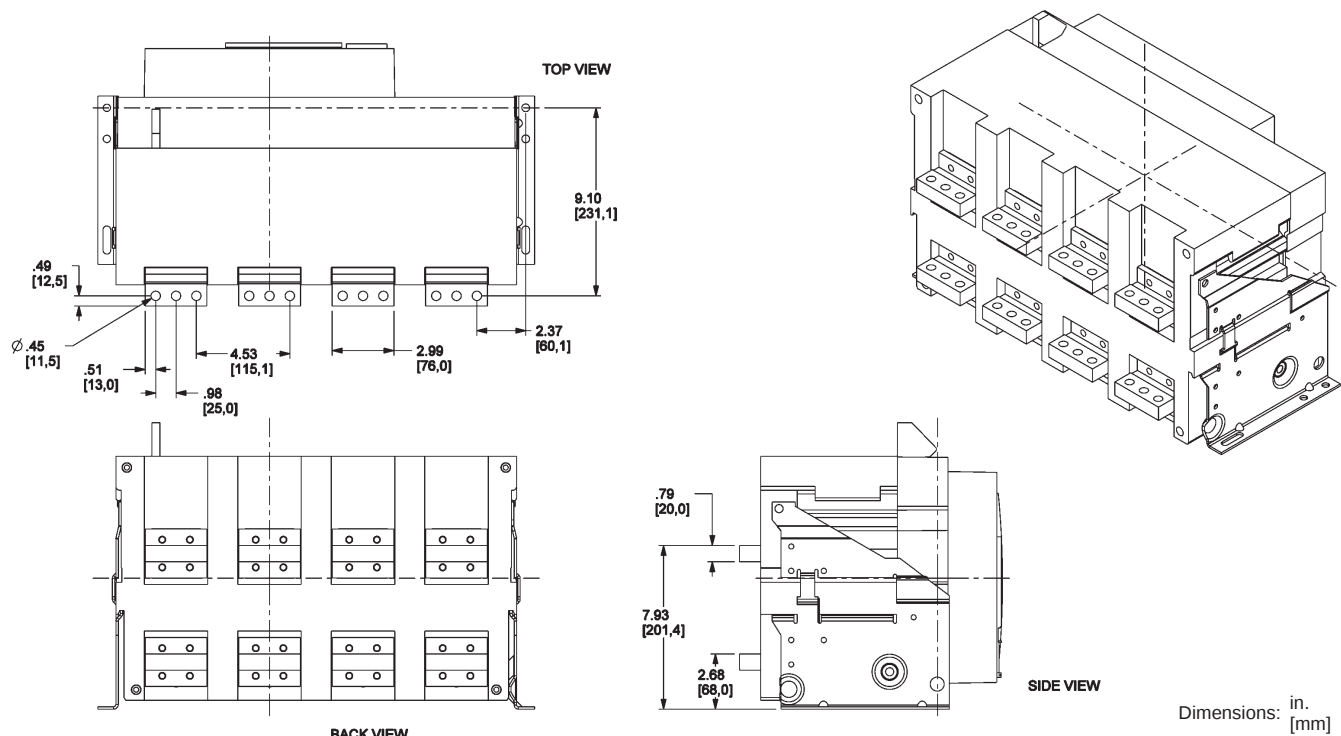


Figure 158: 800–3200 A Front-Connected Flat (FCF)

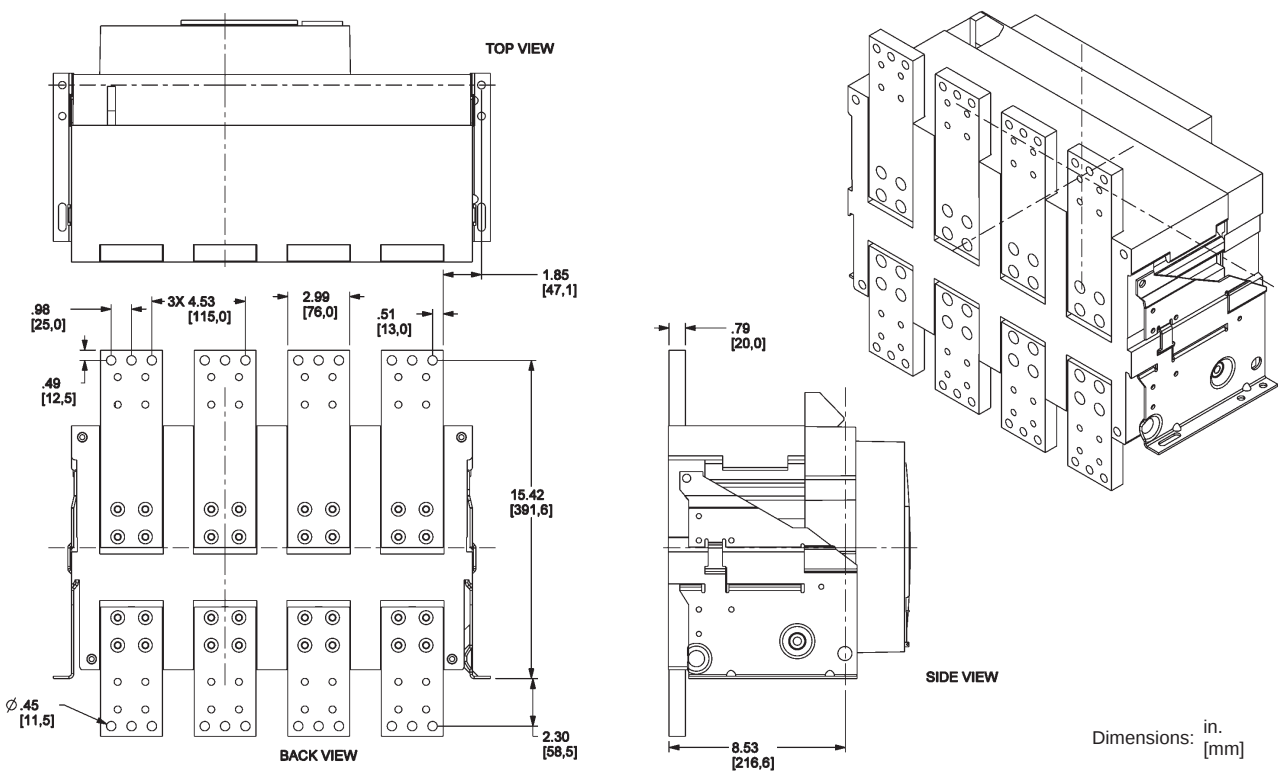

Masterpack™ NT and NW Universal Power Circuit Breakers

Masterpack NW Dimensional Drawings

Figure 159: 4000 A Rear-Connected "T" Vertical (RCTV)


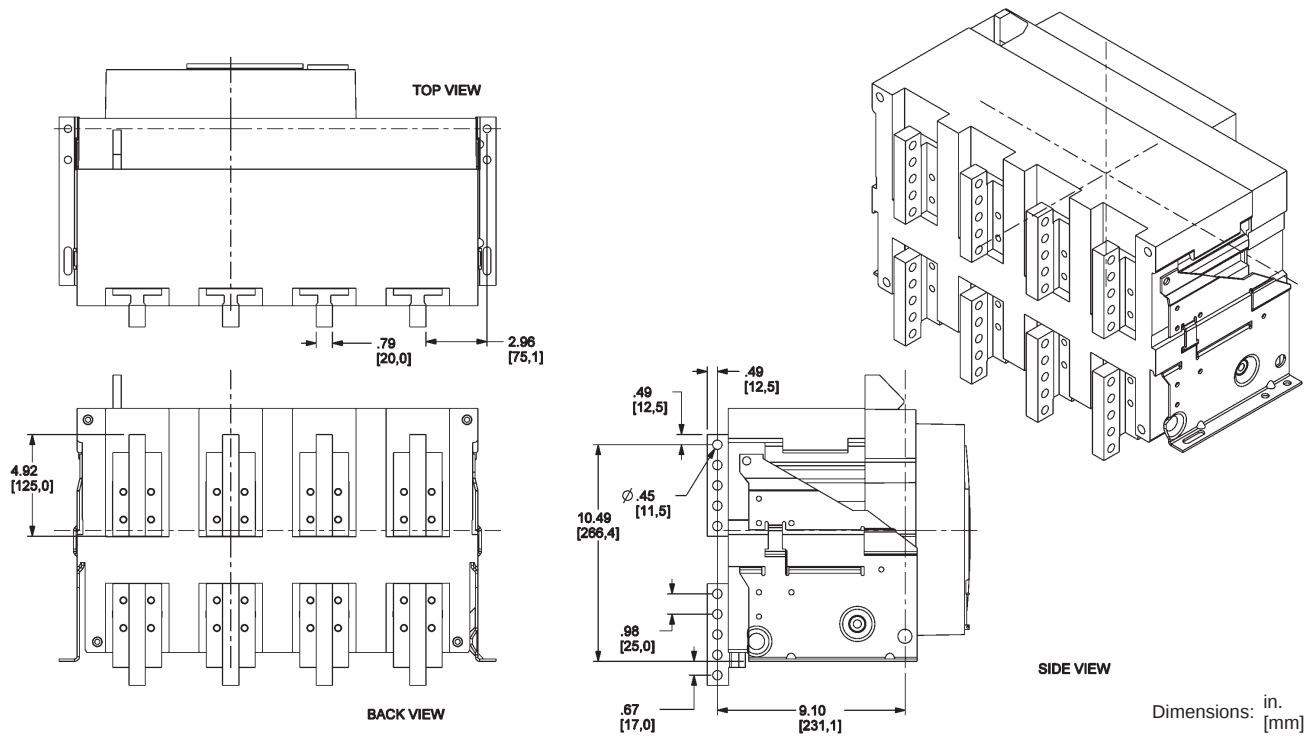


Figure 160: 4000 A Rear-Connected "T" Horizontal (RCTH)

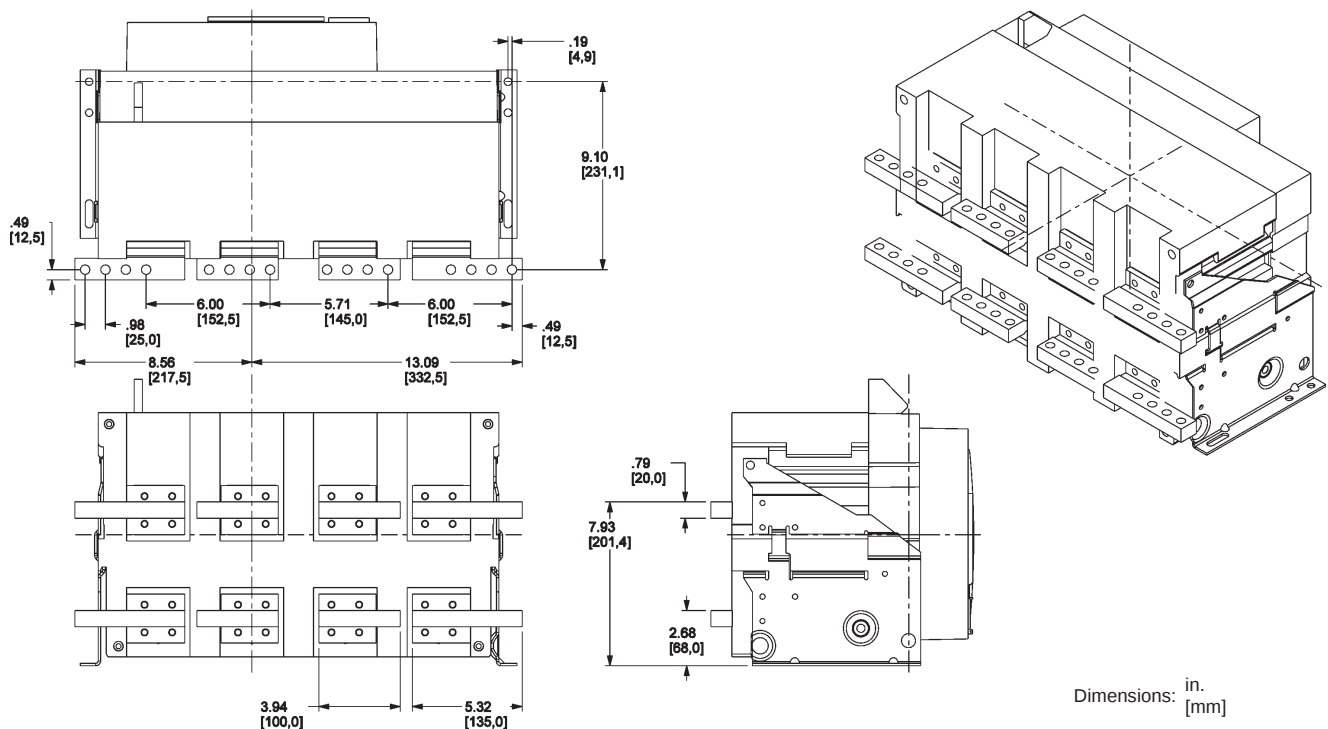

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 161: 5000 A Rear-Connected “T” Vertical (RCTV)


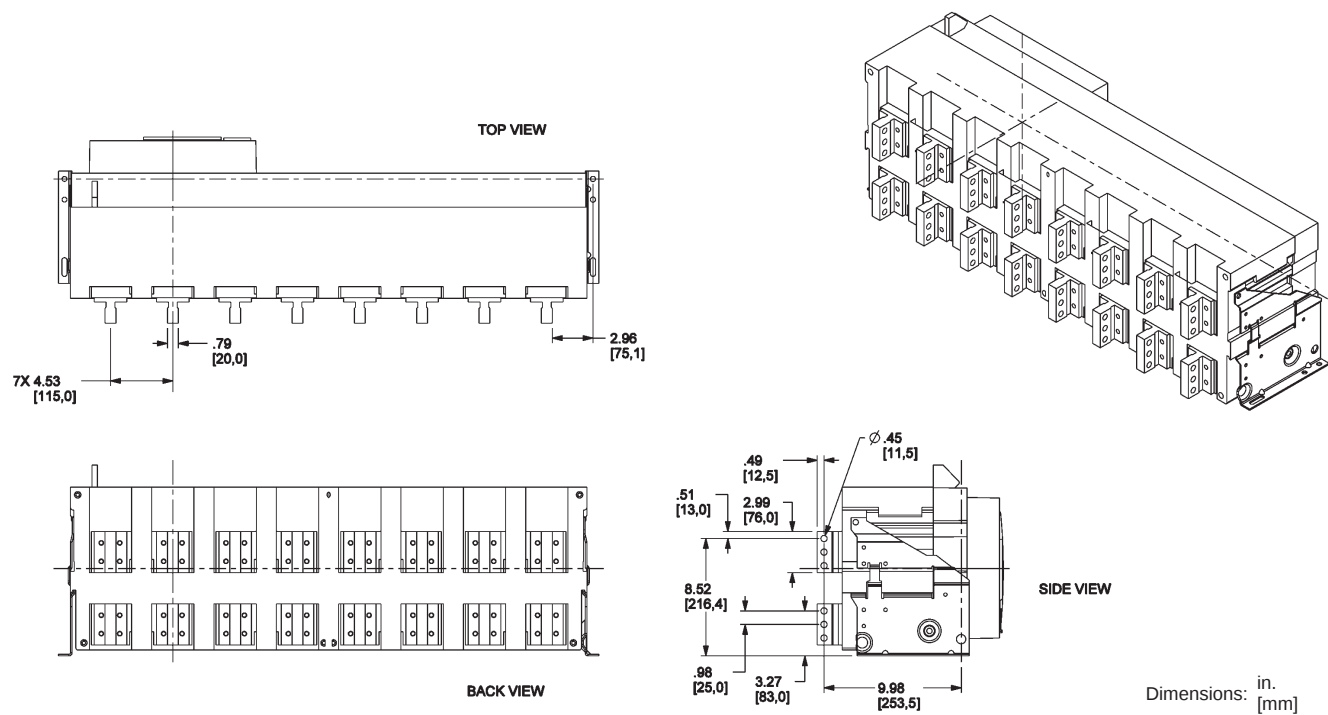


Figure 162: 5000 A Rear-Connected “T” Horizontal (RCTH)

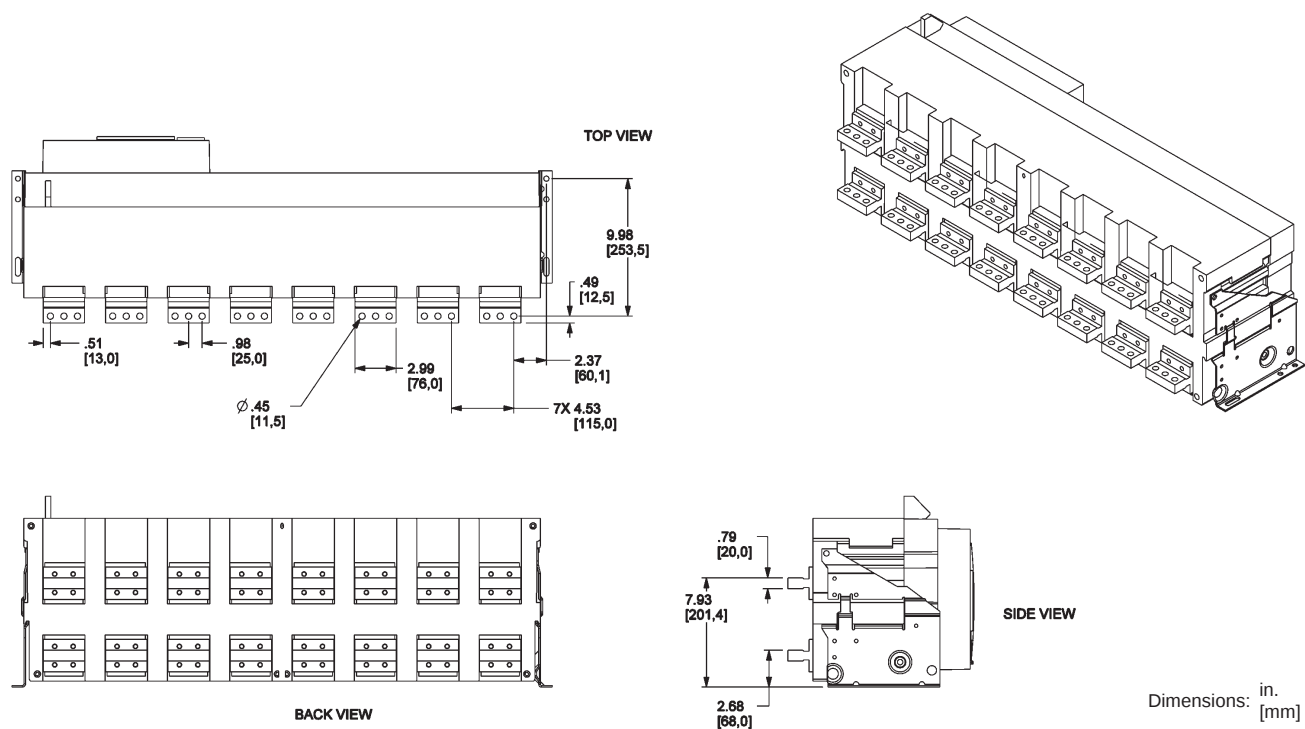

Masterpact™ NT and NW Universal Power Circuit Breakers

Masterpact NW Dimensional Drawings

Figure 163: 6300 Rear-Connected “T” Vertical (RCTV)

