

STP100

Temperaturgivare för dykrör

NTC 1.8 k Ω



STP100 är byggd för montering i rörsystem med separat dykrör. Dykröret är förslutet nedtill så att det är lätt att byta ut givaren om så behövs.

STP100-huset har ett pluggat hål med Ø 20 mm för kabeln.

OBS! Dykröret måste beställas separat. Se Tillbehör.

TEKNISKA DATA

Artikelnummerse tabell
Givarelement NTC, 1.8 kohm vid +25 °C

Tidskonstant utan dykrör i vatten ca 7 s

Material:

Dykrör rostfritt stål

Kopplingsdosa polyamidplast

Kapslingsklass IP 65

Mått enligt figur och tabell

Noggrannhet se tabell på nästa sida

Temperaturer

Omgivningmin. -10 °C

.....max. 110 °C

Driftmin. -40 °C

.....max. 150 °C


Standarder

EMC..... EN 50081-1, EN 50082-1

Tidskonstant med dykrör i vatten:

Dykrörstyp	Med kontakt-pasta	Utan kontakt-massa
Mässing PN16	19 s	23 s
Rostfritt stål PN25	20 s	24 s

MÅTT (mm)

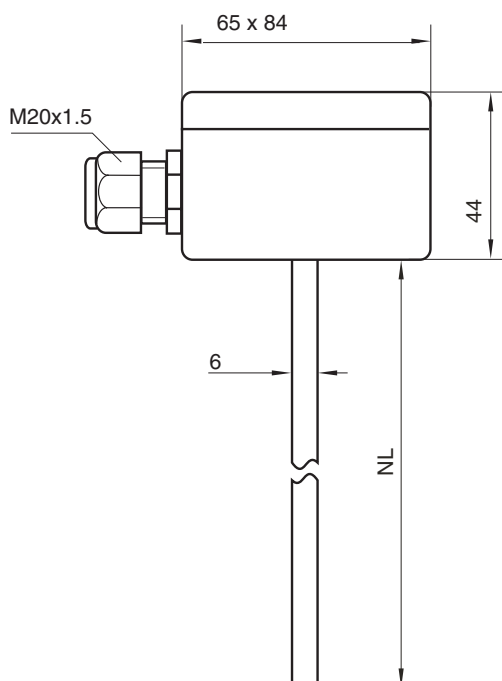



ARTIKELNUMMER

Artikelnummer	Beskrivning	Probe mm	NL mm	Vikt g
512-3102-010	STP100-50	50	63	100
512-3104-010	STP100-100	100	113	104
512-3106-010	STP100-150	150	163	107
512-3108-010	STP100-200	200	213	110
512-3110-010	STP100-250	250	263	113
512-3112-010	STP100-300	300	313	117
512-3114-010	STP100-400	400	413	125

NOGGRANNHET

Vid temperatur	Noggrannhet
-25 °C	±0.7 °C
±0 °C	±0.5 °C
25 °C	±0.3 °C
50 °C	±0.6 °C
75 °C	±0.9 °C
100 °C	±1.3 °C


TILLBEHÖR

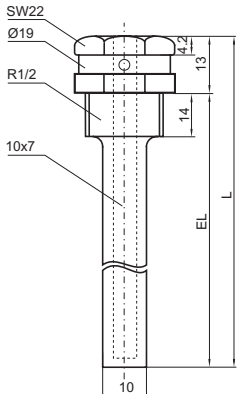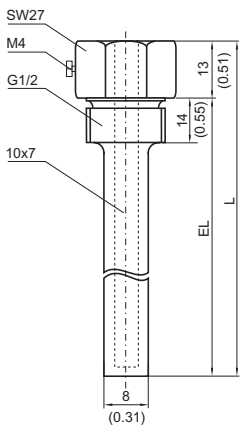	Artikelnummr	Beskrivning	Längd mm	Vikt g
Mässing-/nickelpläterat dykrör PN16				
	912-1040-000	Dykrör STP50 mm	63	85
	912-1041-000	Dykrör STP100 mm	113	100
	912-1042-000	Dykrör STP150 mm	163	115
	912-1043-000	Dykrör STP200 mm	213	130
	912-1044-000	Dykrör STP250 mm	263	145
	912-1045-000	Dykrör STP300 mm	313	160
	912-1046-000	Dykrör STP400 mm	413	190
Dykrör i rostfritt stål PN25				
	912-1050-000	Dykrör STP50 mm	63	75
	912-1051-000	Dykrör STP100 mm	113	85
	912-1052-000	Dykrör STP150 mm	163	95
	912-1053-000	Dykrör STP200 mm	213	105
	912-1054-000	Dykrör STP250 mm	263	115
	912-1055-000	Dykrör STP300 mm	313	125
	912-1056-000	Dykrör STP400 mm	413	145


MONTERING

Montera dykröret i rörsystemet.

Lägg på lite kontaktpasta, sätt in givaren i dykröret och dra åt fixeringsskruven.

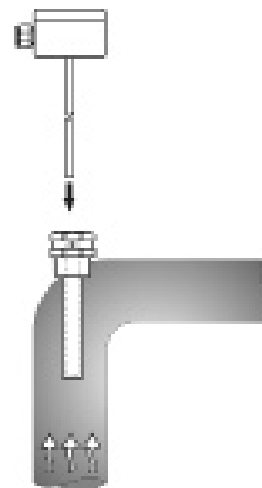

INKOPPLING



On October 1st, 2009, TAC became the Buildings Business of its parent company Schneider Electric. This document reflects the visual identity of Schneider Electric, however there remains references to TAC as a corporate brand in the body copy. As each document is updated, the body copy will be changed to reflect appropriate corporate brand changes.

All brand names, trademarks and registered trademarks are the property of their respective owners.