


Fixed, manually operated Compact NS (cont.)

Wiring of the COM option (Modbus BCM ULP Module) with or without ULP module (FDM121...)

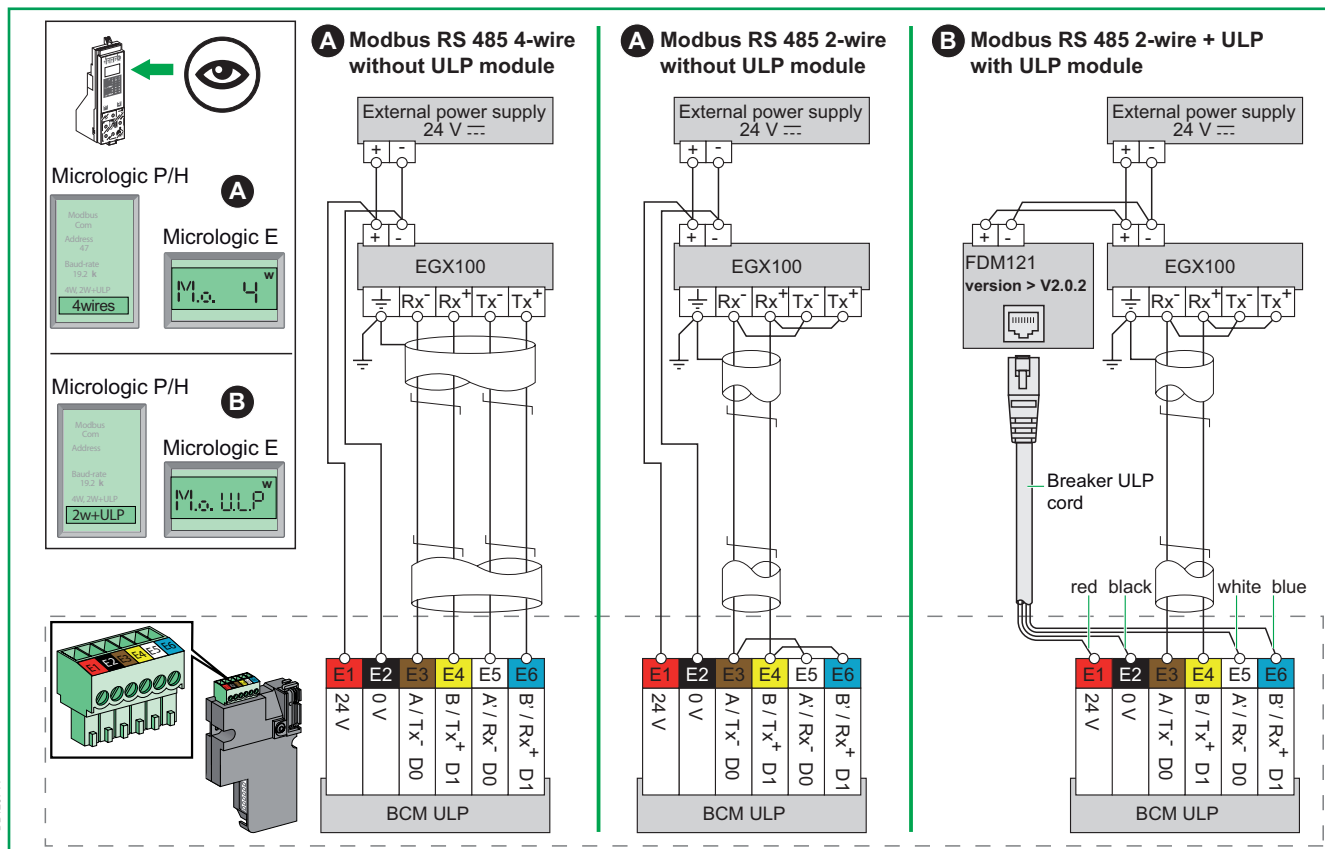

DE128744

Note: please refer to gateway (EGX100) instructions for grounding shield terminations, all unconnected ends of shields shall be properly insulated.