


The diagram is shown with circuits de-energized with all devices open

After tripping initiated by the "Push to trip" button or by the undervoltage (MN) release or the shunt (MX) release, device reset can be automatic, remote or manual.

Following tripping due to an electrical fault, device reset can be remote or manual.

## Connection for CVS100 to 630

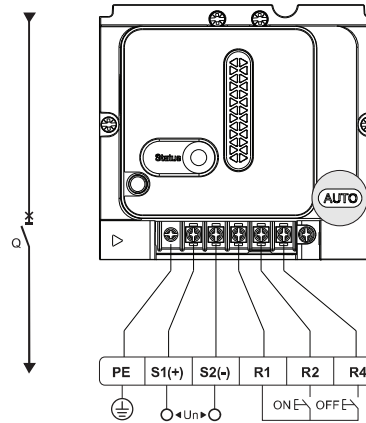

### Symbols

Q:	circuit breaker
PE:	Earth
S1(+):	power supply - AC/DC(+)
S1(-):	power supply - AC/DC(-)
R1:	remote control common terminal
R2:	remote closing order terminal
R4:	remote opening order terminal

