




XPS-AS Replaced by XPS-AK

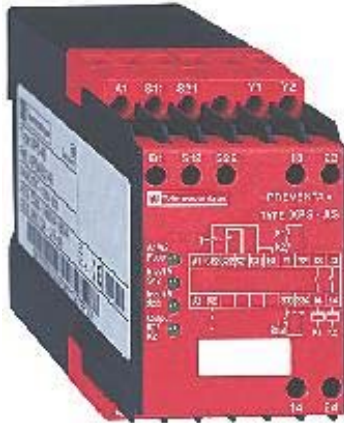


Differentiation

- XPS-AK has 1 extra N/O safety output
- XPS-AK has 1 extra additional N/C output
- XPS-AK has 4 solid state output for PLC signalling
- XPS-AK has choice of removable plug terminals
- XPS-AS can be used for Type III A two-hand control monitoring




XPS-AS Replaced by XPS-AK

Monitoring of E-stop with 2N/C contacts

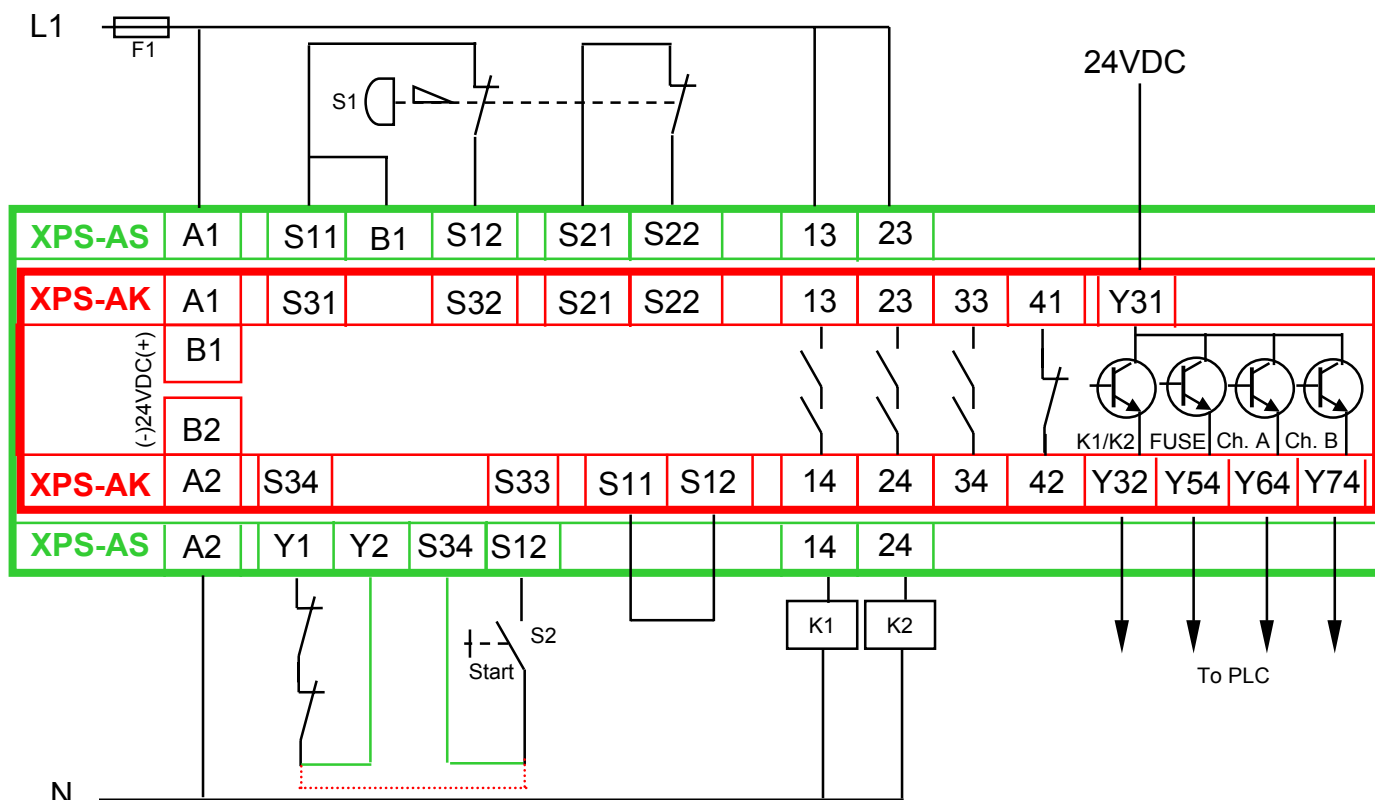

Monitoring of E-stop with 1N/C contact

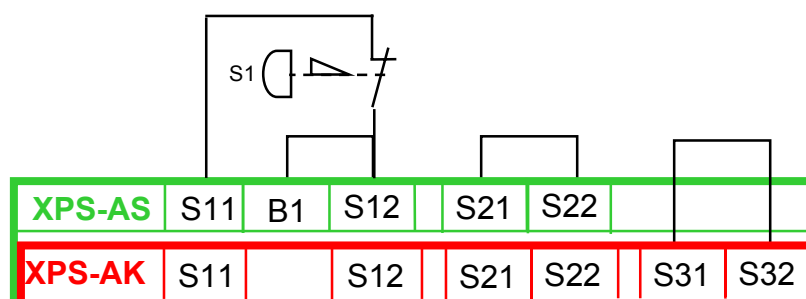





XPS-AS Replaced by XPS-AK

Schematic Comparison

Monitoring of E-stops with 2N/C contacts in series

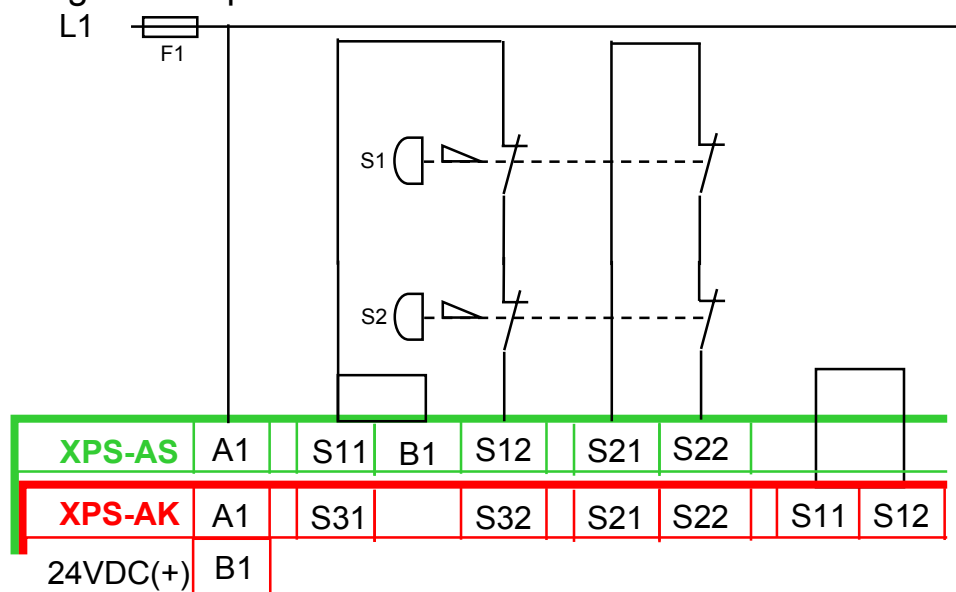

Monitoring of a movable guard associated with 2 limit switches with 1 contact each

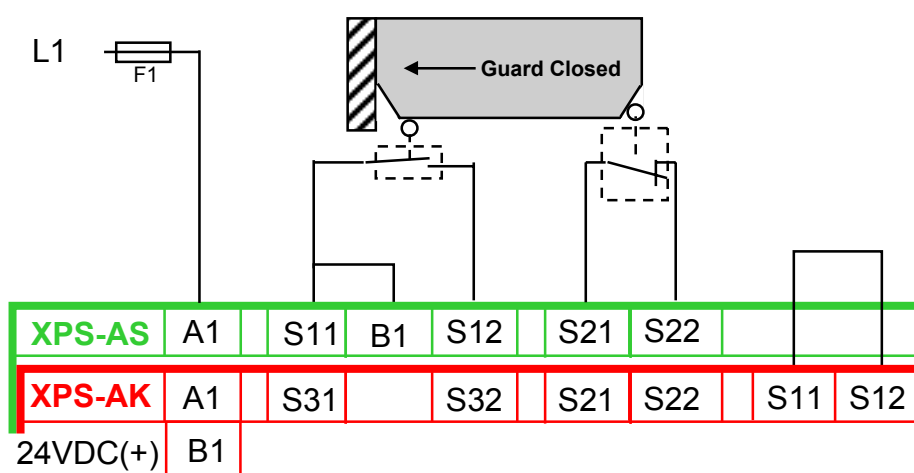



XPS-AS Replaced by XPS-AK

Cross Reference Table

Supply Voltage	Obsolete Reference	Existing Reference *
24VAC/DC	XPS-AS5140	XPS-AK311144
48VAC/DC	XPS-AS5340	-
120VAC	XPS-AS3440	XPS-AK351144
230VAC	XPS-AS3740	XPS-AK371144
*add P to reference for removable plug terminals		