


Compact NSX100-250
FPower NSX

Vigi / Insulation monitoring module
Bloc Vigi / Surveillance isolement
Bloque Vigi / vigilancia de aislamiento

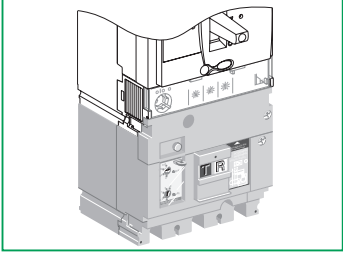

Merlin Gerin
Square D
Idemecanique

Schneider
Electric

GHD16268AA-02

Schneider Electric Industries SAS
89, boulevard Franklin Roosevelt
F-92500 Rueil-Malmaison (France)
Tel: + 33 (0)1 41 29 85 00
www.schneider-electric.com



© 2007 Schneider Electric.
All rights reserved.

IMPORTANT NOTE

■ This device must be installed by a qualified electrician.
■ We cannot accept any responsibility for failure to follow the instructions provided in this document.

REMARQUE IMPORTANTE













■ L'installation de cet appareil doit être effectuée par des professionnels de l'électricité.
■ Le non-respect des indications de la présente notice ne saurait engager la responsabilité du constructeur.

OBSERVACIÓN IMPORTANTE

■ La instalación y mantenimiento de este aparato sólo debe ser realizado por electricistas profesionales.
■ El fabricante no se hace responsable en caso de no cumplir con las indicaciones expuestas en este aviso.


重要注意事項

■ 本装置必须由合格的电工进行安装。
■ 我们不承担任何因未遵循本文档中的指南而导致的责任。

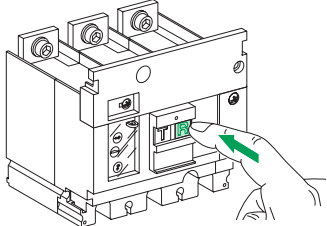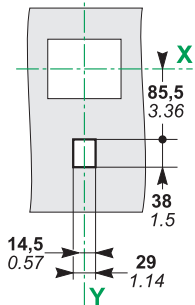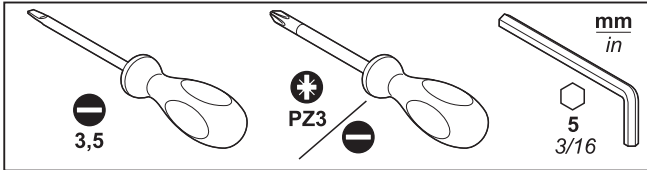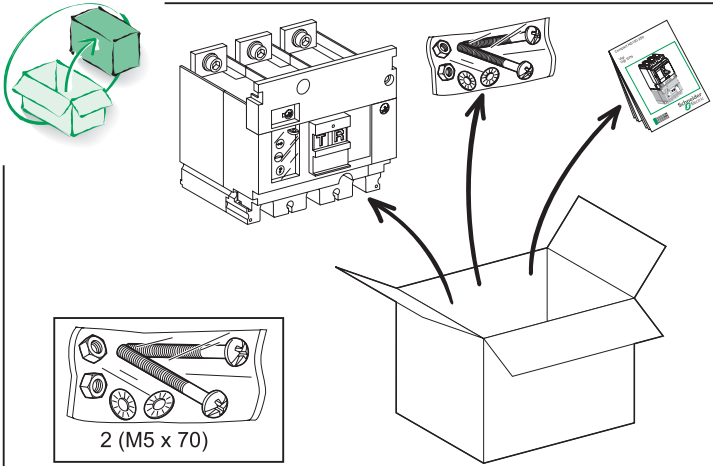



mm
in

3P



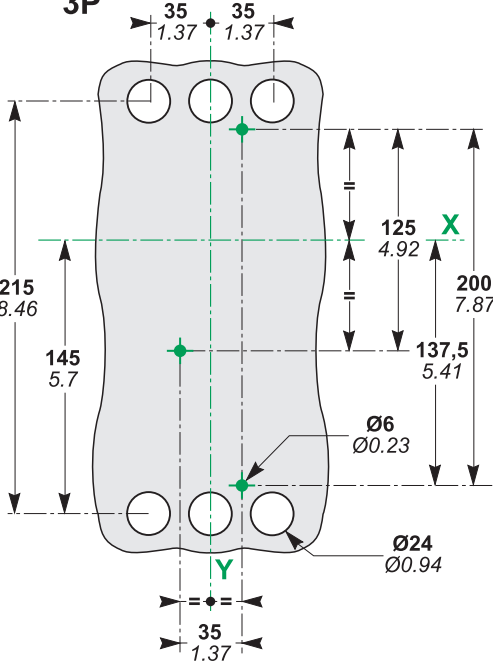


4P




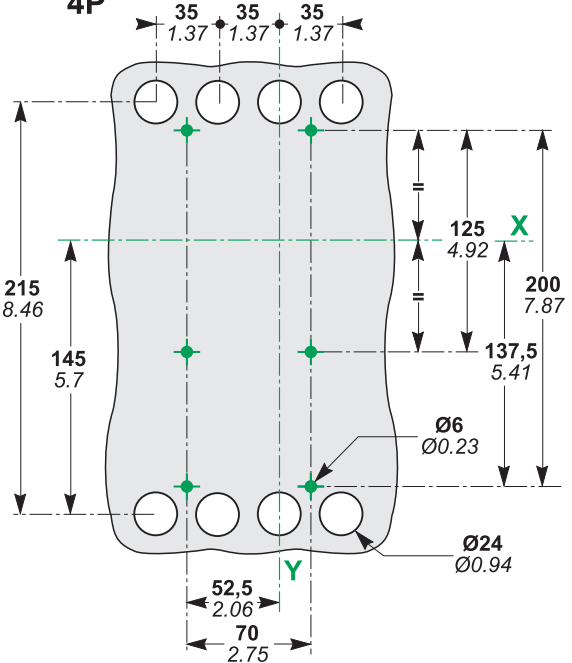








i 160/250 A



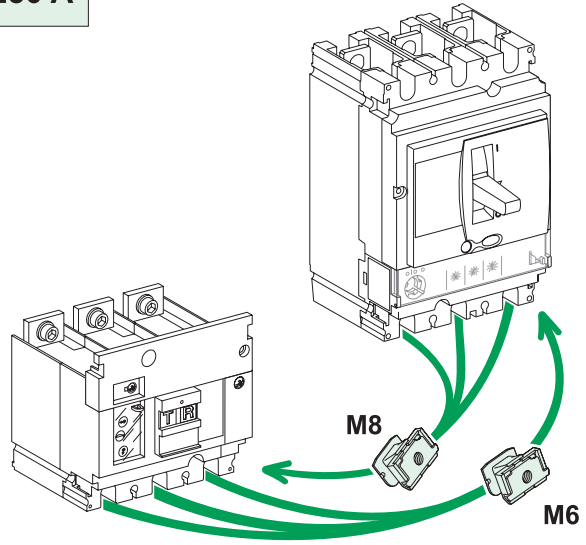
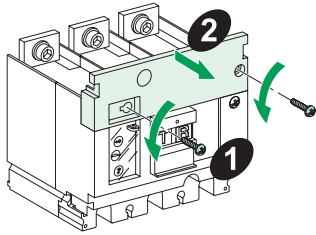



FIXED

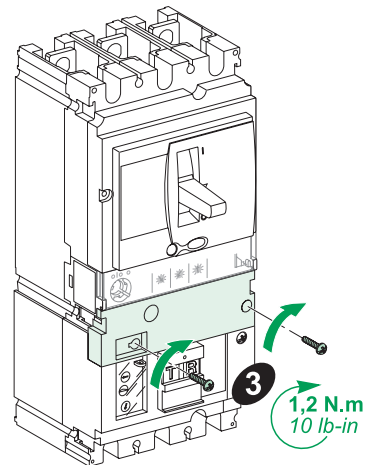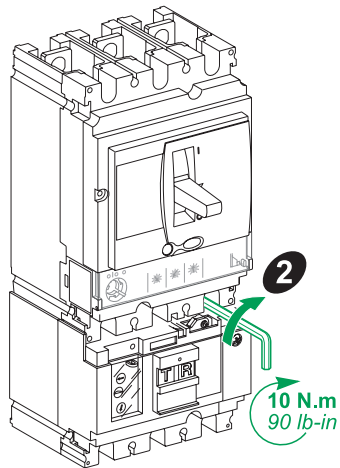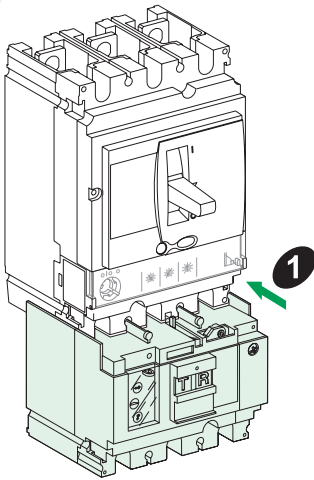


PLUG-IN

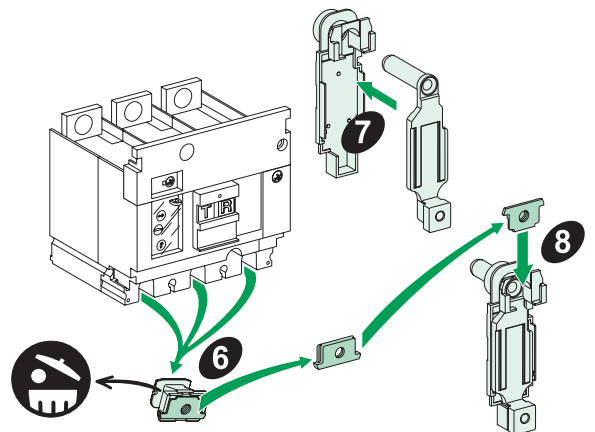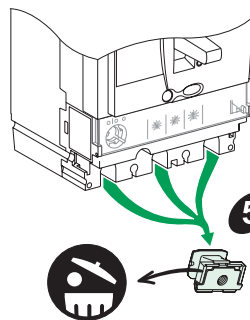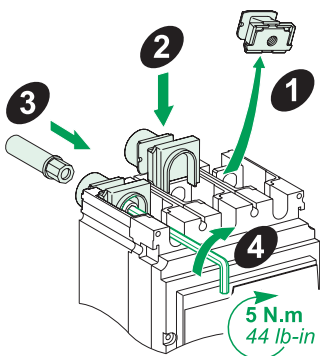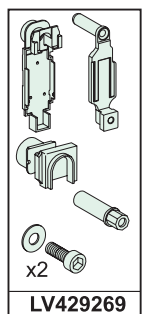

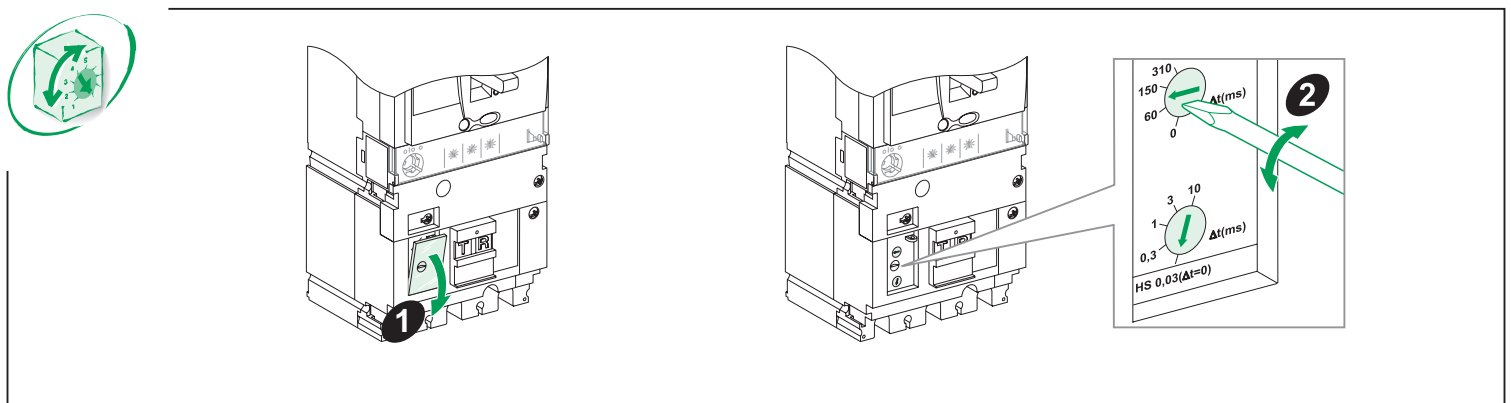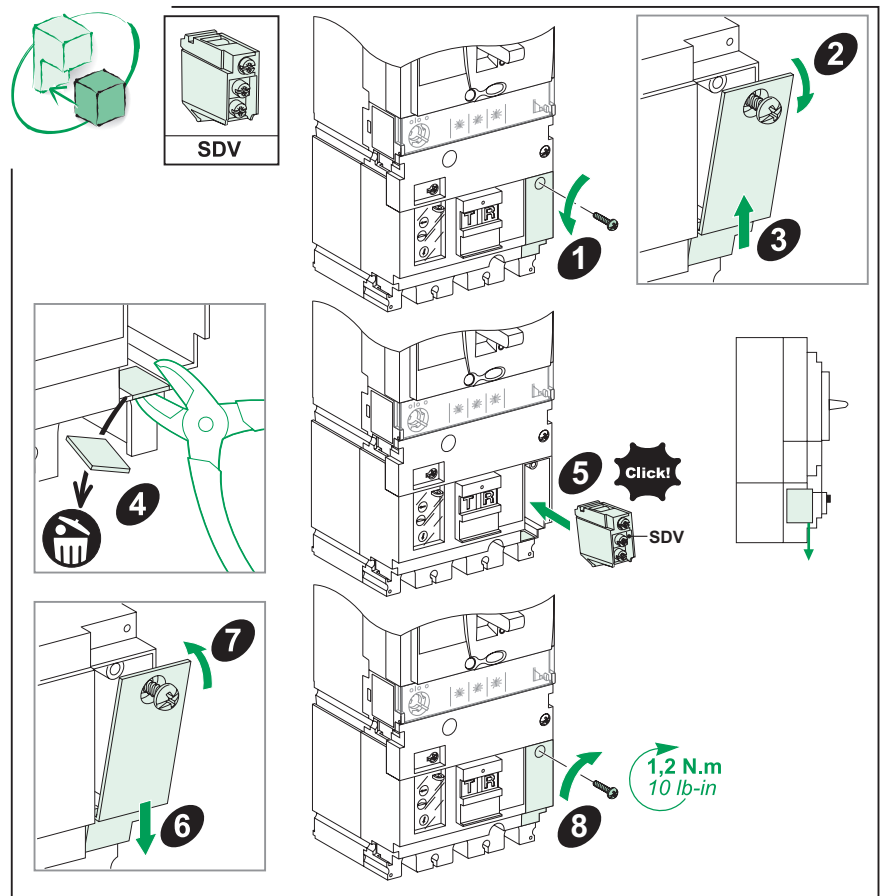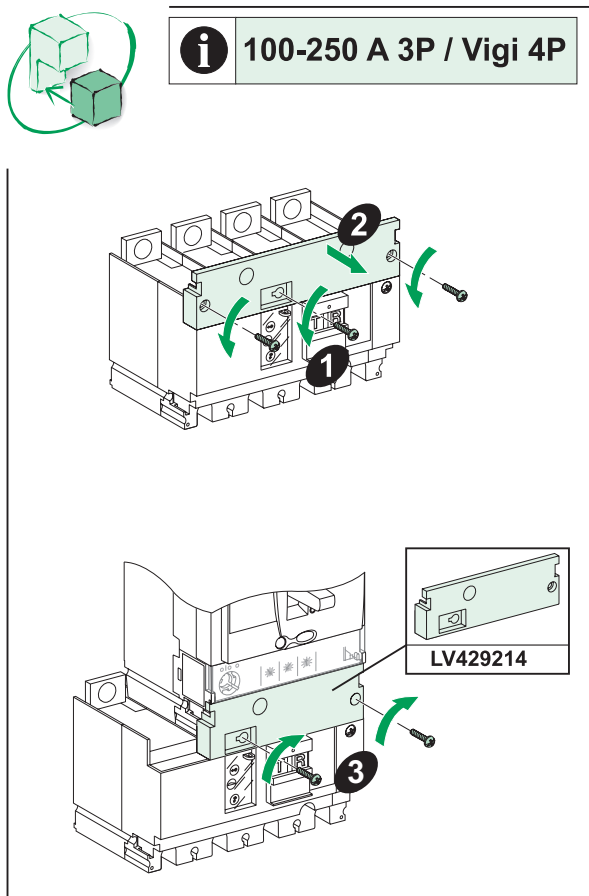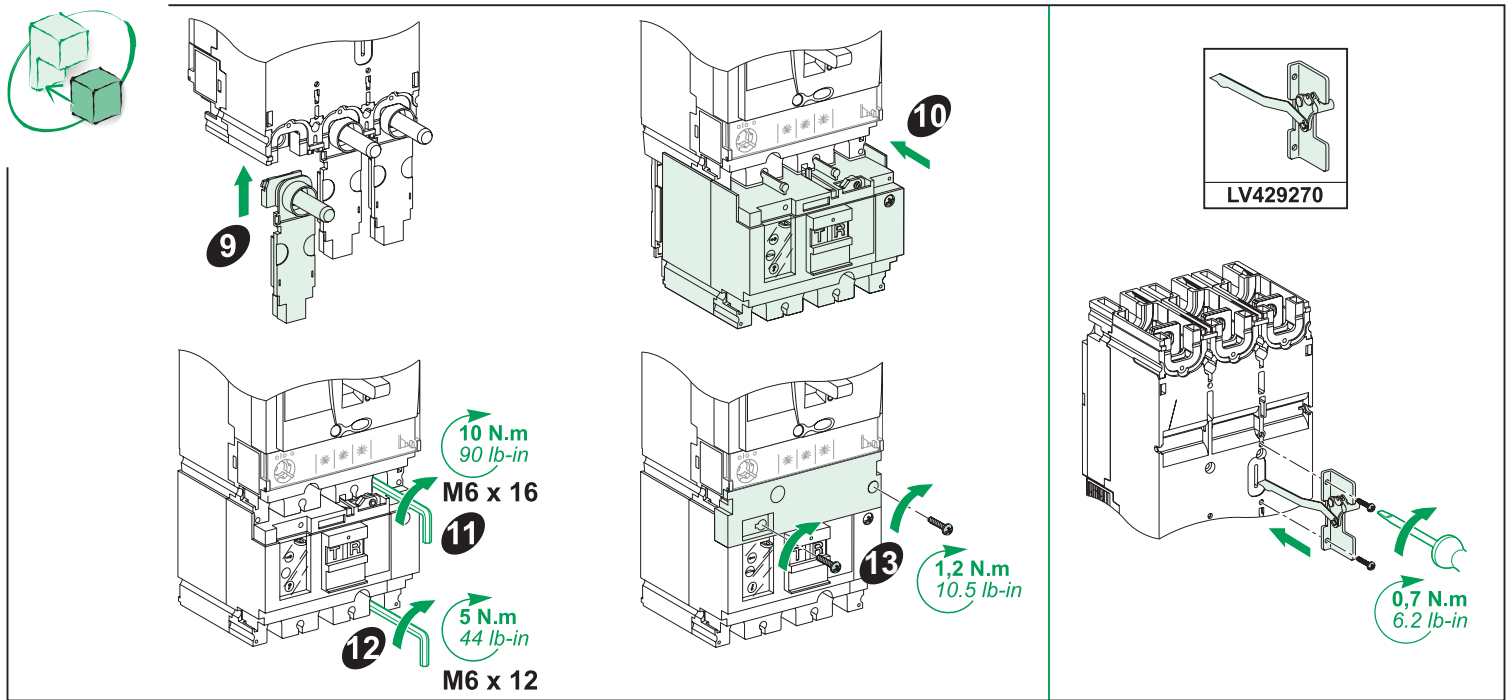


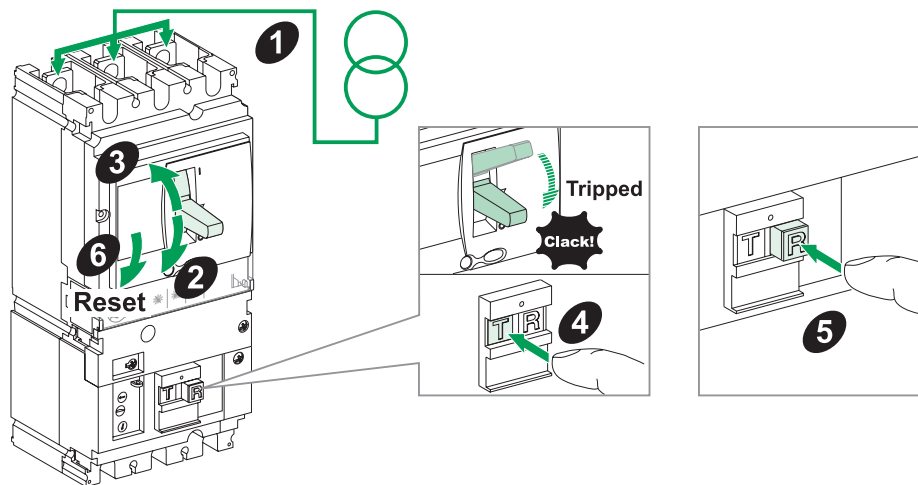

STN

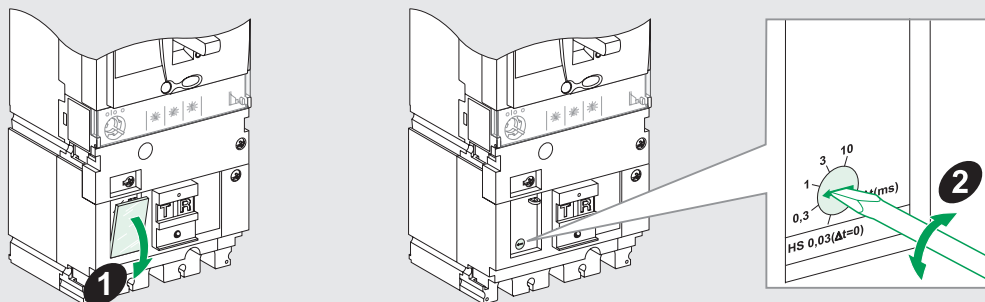

STN

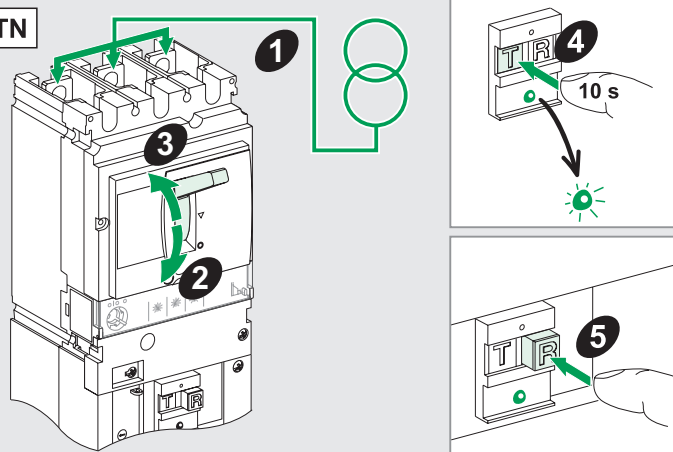

$I_r \geq 225 \text{ A} / 40^\circ \text{ C}$



LV429375

