

Old XPSAT substituted by new XPSATE

How to substitute old XPSAT unit
with time-delayed outputs by the
new equivalent XPSATE

Old XPSAT unit substituted by new XPSATE

• Main differences



XPSAT



XPSATE


Unit model	Safety Function Monitoring										Output contacts nb				Enclosure width mm	Electr. Fixed	Conne ^c . Pull	Approvals			
					Category				safe		Unsafe		UL	CSA/C-UL				BG/TuV			
					2	3	4	24V DC	24V AC	120V AC	230V AC	NO							Time delay	NC	
XPSATE	●	●		●		●	●	●	●	●	2	3		4	45	●	●	●	●		
XPSAT	●	●		●		●	●	●	●	●	3	2	1		90	●		●	●		

Old XPSAT unit substituted by new XPSATE


• Easy substitution

- All connection terminals are at the same side in the front face
- Terminals and wiring diagram are the same in the substitution for the inputs and the existing outputs

Repérage des bornes / Terminal marking

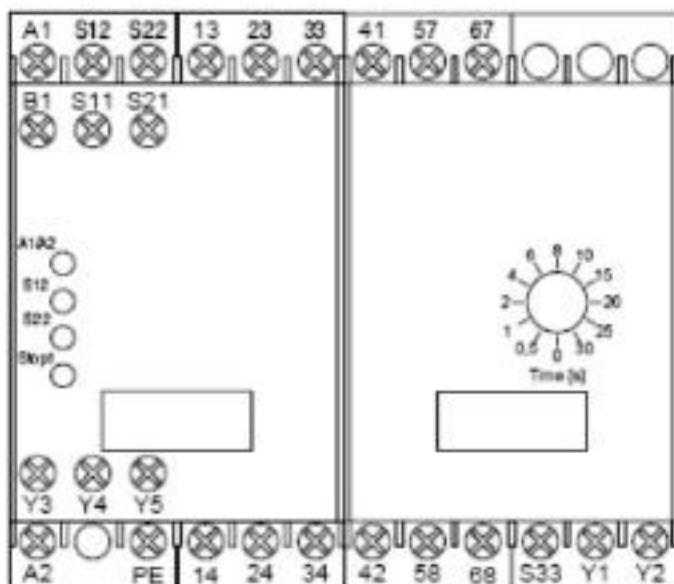

XPS-AT...

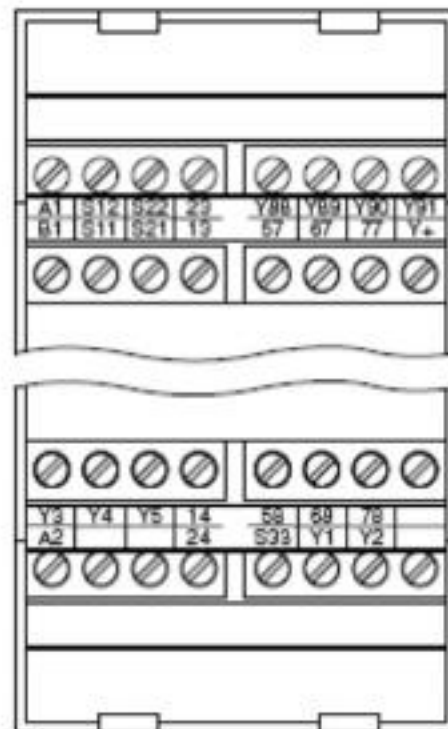

XPS-ATE....

Old XPSAT unit substituted by new XPSATE

• Cross-reference table

Supply Voltage	Old Reference	New Reference *
24VAC/DC	XPS-AT5110	XPS-ATE5110
120VAC	XPS-AT3410	XPS-ATE3410
230VAC	XPS-AT3710	XPS-ATE3710
*add P to reference for removable plug terminals		

• How to replace

